

**TEST REPORT**

Report No: QMTL/R-96676/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96676
<b>ATTN : MR. JASMAN PINTO</b>		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	<b>A1B Building, Level 02, Lounge, Kitchen</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 02.45 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	18.9°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

**TEST RESULTS**

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
**ANILA GEORGE**  
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96675/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96675
<b>ATTN : MR. JASMAN PINTO</b>		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	<b>A1B Building, Room 413, Washroom</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 02.37 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	18.7°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
**ANILA GEORGE**  
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96674/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>		Sample ID	QMTL/S-96674
		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	<b>A1B Building, Room 613, Washroom</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 02.30 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	19°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

### TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
**ANILA GEORGE**  
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96673/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96673
<b>ATTN : MR. JASMAN PINTO</b>		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	A1C Building, Room 201, Washroom		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 02.10 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	23.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
**ANILA GEORGE**  
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96672/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> <b>Abu Dhabi PO Box : 131463</b> <b>United Arab Emirates</b>  <b>ATTN : MR. JASMAN PINTO</b>	Sample ID	QMTL/S-96672	
	Date Received	08 Mar 2020	
	Date(s) Tested	08 Mar 2020 - 10 Mar 2020	
	Date Reported	16 Mar 2020	
Sample Description	<b>A1C Building, Room 421, Washroom</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 02.02 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	23°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
**ANILA GEORGE**  
**LABORATORY MANAGER**



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96671/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96671
<b>ATTN : MR. JASMAN PINTO</b>		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	A1C Building, Room 721, Washroom		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 01.50 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	24°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
**ANILA GEORGE**  
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96911/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96911
ATTN : MR. JASMAN PINTO		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	A2A Building, Level 02, Lounge		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/3:59 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	21.8°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	3
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
ANILA GEORGE  
LABORATORY MANAGER

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96913/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>	Sample ID	QMTL/S-96913		
	Date Received	09 Mar 2020		
	Date(s) Tested	09 Mar 2020 - 11 Mar 2020		
	Date Reported	18 Mar 2020		
Sample Description	A2A Building Room-308			
Sample Type	Water	Sampling Method	QMTL-WI-15	
Client Name/Project	NP	Sampled By	QMTL Representative	
Location	NYUAD	Sampling Date/Time	09.03.2020/4:20 PM	
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap	
Sample Receipt Temp	4.7°C	Sample Onsite Temp	22.4°C	
Sample Appearance	Clear	On-site Treatment	NA	
Reference	NP			

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96912/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96912
ATTN : MR. JASMAN PINTO		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	A2A Building Room-605		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/4:15 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	21.3°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96904/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>		Sample ID	QMTL/S-96904
		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	<b>A2B Building, Level 02 Lounge</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/3:46 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	24.5°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

### TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96903/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96903
		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
<b>ATTN : MR. JASMAN PINTO</b>		Date Reported	18 Mar 2020
Sample Description	<b>A2B Bulding Room-505</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/3:25 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	23°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96902/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96902
ATTN : MR. JASMAN PINTO		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	A2B Building, Room 607		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/3:16 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	25°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




ANILA GEORGE  
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96901/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>		Sample ID	QMTL/S-96901
		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	<b>A2C Building Level 02 Lounge</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/3:05 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	22.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--


Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96900/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96900
ATTN : MR. JASMAN PINTO		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	A2C Building,Room-502		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/2:55 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	21.8°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	3
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL.When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96899/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 30%;">Sample ID</td> <td>QMTL/S-96899</td> </tr> <tr> <td>Date Received</td> <td>09 Mar 2020</td> </tr> <tr> <td>Date(s) Tested</td> <td>09 Mar 2020 - 11 Mar 2020</td> </tr> <tr> <td>Date Reported</td> <td>18 Mar 2020</td> </tr> </table>	Sample ID	QMTL/S-96899	Date Received	09 Mar 2020	Date(s) Tested	09 Mar 2020 - 11 Mar 2020	Date Reported	18 Mar 2020
Sample ID	QMTL/S-96899								
Date Received	09 Mar 2020								
Date(s) Tested	09 Mar 2020 - 11 Mar 2020								
Date Reported	18 Mar 2020								
Sample Description	A2C Building,Room-708								
Sample Type	Water	Sampling Method	QMTL-WI-15						
Client Name/Project	NP	Sampled By	QMTL Representative						
Location	NYUAD	Sampling Date/Time	09.03.2020/2:41 PM						
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap						
Sample Receipt Temp	4.7°C	Sample Onsite Temp	23°C						
Sample Appearance	Clear	On-site Treatment	NA						
Reference	NP								

### TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96679/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96679
ATTN : MR. JASMAN PINTO		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	A3 Building, Room 207, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 03.25 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	19°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
ANILA GEORGE  
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96678/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96678
		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
<b>ATTN : MR. JASMAN PINTO</b>		Date Reported	16 Mar 2020
Sample Description	<b>A3 Building, Room 515, Kitchen</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 03.15 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	19.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
**ANILA GEORGE**  
LABORATORY MANAGER

The test report shall not be reprinted (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96677/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>	Sample ID	QMTL/S-96677	
	Date Received	08 Mar 2020	
	Date(s) Tested	08 Mar 2020 - 10 Mar 2020	
	Date Reported	16 Mar 2020	
Sample Description	A3 Building, Room 711, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 03.10 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	23.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
**ANILA GEORGE**  
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96682/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96682
<b>ATTN : MR. JASMAN PINTO</b>		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	A4 Building, Room 207, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 04.00 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	21.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96681/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates	Sample ID : QMTL/S-96681 Date Received : 08 Mar 2020 Date(s) Tested : 08 Mar 2020 - 10 Mar 2020 Date Reported : 16 Mar 2020		
<b>ATTN : MR. JASMAN PINTO</b>			
Sample Description	A4 Building, Room 515, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 03.47 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	22°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

### TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
**ANILA GEORGE**  
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96680/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96680
ATTN : MR. JASMAN PINTO		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	A4 Building, Room 711, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 03.40 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	20.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
ANILA GEORGE  
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96878/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96878
ATTN : MR. JASMAN PINTO		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	A5A Building Level-02 Lounge		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/9:20 AM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	21.9°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--


Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

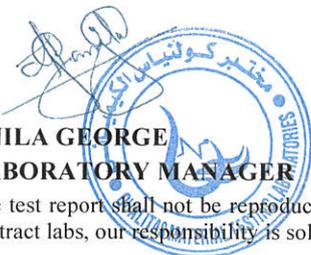

**ANILA GEORGE**  
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96877/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 30%;">Sample ID</td> <td>QMTL/S-96877</td> </tr> <tr> <td>Date Received</td> <td>09 Mar 2020</td> </tr> <tr> <td>Date(s) Tested</td> <td>09 Mar 2020 - 11 Mar 2020</td> </tr> <tr> <td>Date Reported</td> <td>18 Mar 2020</td> </tr> </table>	Sample ID	QMTL/S-96877	Date Received	09 Mar 2020	Date(s) Tested	09 Mar 2020 - 11 Mar 2020	Date Reported	18 Mar 2020
Sample ID	QMTL/S-96877								
Date Received	09 Mar 2020								
Date(s) Tested	09 Mar 2020 - 11 Mar 2020								
Date Reported	18 Mar 2020								
Sample Description	<b>A5A Building Room-410</b>								
Sample Type	Water	Sampling Method	QMTL-WI-15						
Client Name/Project	NP	Sampled By	QMTL Representative						
Location	NYUAD	Sampling Date/Time	09.03.2020/9:10 AM						
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap						
Sample Receipt Temp	4.7°C	Sample Onsite Temp	21.7°C						
Sample Appearance	Clear	On-site Treatment	NA						
Reference	NP								

### TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	3
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96876/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>	Sample ID Date Received Date(s) Tested Date Reported	QMTL/S-96876 09 Mar 2020 09 Mar 2020 - 11 Mar 2020 18 Mar 2020
Sample Description	A5A Building, Room-605	
Sample Type	Water	Sampling Method
Client Name/Project	NP	Sampled By
Location	NYUAD	Sampling Date/Time
Sample Container	1x500ml PB	Sampling Point
Sample Receipt Temp	4.7°C	Sample Onsite Temp
Sample Appearance	Clear	On-site Treatment
Reference	NP	QMTL-WI-15 QMTL Representative 09.03.2020/9:00 AM Kitchen Tap 22°C NA

### TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By



  
**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96910/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>		Sample ID	QMTL/S-96910
		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	<b>A5B Building, Level 02 Lounge</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/3:55 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	21.5°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

### TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	3
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96909/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96909
ATTN : MR. JASMAN PINTO		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	A5B Building,Room-504		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/3:53 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	21°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96908/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96908
ATTN : MR. JASMAN PINTO		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	A5B Building,Room-607		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/3:55 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	22.2°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	6
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96907/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96907
ATTN : MR. JASMAN PINTO		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	A5C Building, Level 02 Lounge		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/3:48 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	23°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
LABORATORY MANAGER

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96906/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>		Sample ID	QMTL/S-96906
		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	<b>A5C Building Room-503</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/3:45 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	24.1°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96905/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>		Sample ID	QMTL/S-96905
		Date Received	09 Mar 2020
		Date(s) Tested	09 Mar 2020 - 11 Mar 2020
		Date Reported	18 Mar 2020
Sample Description	<b>A5C Building Room-606</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	09.03.2020/3:42 PM
Sample Container	1x500ml PB	Sampling Point	Kitchen Tap
Sample Receipt Temp	4.7°C	Sample Onsite Temp	23.5°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

### TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	3
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, WI: Work Instruction, NA: Not Applicable, NP: Not Provided
----------	--


Test method deviation	None
-----------------------	------

Test performed by Emp#	78 & 74 & 55
------------------------	--------------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96661/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>	Sample ID	QMTL/S-96661	
	Date Received	08 Mar 2020	
	Date(s) Tested	08 Mar 2020 - 10 Mar 2020	
	Date Reported	16 Mar 2020	
Sample Description	<b>A6A Building, Level 02, Lounge, Kitchen</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 /11.00AM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	20.7°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
**ANILA GEORGE**  
**LABORATORY MANAGER**  


The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96660/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96660
ATTN : MR. JASMAN PINTO		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	A6A Building, Room 412, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 10.50 AM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	21.8°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
ANILA GEORGE  
LABORATORY MANAGER  


The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96659/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 30%;">Sample ID</td> <td>QMTL/S-96659</td> </tr> <tr> <td>Date Received</td> <td>08 Mar 2020</td> </tr> <tr> <td>Date(s) Tested</td> <td>08 Mar 2020 - 10 Mar 2020</td> </tr> <tr> <td>Date Reported</td> <td>16 Mar 2020</td> </tr> </table>	Sample ID	QMTL/S-96659	Date Received	08 Mar 2020	Date(s) Tested	08 Mar 2020 - 10 Mar 2020	Date Reported	16 Mar 2020
Sample ID	QMTL/S-96659								
Date Received	08 Mar 2020								
Date(s) Tested	08 Mar 2020 - 10 Mar 2020								
Date Reported	16 Mar 2020								
Sample Description	<b>A6A Building, Room 701, Kitchen</b>								
Sample Type	Water	Sampling Method	QMTL-WI-15						
Client Name/Project	NP	Sampled By	QMTL Representative						
Location	NYUAD	Sampling Date/Time	08-03-2020 /10.42AM						
Sample Container	1x500ml PB	Sampling Point	Tap						
Sample Receipt Temp	4°C	Sample Onsite Temp	21°C						
Sample Appearance	Clear	On-site Treatment	NA						
Reference	NP								

### TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
  
**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96664/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>		Sample ID	QMTL/S-96664
		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	<b>A6B Building, Level 02, Lounge, Kitchen</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 11.50 AM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	21.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

### TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
**ANILA GEORGE**  
**LABORATORY MANAGER**



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96663/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96663
ATTN : MR. JASMAN PINTO		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	A6B Building, Room 406, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 /11.42 AM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	20.6°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
ANILA GEORGE  
LABORATORY MANAGER  


The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96662/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96662
ATTN : MR. JASMAN PINTO		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	A6B Building, Room 611, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 11.35 AM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	21.2°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
ANILA GEORGE  
LABORATORY MANAGER

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96667/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96667
ATTN : MR. JASMAN PINTO		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	A6C Building, Level 02, Lounge, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 12.45 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	21°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
  
ANILA GEORGE  
LABORATORY MANAGER

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96666/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>	Sample ID	QMTL/S-96666	
	Date Received	08 Mar 2020	
	Date(s) Tested	08 Mar 2020 - 10 Mar 2020	
	Date Reported	16 Mar 2020	
Sample Description	A6C Building, Room 405, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 12.37 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	21.5°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---


Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96665/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>	Sample ID	QMTL/S-96665	
	Date Received	08 Mar 2020	
	Date(s) Tested	08 Mar 2020 - 10 Mar 2020	
	Date Reported	16 Mar 2020	
Sample Description	A6C Building, Room 603, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 12.20 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	21°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
  
**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be referred to (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96668/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96668
<b>ATTN : MR. JASMAN PINTO</b>		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	<b>B1 Building, Room 401, Kitchen</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 01.05 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	23.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
LABORATORY MANAGER

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96669/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96669
<b>ATTN : MR. JASMAN PINTO</b>		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	<b>B1 Building, Room 702, Kitchen</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 01.17 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	21.9°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
**ANILA GEORGE**  
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96670/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96670
ATTN : MR. JASMAN PINTO		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
		Date Reported	16 Mar 2020
Sample Description	B1 Building, Room 911, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 01.25 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	21.8°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---


Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By

  
ANILA GEORGE  
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

## TEST REPORT

Report No: QMTL/R-96654/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>	Sample ID	QMTL/S-96654	
	Date Received	08 Mar 2020	
	Date(s) Tested	08 Mar 2020 - 10 Mar 2020	
	Date Reported	16 Mar 2020	
Sample Description	<b>B2 Building, Room 310, Kitchen</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 09.05AM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	21.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

## TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.	
---	--

Reported By

  
**ANILA GEORGE**  
**LABORATORY MANAGER**



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

**TEST REPORT**

Report No: QMTL/R-96655/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-96655
		Date Received	08 Mar 2020
		Date(s) Tested	08 Mar 2020 - 10 Mar 2020
<b>ATTN : MR. JASMAN PINTO</b>		Date Reported	16 Mar 2020
Sample Description	<b>B2 Building, Room 608, Kitchen</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 09.10AM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	21°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

**TEST RESULTS**

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

**TEST REPORT**

Report No: QMTL/R-96656/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates  <b>ATTN : MR. JASMAN PINTO</b>	Sample ID	QMTL/S-96656	
	Date Received	08 Mar 2020	
	Date(s) Tested	08 Mar 2020 - 10 Mar 2020	
	Date Reported	16 Mar 2020	
Sample Description	<b>B2 Building, Room 915, Kitchen</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 09.16AM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	20.5°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

**TEST RESULTS**

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




**ANILA GEORGE**  
**LABORATORY MANAGER**

The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**

## TEST REPORT

Report No: QMTL/R-96658/2020

<b>CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES</b> Abu Dhabi PO Box : 131463 United Arab Emirates	Sample ID : QMTL/S-96658 Date Received : 08 Mar 2020 Date(s) Tested : 08 Mar 2020 - 10 Mar 2020 Date Reported : 16 Mar 2020		
<b>ATTN : MR. JASMAN PINTO</b>			
Sample Description	<b>D2 Building, Room 201, Kitchen</b>		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD	Sampling Date/Time	08-03-2020 / 10.15AM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	22.2°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

### TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal Coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction.
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By



**ANILA GEORGE**  
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

**END OF REPORT**