

TEST REPORT

Report No: QMTL/R-122384/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates ATTN : MR. JASMAN PINTO	Sample ID	QMTL/S-122384	
	Date Received	14 Sep 2020	
	Date(s) Tested	14 Sep 2020 - 16 Sep 2020	
	Date Reported	23 Sep 2020	
Sample Description	Building C2, Ground Level, Drinking Water Fountain (NYUAD: 00104737)		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 12:55 PM
Sample Container	1x500ml PB	Sampling Point	Drinking Water Fountain
Sample Receipt Temp	4°C	Sample Onsite Temp	23.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
MICROBIOLOGICAL ANALYSIS				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	5
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By



ANILA GEORGE
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122385/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122385
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 16 Sep 2020
		Date Reported	23 Sep 2020
Sample Description	Building C2, Health and Wellness Center, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 01:15 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	29°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
MICROBIOLOGICAL ANALYSIS				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	7
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets the limits of HAAD EHSMS Standard for Healthcare Providers- RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, HAAD: The Health -Authority- Abu Dhabi, EHSMS: Environment, Health and Safety Management System, NP: Not Provided, NA: Not Applicable, WI: Work Instruction
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




ANILA GEORGE
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122388/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122388
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 16 Sep 2020
		Date Reported	23 Sep 2020
Sample Description	Building C2, Health and Wellness Center, Washroom		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 01:55 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	25.9°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
MICROBIOLOGICAL ANALYSIS				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	8
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets the limits of HAAD EHSMS Standard for Healthcare Providers- RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, HAAD: The Health -Authority- Abu Dhabi, EHSMS: Environment, Health and Safety Management System, NP: Not Provided, NA: Not Applicable, WI: Work Instruction
----------	---

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




ANILA GEORGE
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122386/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122386
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 16 Sep 2020
		Date Reported	23 Sep 2020
Sample Description	Building C2, Level- 1, Drinking Water Fountain (NYUAD: 0074560)		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 01:20 PM
Sample Container	1x500ml PB	Sampling Point	Drinking Water Fountain
Sample Receipt Temp	4°C	Sample Onsite Temp	23.3°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
MICROBIOLOGICAL ANALYSIS				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	4
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




ANILA GEORGE
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122383/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122383
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 16 Sep 2020
		Date Reported	23 Sep 2020
Sample Description	Building C2, Level - 1, Convenience Store		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 12:40 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	26.2°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
MICROBIOLOGICAL ANALYSIS				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	6
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By


ANILA GEORGE
LABORATORY MANAGER



The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122387/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122387
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 16 Sep 2020
		Date Reported	23 Sep 2020
Sample Description	Building C2, Level - 2, Drinking Water Fountain (NYUAD: 00077550)		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 01:45 PM
Sample Container	1x500ml PB	Sampling Point	Drinking Water Fountain
Sample Receipt Temp	4°C	Sample Onsite Temp	22.8°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
MICROBIOLOGICAL ANALYSIS				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	9
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By



ANILA GEORGE
LABORATORY MANAGER



The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122380/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122380
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 16 Sep 2020
		Date Reported	23 Sep 2020
Sample Description	Building C2, Level - 2, SMP Food Preparation Area		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 11:40 AM
Sample Container	1x500ml PB	Sampling Point	Tap (Sink)
Sample Receipt Temp	4°C	Sample Onsite Temp	27.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
MICROBIOLOGICAL ANALYSIS				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	7
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




ANILA GEORGE
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122381/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122381
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 16 Sep 2020
		Date Reported	23 Sep 2020
Sample Description	Building C2, Level 2, Taza Handwash		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 12:05 PM
Sample Container	1x500ml PB	Sampling Point	Tap
Sample Receipt Temp	4°C	Sample Onsite Temp	30°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
MICROBIOLOGICAL ANALYSIS				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




ANILA GEORGE
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122389/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122389
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 16 Sep 2020
		Date Reported	23 Sep 2020
Sample Description	Building C2, Level 3, Drinking Water Fountain (NYUAD: 00119472)		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 02:05 PM
Sample Container	1x500ml PB	Sampling Point	Drinking Water Fountain
Sample Receipt Temp	4°C	Sample Onsite Temp	23.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
MICROBIOLOGICAL ANALYSIS				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




ANILA GEORGE
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122382/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122382
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 16 Sep 2020
		Date Reported	23 Sep 2020
Sample Description	Building C2, Level 3, Library Cafe		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 12:20 PM
Sample Container	1x500ml PB	Sampling Point	Tap (Sink)
Sample Receipt Temp	4°C	Sample Onsite Temp	25.2°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
MICROBIOLOGICAL ANALYSIS				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By



ANILA GEORGE
LABORATORY MANAGER



The test report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122419/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122419
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 24 Sep 2020
		Date Reported	27 Sep 2020
Sample Description	Building C2, Ground Level, Drinking Water Fountain (NYUAD: 00104737)		
Sample Type	Water	Sampling Method	QMTL-WI-16
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 12:50 PM
Sample Container	1x1L PB	Sampling Point	Drinking Water Fountain
Sample Receipt Temp	21°C	Sample Onsite Temp	23.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS


PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
LEGIONELLA ANALYSIS				
Legionella	ISO 11731:2017 E (Matrix A-Procedure-5)	CFU/litre	<1	<1
Legionella pneumophila sero group 1	ISO 11731:2017 E	-	-	Absent
Legionella pneumophila sero group 2-15	ISO 11731:2017 E	-	-	Absent
Legionella Species	ISO 11731:2017 E	-	-	Absent

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, ISO: International Organization for Standardization, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction, BCYE: Buffered Charcoal Yeast Extract, Culture Media :- BCYE Agar
----------	--

Test method deviation	None
Test performed by Emp#	55 & 74
Report prepared by Emp#	72
The above test results are only applicable to the sample(s) referred above.	

Reported By



ANILA GEORGE
LABORATORY MANAGER



The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122420/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122420
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 24 Sep 2020
		Date Reported	27 Sep 2020
Sample Description	Building C2, Health and Wellness Center, Kitchen		
Sample Type	Water	Sampling Method	QMTL-WI-16
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 01:08 PM
Sample Container	1x1L PB	Sampling Point	Tap
Sample Receipt Temp	21°C	Sample Onsite Temp	24°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
LEGIONELLA ANALYSIS				
Legionella	ISO 11731:2017 E (Matrix A-Procedure-5)	CFU/litre	<1	<1
Legionella pneumophila sero group 1	ISO 11731:2017 E	-	-	Absent
Legionella pneumophila sero group 2-15	ISO 11731:2017 E	-	-	Absent
Legionella Species	ISO 11731:2017 E	-	-	Absent

Remarks	The sample meets the limits of HAAD EHSMS Standard for Healthcare Providers- RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, ISO: International Organization for Standardization, RSB: Regulation & Supervision Bureau, HAAD: The Health –Authority- Abu Dhabi, EHSMS: Environment, Health and Safety Management System, NP: Not Provided, NA: Not Applicable, WI: Work Instruction, BCYE: Buffered Charcoal Yeast Extract, Culture Media :- BCYE Agar
----------	---

Test method deviation	None
Test performed by Emp#	55 & 74
Report prepared by Emp#	72
The above test results are only applicable to the sample(s) referred above.	

Reported By



ANILA GEORGE
LABORATORY MANAGER



The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122423/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122423
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 24 Sep 2020
		Date Reported	27 Sep 2020
Sample Description	Building C2, Health and Wellness Center, Washroom		
Sample Type	Water	Sampling Method	QMTL-WI-16
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 01:50 PM
Sample Container	1x1L PB	Sampling Point	Tap
Sample Receipt Temp	21°C	Sample Onsite Temp	25.9°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
LEGIONELLA ANALYSIS				
Legionella	ISO 11731:2017 E (Matrix A-Procedure-5)	CFU/litre	<1	<1
Legionella pneumophila sero group 1	ISO 11731:2017 E	-	-	Absent
Legionella pneumophila sero group 2-15	ISO 11731:2017 E	-	-	Absent
Legionella Species	ISO 11731:2017 E	-	-	Absent

Remarks	The sample meets the limits of HAAD EHSMS Standard for Healthcare Providers- RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, ISO: International Organization for Standardization, RSB: Regulation & Supervision Bureau, HAAD: The Health –Authority- Abu Dhabi, EHSMS: Environment, Health and Safety Management System, NP: Not Provided, NA: Not Applicable, WI: Work Instruction, BCYE: Buffered Charcoal Yeast Extract, Culture Media :- BCYE Agar
----------	---

Test method deviation	None
Test performed by Emp#	55 & 74
Report prepared by Emp#	72
The above test results are only applicable to the sample(s) referred above.	

Reported By



ANILA GEORGE
LABORATORY MANAGER



The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122421/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122421
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 24 Sep 2020
		Date Reported	27 Sep 2020
Sample Description	Building C2, Level- 1, Drinking Water Fountain (NYUAD: 0074560)		
Sample Type	Water	Sampling Method	QMTL-WI-16
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 01:20 PM
Sample Container	1x1L PB	Sampling Point	Drinking Water Fountain
Sample Receipt Temp	21°C	Sample Onsite Temp	23.3°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
LEGIONELLA ANALYSIS				
Legionella	ISO 11731:2017 E (Matrix A-Procedure-5)	CFU/litre	<1	<1
Legionella pneumophila sero group 1	ISO 11731:2017 E	-	-	Absent
Legionella pneumophila sero group 2-15	ISO 11731:2017 E	-	-	Absent
Legionella Species	ISO 11731:2017 E	-	-	Absent

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, ISO: International Organization for Standardization, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction, BCYE: Buffered Charcoal Yeast Extract, Culture Media :- BCYE Agar
----------	--

Test method deviation	None
Test performed by Emp#	55 & 74
Report prepared by Emp#	72
The above test results are only applicable to the sample(s) referred above.	

Reported By




ANILA GEORGE
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122418/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122418
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 24 Sep 2020
		Date Reported	27 Sep 2020
Sample Description	Building C2, Level - 1, Convenience Store		
Sample Type	Water	Sampling Method	QMTL-WI-16
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 12:35 PM
Sample Container	1x1L PB	Sampling Point	Tap
Sample Receipt Temp	21°C	Sample Onsite Temp	26.2°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS


PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
LEGIONELLA ANALYSIS				
Legionella	ISO 11731:2017 E (Matrix A-Procedure-5)	CFU/litre	<1	<1
Legionella pneumophila sero group 1	ISO 11731:2017 E	-	-	Absent
Legionella pneumophila sero group 2-15	ISO 11731:2017 E	-	-	Absent
Legionella Species	ISO 11731:2017 E	-	-	Absent

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, ISO: International Organization for Standardization, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction, BCYE: Buffered Charcoal Yeast Extract, Culture Media :- BCYE Agar
----------	--

Test method deviation	None
Test performed by Emp#	55 & 74
Report prepared by Emp#	72
The above test results are only applicable to the sample(s) referred above.	

Reported By



ANILA GEORGE
LABORATORY MANAGER



The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122422/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122422
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 24 Sep 2020
		Date Reported	27 Sep 2020
Sample Description	Building C2, Level - 2, Drinking Water Fountain (NYUAD: 00077550)		
Sample Type	Water	Sampling Method	QMTL-WI-16
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 01:38 PM
Sample Container	1x1L PB	Sampling Point	Drinking Water Fountain
Sample Receipt Temp	21°C	Sample Onsite Temp	22.8°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
LEGIONELLA ANALYSIS				
Legionella	ISO 11731:2017 E (Matrix A-Procedure-5)	CFU/litre	<1	<1
Legionella pneumophila sero group 1	ISO 11731:2017 E	-	-	Absent
Legionella pneumophila sero group 2-15	ISO 11731:2017 E	-	-	Absent
Legionella Species	ISO 11731:2017 E	-	-	Absent

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, ISO: International Organization for Standardization, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction, BCYE: Buffered Charcoal Yeast Extract, Culture Media :- BCYE Agar
----------	--

Test method deviation	None
Test performed by Emp#	55 & 74
Report prepared by Emp#	72
The above test results are only applicable to the sample(s) referred above.	

Reported By




ANILA GEORGE
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122415/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates ATTN : MR. JASMAN PINTO		Sample ID	QMTL/S-122415
		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 24 Sep 2020
		Date Reported	27 Sep 2020
Sample Description	Building C2, Level - 2, SMP Food Preparation Area		
Sample Type	Water	Sampling Method	QMTL-WI-16
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 11:35 AM
Sample Container	1x1L PB	Sampling Point	Tap (Sink)
Sample Receipt Temp	21°C	Sample Onsite Temp	27.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
LEGIONELLA ANALYSIS				
Legionella	ISO 11731:2017 E (Matrix A-Procedure-5)	CFU/litre	<1	<1
Legionella pneumophila sero group 1	ISO 11731:2017 E	-	-	Absent
Legionella pneumophila sero group 2-15	ISO 11731:2017 E	-	-	Absent
Legionella Species	ISO 11731:2017 E	-	-	Absent

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, ISO: International Organization for Standardization, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction, BCYE: Buffered Charcoal Yeast Extract, Culture Media :- BCYE Agar
----------	--

Test method deviation	None
Test performed by Emp#	55 & 74
Report prepared by Emp#	72
The above test results are only applicable to the sample(s) referred above.	

Reported By



ANILA GEORGE
LABORATORY MANAGER



The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122416/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122416
		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 24 Sep 2020
ATTN : MR. JASMAN PINTO		Date Reported	27 Sep 2020
Sample Description	Building C2, Level 2, Taza Handwash		
Sample Type	Water	Sampling Method	QMTL-WI-16
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 11:50 AM
Sample Container	1x1L PB	Sampling Point	Tap
Sample Receipt Temp	21°C	Sample Onsite Temp	30°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS


PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
LEGIONELLA ANALYSIS				
Legionella	ISO 11731:2017 E (Matrix A-Procedure-5)	CFU/litre	<1	<1
Legionella pneumophila sero group 1	ISO 11731:2017 E	-	-	Absent
Legionella pneumophila sero group 2-15	ISO 11731:2017 E	-	-	Absent
Legionella Species	ISO 11731:2017 E	-	-	Absent

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, ISO: International Organization for Standardization, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction, BCYE: Buffered Charcoal Yeast Extract, Culture Media :- BCYE Agar
----------	--

Test method deviation	None
Test performed by Emp#	55 & 74
Report prepared by Emp#	72
The above test results are only applicable to the sample(s) referred above.	

Reported By



ANILA GEORGE
LABORATORY MANAGER



The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122424/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122424
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 24 Sep 2020
		Date Reported	27 Sep 2020
Sample Description	Building C2, Level 3, Drinking Water Fountain (NYUAD: 00119472)		
Sample Type	Water	Sampling Method	QMTL-WI-16
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 02:00 PM
Sample Container	1x1L PB	Sampling Point	Drinking Water Fountain
Sample Receipt Temp	21°C	Sample Onsite Temp	23.4°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS


PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
LEGIONELLA ANALYSIS				
Legionella	ISO 11731:2017 E (Matrix A-Procedure-5)	CFU/litre	<1	<1
Legionella pneumophila sero group 1	ISO 11731:2017 E	-	-	Absent
Legionella pneumophila sero group 2-15	ISO 11731:2017 E	-	-	Absent
Legionella Species	ISO 11731:2017 E	-	-	Absent

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, ISO: International Organization for Standardization, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction, BCYE: Buffered Charcoal Yeast Extract, Culture Media :- BCYE Agar
----------	--

Test method deviation	None
Test performed by Emp#	55 & 74
Report prepared by Emp#	72
The above test results are only applicable to the sample(s) referred above.	

Reported By




ANILA GEORGE
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-122417/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-122417
ATTN : MR. JASMAN PINTO		Date Received	14 Sep 2020
		Date(s) Tested	14 Sep 2020 - 24 Sep 2020
		Date Reported	27 Sep 2020
Sample Description	Building C2, Level 3, Library Cafe		
Sample Type	Water	Sampling Method	QMTL-WI-16
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	14.09.2020 / 12:15 PM
Sample Container	1x1L PB	Sampling Point	Tap (Sink)
Sample Receipt Temp	21°C	Sample Onsite Temp	25.2°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS


PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
LEGIONELLA ANALYSIS				
Legionella	ISO 11731:2017 E (Matrix A-Procedure-5)	CFU/litre	<1	<1
Legionella pneumophila sero group 1	ISO 11731:2017 E	-	-	Absent
Legionella pneumophila sero group 2-15	ISO 11731:2017 E	-	-	Absent
Legionella Species	ISO 11731:2017 E	-	-	Absent

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, ISO: International Organization for Standardization, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction, BCYE: Buffered Charcoal Yeast Extract, Culture Media :- BCYE Agar
----------	--

Test method deviation	None
Test performed by Emp#	55 & 74
Report prepared by Emp#	72
The above test results are only applicable to the sample(s) referred above.	

Reported By



ANILA GEORGE
LABORATORY MANAGER



The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-121883/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-121883
ATTN : MR. JASMAN PINTO		Date Received	12 Sep 2020
		Date(s) Tested	12 Sep 2020 - 14 Sep 2020
		Date Reported	17 Sep 2020
Sample Description	C2 Building, Cold Water Tank		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	12.09.2020 / 03:39 PM
Sample Container	1x500ml PB	Sampling Point	Tank
Sample Receipt Temp	4°C	Sample Onsite Temp	22.2°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
MICROBIOLOGICAL ANALYSIS				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	3
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




ANILA GEORGE
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-121880/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-121880
ATTN : MR. JASMAN PINTO		Date Received	12 Sep 2020
		Date(s) Tested	12 Sep 2020 - 14 Sep 2020
		Date Reported	17 Sep 2020
Sample Description	C2 Building, Ambient Water Tank		
Sample Type	Water	Sampling Method	QMTL-WI-15
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	12.09.2020 / 03:00 PM
Sample Container	1x500ml PB	Sampling Point	Tank
Sample Receipt Temp	4°C	Sample Onsite Temp	24.8°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
MICROBIOLOGICAL ANALYSIS				
E.coli	APHA 9222 H & I (23rd Edition)	CFU/100 ml	Zero	Zero
Fecal coliforms	APHA 9222 D (23rd Edition)	CFU/100 ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E (23rd Edition)	CFU/100 ml	Zero	Zero
Total Bacterial Count	APHA 9215 B (23rd Edition)	CFU/ml	10@37°C	3
Total Coliforms	APHA 9222 B (23rd Edition)	CFU/100 ml	Zero	Zero

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction
----------	--


Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




ANILA GEORGE
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-121910/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-121910
ATTN : MR. JASMAN PINTO		Date Received	12 Sep 2020
		Date(s) Tested	12 Sep 2020 - 22 Sep 2020
		Date Reported	24 Sep 2020
Sample Description	C2 Building, Cold Water Tank		
Sample Type	Water	Sampling Method	QMTL-WI-16
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	12.09.2020 / 03:35 PM
Sample Container	1x1L PB	Sampling Point	Tank
Sample Receipt Temp	21°C	Sample Onsite Temp	22.2°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
LEGIONELLA ANALYSIS				
Legionella	ISO 11731:2017 E (Matrix A-Procedure-5)	CFU/litre	<1	<1
Legionella pneumophila sero group 1	ISO 11731:2017 E	-	-	Absent
Legionella pneumophila sero group 2-15	ISO 11731:2017 E	-	-	Absent
Legionella Species	ISO 11731:2017 E	-	-	Absent

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, ISO: International Organization for Standardization, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction, BCYE: Buffered Charcoal Yeast Extract, Culture Media :- BCYE Agar
----------	--

Test method deviation	None
-----------------------	------

Test performed by Emp#	55 & 74
------------------------	---------

Report prepared by Emp#	72
-------------------------	----

The above test results are only applicable to the sample(s) referred above.

Reported By




ANILA GEORGE
LABORATORY MANAGER

The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

TEST REPORT

Report No: QMTL/R-121907/2020

CLIENT : CRYSTALLINE ENVIRONMENTAL SERVICES Abu Dhabi PO Box : 131463 United Arab Emirates		Sample ID	QMTL/S-121907
ATTN : MR. JASMAN PINTO		Date Received	12 Sep 2020
		Date(s) Tested	12 Sep 2020 - 22 Sep 2020
		Date Reported	24 Sep 2020
Sample Description	C2 Building, Ambient Water Tank		
Sample Type	Water	Sampling Method	QMTL-WI-16
Client Name/Project	NP	Sampled By	QMTL Representative
Location	NYUAD, Abu Dhabi	Sampling Date/Time	12.09.2020 / 02:58 PM
Sample Container	1x1L PB	Sampling Point	Tank
Sample Receipt Temp	21°C	Sample Onsite Temp	24.8°C
Sample Appearance	Clear	On-site Treatment	NA
Reference	NP		

TEST RESULTS

PARAMETERS	TEST METHODS	UNITS	GUIDELINES	RESULTS
LEGIONELLA ANALYSIS				
Legionella	ISO 11731:2017 E (Matrix A-Procedure-5)	CFU/litre	<1	<1
Legionella pneumophila sero group 1	ISO 11731:2017 E	-	-	Absent
Legionella pneumophila sero group 2-15	ISO 11731:2017 E	-	-	Absent
Legionella Species	ISO 11731:2017 E	-	-	Absent

Remarks	The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.
---------	--

Keywords	CFU: Colony Forming Unit, ISO: International Organization for Standardization, RSB: Regulation & Supervision Bureau, NP: Not Provided, NA: Not Applicable, WI: Work Instruction, BCYE: Buffered Charcoal Yeast Extract, Culture Media :- BCYE Agar
----------	--

Test method deviation	None
Test performed by Emp#	55 & 74
Report prepared by Emp#	72
The above test results are only applicable to the sample(s) referred above.	

Reported By



ANILA GEORGE
LABORATORY MANAGER




The test report shall not be reproduced(except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is solely to ensure that the analysis is conducted to standard test methods in accordance with Industry accepted practice.

END OF REPORT

CONSULTING SERVICE REPORT

CUSTOMER: SERCO - NEW YORK UNIVERSITY, ABU DHABI		To: Mr. Ratheesh Muttath Operations Engineer		DATE: 12-09-2020	
CUSTOMER ID: 3003		Copy: SERCO - NYUAD		LAST VISIT: 08-08-2020	
POTABLE WATER ANALYSIS					
			AMBIENT WATER		
PARAMETER		CONTROL LIMITS		C2	
pH at 25°C		7.0 - 9.2		7.86	
Conductivity at 25°C, µs/cm		--		329	
Total Dissolved Solids (TDS)		1000 Max.		213	
Total Hardness, ppm as CaCO ₃		300 Max.		67	
Calcium Hardness, ppm as CaCO ₃		200 Max.		61	
Total Alkalinity		--		53	
Chloride, ppm as Cl ⁻		250 Max.		60	
Iron, ppm as Fe		0.2 Max.		<0.05	
Sulphate (SO ₄), mg/l		250 Max.		<10	
Copper (Cu), mg/l		1 Max.		<0.05	
Aluminum (Al), mg/l		0.2 Max.		<0.05	
Zinc (Zn), mg/l		5 Max.		<0.05	
Nitrate (NO ₃ ⁻), mg/l		50 Max.		<1.0	
Nitrite (NO ₂ ⁻), mg/l		3.0 Max.		<0.05	
Fluorides (F)		1.5 Max.		<0.05	
Potassium (K)		12 Max.		<5.0	
Treatment Residuals					
Odor		Unobjectionable		ND	
Chlorine Dioxide ClO ₂		0.2 - 0.5		0.36	
Free Residual Chlorine as Cl		0.2 - 0.5		--	
Turbidity in NTU		4 Max.		<1.0	
<i>All test results expressed in parts per million (ppm) as CaCO₃ except pH and conductivity (µmhos).</i>					
COMMENTS:			ACTION:		
The pH and Conductivity/TDS are found satisfactory. ⇨			No action recommended.		
Dissolved iron levels are within control limits ⇨			No action recommended.		
Chlorine Dioxide levels found satisfactory ⇨			No action recommended.		
INVENTORY LEVELS			DOSAGE SCHEDULE		
Chemical	Quantity	Chemical	Present Dosage	Revised Dosage	
Bello Zon Acid			--	--	
Bello Zon Chlorite			--	--	
Service Engineer:	Murugaraaj		Client:	Mr. Ratheesh Muttath	
Signature:			Signature:		

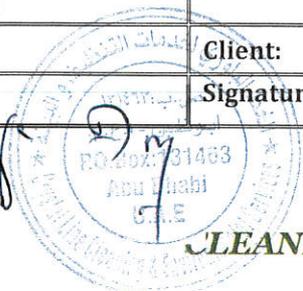



CONSULTING SERVICE REPORT

CUSTOMER: SERCO – NEW YORK UNIVERSITY, ABU DHABI	To: Mr. Ratheesh Muttath Operations Engineer	DATE: 12-09-2020
CUSTOMER ID: 3003	Copy: SERCO – NYUAD	LAST VISIT: 08-08-2020

POTABLE WATER ANALYSIS

PARAMETER	CONTROL LIMITS	COLD WATER	
		C2	
pH at 25°C	7.0 – 9.2	7.64	
Conductivity at 25°C, µs/cm	--	347	
Total Dissolved Solids (TDS)	1000 Max.	225	
Total Hardness, ppm as CaCO ₃	300 Max.	71	
Calcium Hardness, ppm as CaCO ₃	200 Max.	66	
Total Alkalinity	--	62	
Chloride, ppm as Cl ⁻	250 Max.	65	
Iron, ppm as Fe	0.2 Max.	<0.05	
Sulphate (SO ₄), mg/l	250 Max.	<13	
Copper (Cu), mg/l	1 Max.	<0.05	
Aluminum (Al), mg/l	0.2 Max.	<0.05	
Zinc (Zn), mg/l	5 Max.	<0.05	
Nitrate (NO ₃ ⁻), mg/l	50 Max.	<1.0	
Nitrite (NO ₂ ⁻), mg/l	3.0 Max.	<0.05	
Fluorides (F)	1.5 Max.	<0.05	
Potassium (K)	12 Max.	<5.0	

Treatment Residuals

Odor	Unobjectionable	ND	
Chlorine Dioxide ClO ₂	0.2 – 0.5	0.39	
Free Residual Chlorine as Cl	0.2 – 0.5	---	
Turbidity in NTU	4 Max.	<1.0	

All test results expressed in parts per million (ppm) as CaCO₃ except pH and conductivity (µmhos).

COMMENTS:

ACTION:

The pH and Conductivity/TDS are found satisfactory. ⇨	No action recommended.
Dissolved iron levels are within control limits ⇨	No action recommended.
Chlorine Dioxide levels found satisfactory ⇨	No action recommended.

INVENTORY LEVELS

DOSAGE SCHEDULE

Chemical	Quantity	Chemical	Present Dosage	Revised Dosage
Bello Zon Acid	15 Cans		--	--
Bello Zon Chlorite	15 Cans		--	--
Service Engineer:	Murugaraaj		Client:	Mr. Ratheesh Muttath
Signature:			Signature:	

