

TEST REPORT

REPORT NO:-QMTL/R-76377

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76377
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 37, Plant Room, Roof Water Tank Sample Onsite Temp: 29°C Sample Receipt Temp: 26.5°C	Source: GRP Tank	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76527

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E		
Ph:02-6508930/0557167017		
ATTN:MR. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76527
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description : External Pump Room, Water Tank: 05 Sample Onsite Temp: 32°C Sample Receipt Temp: 7°C	Source: Tank	Date(s) Tested: 16-18.10.2019
	Sample Container: 1X 500 ml PB	Date Reported: 22.10.2019
	Sample Appearance: Clear	Date of Sampling: NA
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets with RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76518

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E		
Ph:02-6508930/0557167017		
ATTN:MR. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76518
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description : HQ, External Pump Room, Water Tank: 06 Sample Onsite Temp: 31°C Sample Receipt Temp: 7°C	Source: Tank	Date(s) Tested: 16-18.10.2019
	Sample Container: 1X 500 ml PB	Date Reported: 22.10.2019
	Sample Appearance: Clear	Date of Sampling: NA
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets with RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76521

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E		
Ph:02-6508930/0557167017		
ATTN:MR. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76521
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description : HQ, External Pump Room, Water Tank: 07 Sample Onsite Temp: 32°C Sample Receipt Temp: 7°C	Source: Tank	Date(s) Tested: 16-18.10.2019
	Sample Container: 1X 500 ml PB	Date Reported: 22.10.2019
	Sample Appearance: Clear	Date of Sampling: NA
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets with RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76520

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E		
Ph:02-6508930/0557167017		
ATTN:MR. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76520
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description : HQ, External Pump Room, Water Tank: 08 Sample Onsite Temp: 20°C Sample Receipt Temp: 7°C	Source: Tank	Date(s) Tested: 16-18.10.2019
	Sample Container: 1X 500 ml PB	Date Reported: 22.10.2019
	Sample Appearance: Clear	Date of Sampling: NA
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	3
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets with RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER



The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76366

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E		
Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76366
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ Basement- Clinic- Cold Water Sample Onsite Temp: 21°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	3
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS : The sample meets the limits of HAAD EHSMS Standard for Healthcare Providers- RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU : Colony Forming Unit, APHA : American Public Health Association, RSB : Regulation & Supervision Bureau HAAD : The Health – Authority- Abu Dhabi, EHSMS : Environment, Health and Safety Management System, NA : Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.



END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76368

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76368
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ Basement- Shower Room- Cold Water Sample Onsite Temp: 20°C Sample Receipt Temp: 26.5°C	Source: Shower Head	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER 9035

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76367

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76367
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ Mezzanine Floor- Kitchen- Cold Water Sample Onsite Temp: 22°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76369

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76369
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 16 Wing A Pantry- Cold Water Sample Onsite Temp: 23°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.



END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76370

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76370
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 16 Wing B Pantry- Cold Water Sample Onsite Temp: 24°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76371

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76371
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 31B Pantry- Cold Water Sample Onsite Temp: 24°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61


Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

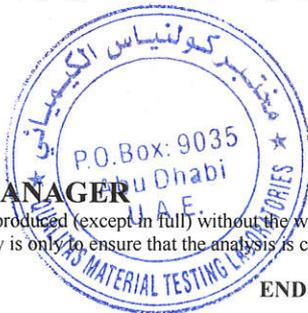

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76372

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E		
Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76372
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 32 Floor- Cold Water Sample Onsite Temp: 23°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	3
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE

LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76373

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76373
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 33 Floor- Cold Water Sample Onsite Temp: 22°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.



END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76374

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76374
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 34 Floor- Cold Water Sample Onsite Temp: 23°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76375

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E		
Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76375
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 35 Floor- Cold Water Sample Onsite Temp: 21°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS:The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61


Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

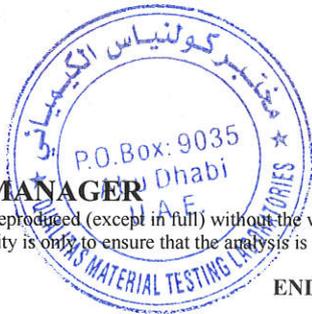

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76376

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E		
Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76376
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 36 Floor- Cold Water Sample Onsite Temp: 23°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE

LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.



END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76378

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E		
Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76378
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 36F, Shower Room- Cold Room Sample Onsite Temp: 24°C Sample Receipt Temp: 26.5°C	Source: Shower Head	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER



The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76382

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76382
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ Basement- Shower Room- Hot Water Sample Onsite Temp: 51°C Sample Receipt Temp: 26.5°C	Source: Shower Head	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76379

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76379
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: LG- Calorifier No. # 04- Hot Water Sample Onsite Temp: 42°C Sample Receipt Temp: 26.5°C	Source: Valve	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	500	3
Total Coliforms	APHA 9222 B	CFU/100ml	-	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	-	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	-	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	-	Zero

REMARKS: The sample meets DM Water Systems quality (2010) specifications for Hot & Cold Water System with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, DM: Dubai Municipality, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76380

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76380
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: LG- Calorifier No. # 05- Hot Water Sample Onsite Temp: 41°C Sample Receipt Temp: 26.5°C	Source: Valve	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	500	2
Total Coliforms	APHA 9222 B	CFU/100ml	-	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	-	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	-	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	-	Zero

REMARKS: The sample meets DM Water Systems quality (2010) specifications for Hot & Cold Water System with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, DM: Dubai Municipality, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.



END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76381

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76381
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ Mezzanine Floor- Kitchen- Hot Water Sample Onsite Temp: 46°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61


Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

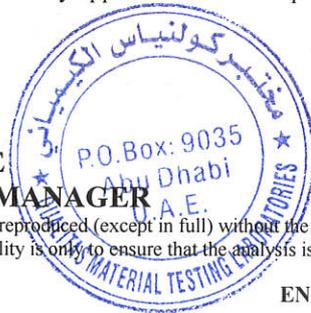

END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76383

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76383
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 16 Wing A Pantry- Hot Water Sample Onsite Temp: 48°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE

LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.



END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76384

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E		
Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76384
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 16 Wing B Pantry- Hot Water Sample Onsite Temp: 49°C Sample Receipt Temp: 26.5°C	Source: Tap	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE
LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.



END OF REPORT

TEST REPORT

REPORT NO:-QMTL/R-76385

CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
ATTN:Mr. JASMAN PINTO		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-76385
Reference: ADIA - HQ	Sampled By: Client Representative	Date Received: 16.10.2019
Sample Description: HQ 36F, Shower Room- Hot Water Sample Onsite Temp: 44°C Sample Receipt Temp: 26.5°C	Source: Shower Head	Date(s) Tested: 16-18.10.2019
	Sample Container: 1x500 ml PB	Date Reported: 21.10.2019
	Sample Appearance: Clear	Date of Sampling: 15.10.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 55	Location: AUH

TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 RD EDITION)	UNITS	SPECIFICATIONS	RESULTS
MICROBIOLOGICAL ANALYSIS				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	2
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	Zero
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	Zero
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	Zero
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	Zero

REMARKS: The sample meets RSB Water Quality Regulations (4th Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 61

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

ANILA GEORGE

LABORATORY MANAGER

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.



END OF REPORT