

EMERGENCY WATER SUPPLY

At

HEALTHPOINT HOSPITAL

Client : EFS Facility Management

Contact Person : Mr. Anjaneyamoorthi
Jr. Operation Manager

Site Details : Healthpoint Hospital Abu Dhabi

Month : Feb 2021



CRYSTALLINE
ENVIRONMENTAL SERVICES

Crystalline Environmental Services

P.O. Box 131463, Abu Dhabi, U.A.E.

Tel: 02 6508930 Fax: 02 6508942

info@crystalline-uae.com

www.crystalline-uae.com



Statement of Work:

Activity	Timing	Comments & Taken action
Healthpoint Requisition	28/Feb/2021 12:14 PM	We (Crystalline) received a request from Healthpoint facility management for providing 20 cubic meter water as an emergency; because they face water lack on the time.
Healthpoint Approval to start the filling	28/Feb/2021 12:58 PM	Healthpoint announced the internal emergency code (Code: Gold) for this emergency supply of water activity.
Portable water arrangement	28/Feb/2021 13:03 PM	We arranged water delivery by portable water tanker (5000 US gallon). Ref Picture#1
Onsite Water test	28/Feb/2021 01:14 PM	Before filling the portable water from tanker to main tank; we tested the tanker water quality at onsite. The chlorine test results are in acceptable arrange and which confirms us to fill the water to main tanks. Ref Picture#2
Laboratory water test	28/Feb/2021 01:19 PM	We collected the water samples for Microbiological test at laboratory house. Ref Picture#3 & Ref Picture#4
Water sample transport	28/Feb/2021 01:25 PM	We stored the collected samples in the container and sent it our laboratory house. Ref Picture#5
Pre-work of water transfer	28/Feb/2021 01:30 PM	We set of the tanker as much nearer to the ADDC source point (Manhole) and extended the tanker's connection hose for water flushing. Ref Picture#6
Water flushing	28/Feb/2021 01:36 PM	We flushed 10 minutes continuously from the tanker hose at before connecting the tanker's hose to main water line. Ref Picture#7
Water hose connection with Mainline	28/Feb/2021 01:41 PM	We close the ADDC main water valve and then connected the portable water with ADDC mainline from tanker by the tanker's hose. 5000 gallon of water is transferred to main water tank – 3 & 4. Ref Picture#8
Hose Disconnection	28/Feb/2021 01:55 PM	We removed the connected tanker's hose from the mainline and restore the ADDC water supply. Ref Picture#09 & 10
End of Session	28/Feb/2021 02:03 PM	We confirmed the water supply from the ADDC main water source with presence of Healthpoint team and closed the water manhole properly. Ref Picture# 11 & 12




CRYSTALLINE
ENVIRONMENTAL SERVICES

PICTURE # 1 (Water tanker parked at designated area)



PICTURE # 02 (Onsite Chlorine Test)

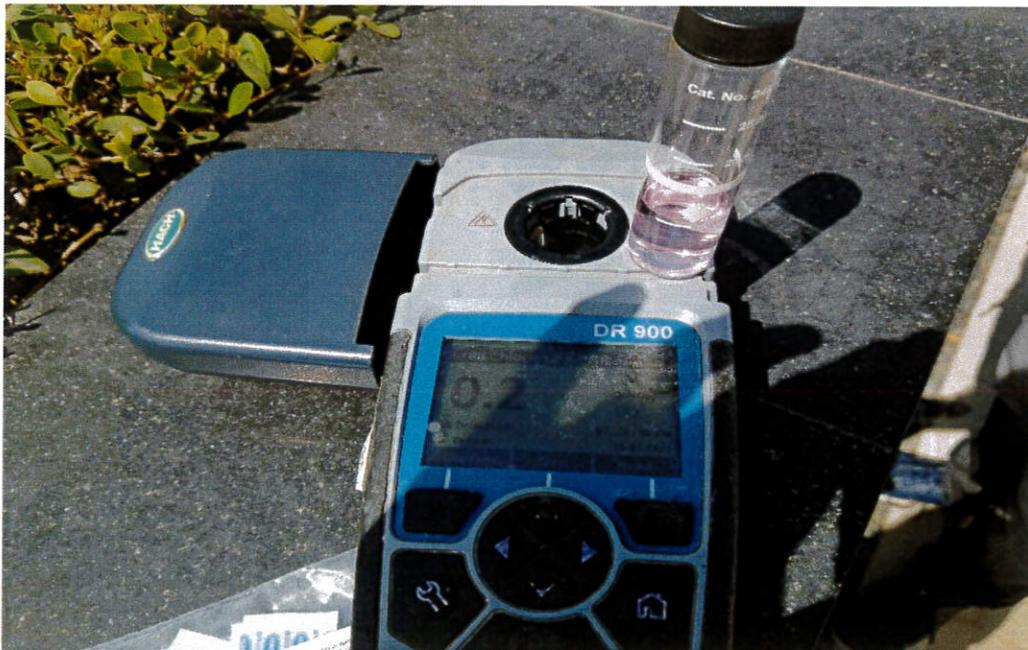

P.O. Box 131463, Abu Dhabi, U.A.E
Tel: 02 6508930 Fax: 02 6508942

CLEANER WATER GREENER TOMORROW



CRYSTALLINE
ENVIRONMENTAL SERVICES

PICTURE # 3(Water Sample taken)



PICTURE # 04 (Water Sample Collected)



P.O. Box 131463, Abu Dhabi, U.A.E
Tel: 02 6508930 Fax: 02 6508942

CLEANER WATER GREENER TOMORROW



CRYSTALLINE
ENVIRONMENTAL SERVICES

PICTURE # 5 (Collected Sample kept in cool box)



PICTURE # 06 (Discharge Hose Connected)



P.O. Box 131463, Abu Dhabi, U.A.E
Tel: 02 6508930 Fax: 02 6508942

CLEANER WATER GREENER TOMORROW



CRYSTALLINE
ENVIRONMENTAL SERVICES

PICTURE # 7 (Discharge hose flushed with water)



PICTURE# 08 (Hose Connected for supply of Water)



P.O. Box 131463, Abu Dhabi, U.A.E
Tel: 02 6508930 Fax: 02 6508942

CLEANER WATER GREENER TOMORROW



CRYSTALLINE
ENVIRONMENTAL SERVICES

PICTURE # 09 (Water Meter System # 01)



PICTURE # 10 (Water Meter System # 02)



P.O. Box 131463, Abu Dhabi, U.A.E
Tel: 02 6508930 Fax: 02 6508942

CLEANER WATER GREENER TOMORROW



CRYSTALLINE
ENVIRONMENTAL SERVICES

PICTURE # 11 (After Water Supply System # 01)



PICTURE # 12 (After Water Supply System # 02)



P.O. Box 131463, Abu Dhabi, U.A.E
Tel: 02 6508930 Fax: 02 6508942

CLEANER WATER GREENER TOMORROW