

### TEST REPORT

REPORT NO:-QMTL/R-71229

<b>CLIENT:- CRYSTALLINE ENVIRONMENTAL SERVICES</b> P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: APHA 9060 A	Sample ID: QMTL/S-71229
Reference: <b>ZAYED UNIVERSITY – ABU DHABI</b>	Sampled By: QMTL Representative	Date Received: 08.09.2019
<b>Sample Description :</b> Domestic Water – SV 1 Building – Raw Water Tank Sample Onsite Temp: 35°C Sample Receipt Temp: 6°C	Source: Hydraulic Pump Room	Date(s) Tested: 08-10.09.2019
	Sample Container: 1X 500ml PB	Date Reported: 14.09.2019
	Sample Appearance: Clear	Date of Sampling: 08.09.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

### TEST RESULTS

PARAMETERS	TEST METHOD (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATIONS	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	<b>Zero</b>

REMARKS: The sample meets RSB Water Quality Regulations (4<sup>th</sup> Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75


Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

**ANILA GEORGE**  
**LABORATORY MANAGER**

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

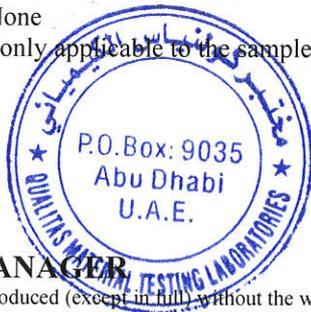

END OF REPORT

### TEST REPORT

REPORT NO:-QMTL/R-71230

<b>CLIENT:- CRYSTALLINE ENVIRONMENTAL SERVICES</b>		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: APHA 9060 A	Sample ID: QMTL/S-71230
Reference: <b>ZAYED UNIVERSITY – ABU DHABI</b>	Sampled By: QMTL Representative	Date Received: 08.09.2019
<b>Sample Description :</b> Domestic Water – SV 1 Building – Filter Water Tank Sample Onsite Temp: 33°C Sample Receipt Temp: 6°C	Source: Hydraulic Pump Room	Date(s) Tested: 08-10.09.2019
	Sample Container: 1X 500ml PB	Date Reported: 14.09.2019
	Sample Appearance: Clear	Date of Sampling: 08.09.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

### TEST RESULTS

PARAMETERS	TEST METHOD (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATIONS	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<b>10</b>
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	<b>Zero</b>

REMARKS: The sample meets RSB Water Quality Regulations (4<sup>th</sup> Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

**ANILA GEORGE**  
**LABORATORY MANAGER**

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

**TEST REPORT**

REPORT NO:-QMTL/R-71224

<b>CLIENT:- CRYSTALLINE ENVIRONMENTAL SERVICES</b> P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: APHA 9060 A	Sample ID: QMTL/S-71224
Reference: <b>ZAYED UNIVERSITY – ABU DHABI</b>	Sampled By: QMTL Representative	Date Received: 08.09.2019
<b>Sample Description :</b> SV2 Service Building – Hydraulic RCC – Raw Tank, Domestic Water Sample Onsite Temp: 27°C Sample Receipt Temp: 6°C	Source: Tank	Date(s) Tested: 08-10.09.2019
	Sample Container: 1X 500ml PB	Date Reported: 14.09.2019
	Sample Appearance: Clear	Date of Sampling: 08.09.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

**TEST RESULTS**

PARAMETERS	TEST METHOD (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATIONS	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<1
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	<b>Zero</b>

REMARKS:The sample meets RSB Water Quality Regulations (4<sup>th</sup> Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

**ANILA GEORGE**  
**LABORATORY MANAGER**



The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

### TEST REPORT

REPORT NO:-QMTL/R-71228

<b>CLIENT:- CRYSTALLINE ENVIRONMENTAL SERVICES</b> P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: APHA 9060 A	Sample ID: QMTL/S-71228
Reference: <b>ZAYED UNIVERSITY – ABU DHABI</b>	Sampled By: QMTL Representative	Date Received: 08.09.2019
<b>Sample Description :</b> Domestic Water – Female Campus - Washroom Sample Onsite Temp: 24°C Sample Receipt Temp: 6°C	Source: Tap	Date(s) Tested: 08-10.09.2019
	Sample Container: 1X 500ml PB	Date Reported: 14.09.2019
	Sample Appearance: Clear	Date of Sampling: 08.09.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

### TEST RESULTS

PARAMETERS	TEST METHOD (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATIONS	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<b>9</b>
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	<b>Zero</b>

REMARKS: The sample meets RSB Water Quality Regulations (4<sup>th</sup> Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

**ANILA GEORGE**  
**LABORATORY MANAGER**

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

### TEST REPORT

REPORT NO:-QMTL/R-71226

<b>CLIENT:- CRYSTALLINE ENVIRONMENTAL SERVICES</b>		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: APHA 9060 A	Sample ID: QMTL/S-71226
Reference: <b>ZAYED UNIVERSITY – ABU DHABI</b>	Sampled By: QMTL Representative	Date Received: 08.09.2019
<b>Sample Description :</b> Domestic Water – Male Campus - Washroom Sample Onsite Temp: 23°C Sample Receipt Temp: 6°C	Source: Tap	Date(s) Tested: 08-10.09.2019
	Sample Container: 1X 500ml PB	Date Reported: 14.09.2019
	Sample Appearance: Clear	Date of Sampling: 08.09.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

### TEST RESULTS

PARAMETERS	TEST METHOD (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATIONS	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	10@37°C	<b>10</b>
Total Coliforms	APHA 9222 B	CFU/100ml	Zero	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	Zero	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	Zero	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	Zero	<b>Zero</b>

REMARKS: The sample meets RSB Water Quality Regulations (4<sup>th</sup> Edition) January 2014 requirements for potable water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75

Test Method deviation : None


The above test results are only applicable to the sample(s) referred above

Reported By

**ANILA GEORGE**

**LABORATORY MANAGER**

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

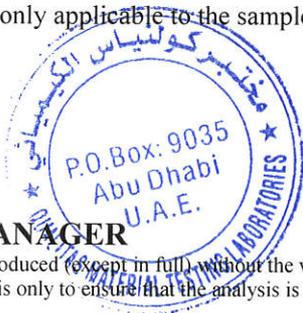

END OF REPORT

### TEST REPORT

REPORT NO:-QMTL/R-71232

<b>CLIENT:- CRYSTALLINE ENVIRONMENTAL SERVICES</b> P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: APHA 9060A	Sample ID: QMTL/S-71232
Reference: <b>ZAYED UNIVERSITY – ABU DHABI</b>	Sampled By: QMTL Representative	Date Received: 08.09.2019
<b>Sample Description :</b> Irrigation Water - SV 1 - Building Sample Onsite Temp: 40°C Sample Receipt Temp: 6°C	Source: Tank	Date(s) Tested: 08-10.09.2019
	Sample Container: 1X 500ml PB	Date Reported: 14.09.2019
	Sample Appearance: Clear	Date of Sampling: 08.09.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

### TEST RESULTS

PARAMETERS	TEST METHOD (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATION	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	-	<1
Total Coliforms	APHA 9222 B	CFU/100ml	-	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	23	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	-	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	23	<b>Zero</b>

REMARKS: The sample meets RSB Recycled Water and Biosolids Regulations 2018(Second Edition) requirements for irrigation water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

**ANILA GEORGE**  
LABORATORY MANAGER



The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

Page 1 of 1

QMTL-FRM-58 Revision : 02; Revision Date : 03.01.2016

"An ISO 9001:2015, ISO14001:2015 & OHSAS 18001:2007 Certified Company"



NAL 079  
17025



### TEST REPORT

REPORT NO:-QMTL/R-71463

<b>CLIENT:- CRYSTALLINE ENVIRONMENTAL SERVICES</b>		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-71463
Reference: <b>ZAYED UNIVERSITY – ABU DHABI</b>	Sampled By: Client Representative	Date Received: 09.09.2019
<b>Sample Description :</b> Irrigation Water, Female Campus FF2 Sample Onsite Temp: 28°C Sample Receipt Temp: 20°C	Source: Tap (Garden)	Date(s) Tested: 09-11.09.2019
	Sample Container: 1X 500ml PB	Date Reported: 15.09.2019
	Sample Appearance: Clear	Date of Sampling: NA
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

### TEST RESULTS

PARAMETERS	TEST METHOD (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATION	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	-	<b>4</b>
Total Coliforms	APHA 9222 B	CFU/100ml	-	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	23	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	-	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	23	<b>Zero</b>

REMARKS: The sample meets RSB Recycled Water and Biosolids Regulations 2018(Second Edition) requirements for irrigation water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75  
Test Method deviation : None  
The above test results are only applicable to the sample(s) referred above

Reported By

**ANILA GEORGE**  
**LABORATORY MANAGER**

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

**TEST REPORT**

REPORT NO:-QMTL/R-71464

<b>CLIENT:- CRYSTALLINE ENVIRONMENTAL SERVICES</b> P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-71464
Reference: ZAYED UNIVERSITY – ABU DHABI	Sampled By: Client Representative	Date Received: 09.09.2019
<b>Sample Description :</b> Irrigation Water, Center Campus Sample Onsite Temp: 28°C Sample Receipt Temp: 20°C	Source: Tap (Garden)	Date(s) Tested: 09-11.09.2019
	Sample Container: 1X 500ml PB	Date Reported: 15.09.2019
	Sample Appearance: Clear	Date of Sampling: NA
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

**TEST RESULTS**

PARAMETERS	TEST METHOD (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATION	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	-	<b>2</b>
Total Coliforms	APHA 9222 B	CFU/100ml	-	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	23	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	-	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	23	<b>Zero</b>

REMARKS: The sample meets RSB Recycled Water and Biosolids Regulations 2018(Second Edition) requirements for irrigation water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

**Reported By**

**ANILA GEORGE**  
**LABORATORY MANAGER**



The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

### TEST REPORT

REPORT NO:-QMTL/R-71465

<b>CLIENT:- CRYSTALLINE ENVIRONMENTAL SERVICES</b> P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: NA	Sample ID: QMTL/S-71465
Reference: <b>ZAYED UNIVERSITY – ABU DHABI</b>	Sampled By: Client Representative	Date Received: 09.09.2019
<b>Sample Description :</b> Irrigation Water, Male Campus MF2 Sample Onsite Temp: 28°C Sample Receipt Temp: 20°C	Source: Tap (Garden)	Date(s) Tested: 09-11.09.2019
	Sample Container: 1X 500ml PB	Date Reported: 15.09.2019
	Sample Appearance: Clear	Date of Sampling: NA
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

### TEST RESULTS

PARAMETERS	TEST METHOD (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATION	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	-	<b>9</b>
Total Coliforms	APHA 9222 B	CFU/100ml	-	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	23	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	-	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	23	<b>Zero</b>

REMARKS:The sample meets RSB Recycled Water and Biosolids Regulations 2018(Second Edition) requirements for irrigation water with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, RSB: Regulation & Supervision Bureau, NA: Not Applicable

Report prepared by Emp#: 75  
Test Method deviation : None  
The above test results are only applicable to the sample(s) referred above

Reported By

**ANILA GEORGE**  
**LABORATORY MANAGER**

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

**TEST REPORT**

REPORT NO:-QMTL/R-71231

<b>CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES</b> P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: APHA 9060 A	Sample ID: QMTL/S-71231
Reference: <b>ZAYED UNIVERSITY – ABU DHABI</b>	Sampled By: QMTL Representative	Date Received: 08.09.2019
<b>Sample Description :</b> Chilled Water – SV 1 Building – ETS Room Sample Onsite Temp: 11°C Sample Receipt Temp: 6°C	Source: ETS Room	Date(s) Tested: 08-10.09.2019
	Sample Container: 1X 500 ml PB	Date Reported: 14.09.2019
	Sample Appearance: Clear	Date of Sampling: 08.09.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

**TEST RESULTS**

PARAMETERS	TEST METHODS (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATIONS	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	10,000	<b>60</b>
Total Coliforms	APHA 9222 B	CFU/100ml	-	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	-	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	-	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	-	<b>Zero</b>

REMARKS: The sample meets DM Water Systems quality 2010 specifications for Cooling Water System with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, DM: Dubai Municipality, NA: Not Applicable


Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

**ANILA GEORGE**  
**LABORATORY MANAGER**

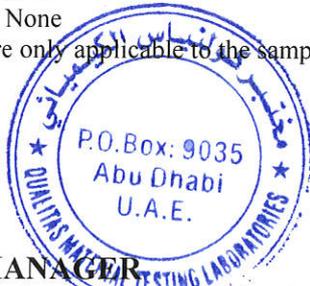

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

**END OF REPORT**

### TEST REPORT

REPORT NO:-QMTL/R-71225

<b>CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES</b>		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: APHA 9060 A	Sample ID: QMTL/S-71225
Reference: <b>ZAYED UNIVERSITY - ABU DHABI</b>	Sampled By: QMTL Representative	Date Received: 08.09.2019
<b>Sample Description :</b> Chilled Water - Male Campus Sample Onsite Temp: 9°C Sample Receipt Temp: 6°C	Source: NA	Date(s) Tested: 08-10.09.2019
	Sample Container: 1X 500 ml PB	Date Reported: 14.09.2019
	Sample Appearance: Clear	Date of Sampling: 08.09.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

### TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATIONS	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	10,000	<1
Total Coliforms	APHA 9222 B	CFU/100ml	-	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	-	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	-	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	-	<b>Zero</b>

REMARKS: The sample meets DM Water Systems quality 2010 specifications for Cooling Water System with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, DM: Dubai Municipality, NA: Not Applicable

Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

**ANILA GEORGE**  
**LABORATORY MANAGER**



The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

### TEST REPORT

REPORT NO:-QMTL/R-71227

<b>CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES</b>		
P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: APHA 9060 A	Sample ID: QMTL/S-71227
Reference: <b>ZAYED UNIVERSITY – ABU DHABI</b>	Sampled By: QMTL Representative	Date Received: 08.09.2019
<b>Sample Description :</b> Chilled Water – Female Campus Sample Onsite Temp: 10°C Sample Receipt Temp: 6°C	Source: NA	Date(s) Tested: 08-10.09.2019
	Sample Container: 1X 500 ml PB	Date Reported: 14.09.2019
	Sample Appearance: Clear	Date of Sampling: 08.09.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

### TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATIONS	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	10,000	<b>160</b>
Total Coliforms	APHA 9222 B	CFU/100ml	-	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	-	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	-	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	-	<b>Zero</b>

REMARKS: The sample meets DM Water Systems quality 2010 specifications for Cooling Water System with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, DM: Dubai Municipality, NA: Not Applicable

Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

**ANILA GEORGE**  
LABORATORY MANAGER



The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

**END OF REPORT**

### TEST REPORT

REPORT NO:-QMTL/R-71223

<b>CLIENT: CRYSTALLINE ENVIRONMENTAL SERVICES</b> P.O.Box.131463, Abu Dhabi, U.A.E Ph:02-6508930/0557167017		
<b>ATTN:MR. JASMAN PINTO</b>		
Product: Water	Sampling Method: APHA 9060 A	Sample ID: QMTL/S-71223
Reference: <b>ZAYED UNIVERSITY – ABU DHABI</b>	Sampled By: QMTL Representative	Date Received: 08.09.2019
<b>Sample Description :</b> SV2 Building – ETS Room – Chilled Water Sample Onsite Temp: 9°C Sample Receipt Temp: 6°C	Source: Chiller	Date(s) Tested: 08-10.09.2019
	Sample Container: 1X 500 ml PB	Date Reported: 14.09.2019
	Sample Appearance: Clear	Date of Sampling: 08.09.2019
On-Site Treatment: NA	Tested by Emp#: 14 & 29	Location: AUH

### TEST RESULTS

PARAMETERS	TEST METHODS (APHA 23 <sup>RD</sup> EDITION)	UNITS	SPECIFICATIONS	RESULTS
<b>MICROBIOLOGICAL ANALYSIS</b>				
Total Bacterial Count	APHA 9215 B	CFU/ml	10,000	<b>210</b>
Total Coliforms	APHA 9222 B	CFU/100ml	-	<b>Zero</b>
Faecal coliform	APHA 9222 D	CFU/100ml	-	<b>Zero</b>
Pseudomonas aeruginosa	APHA 9213 E	CFU/100ml	-	<b>Zero</b>
Escherichia coli	APHA 9222 H & I	CFU/100ml	-	<b>Zero</b>

REMARKS: The sample meets DM Water Systems quality 2010 specifications for Cooling Water System with respect to the above tests only.

Key Words:- CFU: Colony Forming Unit, APHA: American Public Health Association, DM: Dubai Municipality, NA: Not Applicable


Report prepared by Emp#: 75

Test Method deviation : None

The above test results are only applicable to the sample(s) referred above

Reported By

**ANILA GEORGE**  
**LABORATORY MANAGER**

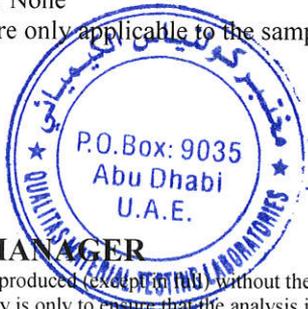

The test Report shall not be reproduced (except in full) without the written approval of QMTL. When analysis is witnessed by us or carried out by sub contract labs, our responsibility is only to ensure that the analysis is conducted to standard test methods in accordance with industry accepted practice.

END OF REPORT

Page 1 of 1

QMTL-FRM-58 Revision : 02; Revision Date : 03.01.2016