

WATER TANK CLEANING & DISINFECTION COMPLETION REPORT

FOR



مدرسة الريادة المشرقة
BRIGHT RIDERS
SCHOOL

Client : BRIGHT RIDERS SCHOOL LLC

Contact Person: Mr. Bijith Kumar.

Site Details : Bright Riders School, Mohammed
Bin Zayed City, Mussaffah.

Date : 30 August 2018



CRYSTALLINE
ENVIRONMENTAL SERVICES

CRYSTALLINE ENVIRONMENTAL
SERVICES

P.O. BOX 131463, Abu Dhabi, U.A.E.

TEL: 02 6508930 FAX: 02 6508942

info@crystalline-uae.com

www.crystalline-uae.com





CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

20014

CUSTOMER: <i>Bright riders school</i>			CONTACT PERSON: <i>Ms:- Bijith</i>		
SITE DETAILS: <i>shabia</i>			CONTACT NO: <i>026922022</i>		
TANK DETAILS: <i>R.C.C. water tanks</i>			LOCATION DETAILS: <i>Auditorium - under ground</i>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED	<input type="checkbox"/> POLYURETHANE		<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED <input type="checkbox"/> NA
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> NA <input checked="" type="checkbox"/>
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<i>25/08/2018</i>		<i>25/02/2019</i>	
CHEMICALS & EQUIPMENTS USED					
1. <i>Caerite bio plus</i> Quantity <i>500mb</i>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input checked="" type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input checked="" type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input checked="" type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
<i>Above mentioned water tanks are successfully cleared and disinfected.</i>					
Crystalline Representative: <i>Jasir shanfudeer</i>			Signature: <i>Jasir</i>		




CRYSTALLINE
ENVIRONMENTAL SERVICES


Date of Cleaning: 25.08.2018

PHOTOGRAPHS
RCC WATER TANK (AUDITORIUM)

BEFORE

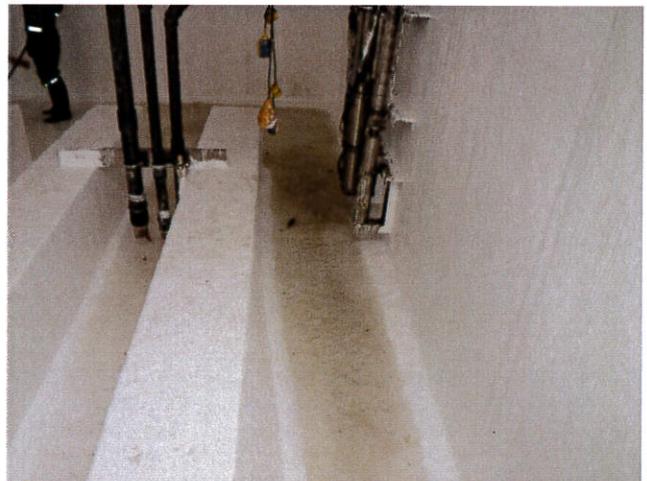

AFTER

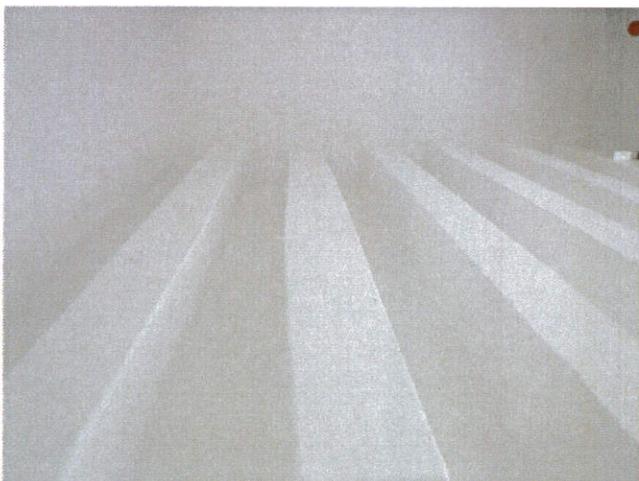

CLEANER WATER GREENER TOMORROW

CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

CLEANING & DISINFECTION CERTIFICATE

POTABLE WATER TANKS

CLIENT NAME : BRIGHT RIDERS SCHOOL LLC.
CLIENT ADDRESS : P.O.BOX: 39665, MUSSAFFAH, ABU DHABI, UAE.
CONTACT PERSON : MR. BIJITH KUMAR.
SITE DETAILS : BRIGHT RIDERS SCHOOL, MOHAMMED BIN ZAYED CITY, MUSSAFFAH, ABU DHABI, UAE.
DETAILS : WATER TANK CLEANING
DATE OF CLEANING : 25 AUGUST 2018
FREQUENCY OF CLEANING : EVERY SIX MONTHS
DATE OF NEXT CLEANING : 25 FEBRUARY 2019

The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.

The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES