

**KITCHEN EXHAUST SYSTEM
CLEANING
&
DEGREASING**

COMPLETION REPORT

For



Client : AL REEM HOSPICO COMPANY
Contact Person: Mr. Ferdinand
Engineering Department
Site Details : Tawam Hospital, Al Ain, UAE
Date : 14 November 2018



CRYSTALLINE
ENVIRONMENTAL SERVICES

**Crystalline environmental
services**

P.O. Box 131463, Abu Dhabi, U.A.E.

Tel: 02 6508930 Fax: 02 6508942

info@crystalline-uae.com

www.crystalline-uae.com



KITCHEN EXHAUST SYSTEM – AFTER SERVICE REPORT


CUSTOMER: <i>All Reem Hospico Company Uc</i>		CONTACT PERSON: <i>Ferdinand</i>	
SITE DETAILS: <i>Tauam Hospital main kitchen</i>		CONTACT NO: <i>052-6209566</i>	
NAME OF KITCHEN/DETAILS: <i>dict kitchen hood-4</i>		LOCATION OF KITCHEN: <i>level-1 Al Ain</i>	
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> RESIDENTIAL <input type="checkbox"/> EDUCATIONAL <input type="checkbox"/> INDUSTRIAL			
<i>dict-4 Exhaust fan m-t 1689 cleaned & disinfected</i>			
COOKING VOLUME	<input type="checkbox"/> HIGH	<input checked="" type="checkbox"/> MEDIUM	<input type="checkbox"/> LOW
TYPE OF FILTERS	<input checked="" type="checkbox"/> MESH	<input type="checkbox"/> BAFFLE	<input type="checkbox"/> N/A
FILTERS IN PLACE	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> N/A
EXHAUST FAN	<input checked="" type="checkbox"/> UPBLAST	<input type="checkbox"/> INLINE	<input type="checkbox"/> UTILITY
CONDITION OF DUCT	<input type="checkbox"/> DAMAGED	<input checked="" type="checkbox"/> NOT DAMAGED	<input type="checkbox"/> N/A
FILTER CLEANING FREQUENCY	<input type="checkbox"/> DAILY	<input type="checkbox"/> WEEKLY	<input type="checkbox"/> MONTHLY
	<input type="checkbox"/> BIMONTHLY	<input type="checkbox"/> QUARTERLY	HALF YEARLY <input checked="" type="checkbox"/>
DOORS/PLATES PRESENT	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	HOW MANY DOORS <i>02</i>
			HOW MANY PANELS <i>05</i>
DOORS/PANELS INSTALLED	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	HOW MANY DOORS <input checked="" type="checkbox"/>
			HOW MANY PANELS <input checked="" type="checkbox"/>
CONDITION OF ROOF/WALL	<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
CONDITION OF KITCHEN DUCT BEFORE CLEANING		CONDITION OF KITCHEN DUCT AFTER CLEANING	
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN
			<input type="checkbox"/> DIRTY
			<input type="checkbox"/> VERY DIRTY
LAST CLEANING DATE		CURRENT CLEANING DATE	
		<i>08-11-2018</i>	
		<i>08-05-2019</i>	
<u>CHEMICALS & EQUIPMENTS USED</u>			
<input checked="" type="checkbox"/> High/Low Pressure Jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Degreaser Chemical <input checked="" type="checkbox"/> Plastic Roll <input checked="" type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials.			
TEAM <input checked="" type="checkbox"/>		TEAM LEADER <i>Bishal Rai</i>	
COMMENTS & RECOMMENDATIONS: <i>kitchen disinfected</i> The above kitchen exhaust duct was successfully degreased and cleaned as per local municipality guidelines.			
Crystalline Representative: <i>Bishal Rai</i>		Signature: <i>[Signature]</i>	

kitchen hood and duct cleaned & disinfected

Date of Cleaning: 03-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- DIET KITCHEN (Tawam Hospital)

BEFORE

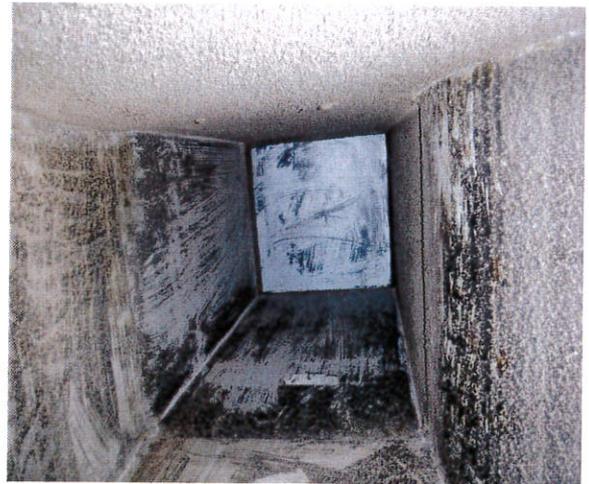

AFTER



Date of Cleaning:03-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- DIET KITCHEN

BEFORE



AFTER



CLEANER WATER GREENER TOMORROW

Date of Cleaning: 03-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- DIET KITCHEN

BEFORE



AFTER



CLEANER WATER GREENER TOMORROW



CRYSTALLINE
ENVIRONMENTAL SERVICES


Date of Cleaning: 03-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- DIET KITCHEN

BEFORE



AFTER

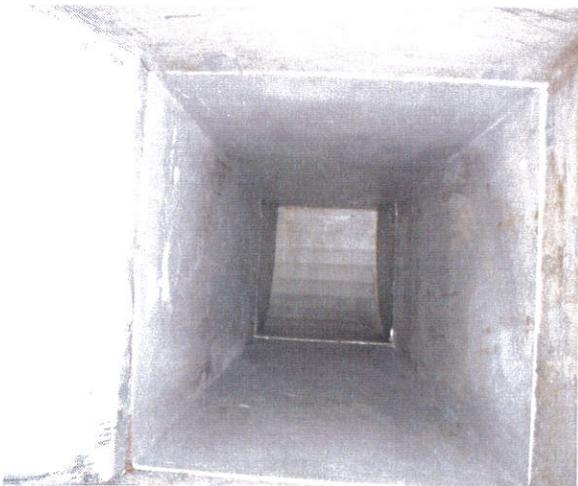

CLEANER WATER GREENER TOMORROW



KITCHEN EXHAUST SYSTEM – AFTER SERVICE REPORT

CUSTOMER: <i>Al Reem Hospico Company LLC</i>		CONTACT PERSON: <i>Ferdinand</i>	
SITE DETAILS: <i>Tawam Hospital Main Kitchen</i>		CONTACT NO: <i>052-6209566</i>	
NAME OF KITCHEN/DETAILS: <i>hot kitchen hood-2</i>		LOCATION OF KITCHEN: <i>level-1 Al Ayn</i>	
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> RESIDENTIAL <input type="checkbox"/> EDUCATIONAL <input type="checkbox"/> INDUSTRIAL			
<i>hot-2 Exhaust-fan m-T 1637 cleaned & disinfected</i>			
COOKING VOLUME	<input type="checkbox"/> HIGH	<input checked="" type="checkbox"/> MEDIUM	<input type="checkbox"/> LOW
TYPE OF FILTERS	<input checked="" type="checkbox"/> MESH	<input type="checkbox"/> BAFFLE	<input type="checkbox"/> N/A
FILTERS IN PLACE	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> N/A
EXHAUST FAN	<input checked="" type="checkbox"/> UPBLAST	<input type="checkbox"/> INLINE	<input type="checkbox"/> UTILITY
CONDITION OF DUCT	<input type="checkbox"/> DAMAGED	<input type="checkbox"/> NOT DAMAGED	<input type="checkbox"/> N/A
FILTER CLEANING FREQUENCY	<input type="checkbox"/> DAILY	<input type="checkbox"/> WEEKLY	<input type="checkbox"/> MONTHLY
	<input type="checkbox"/> BIMONTHLY	<input type="checkbox"/> QUARTERLY	HALF YEARLY <input checked="" type="checkbox"/>
DOORS/PLATES PRESENT	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	HOW MANY DOORS <i>04</i>
			HOW MANY PANELS <i>04</i>
DOORS/PANELS INSTALLED	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	HOW MANY DOORS <input checked="" type="checkbox"/>
			HOW MANY PANELS <input checked="" type="checkbox"/>
CONDITION OF ROOF/WALL	<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
CONDITION OF KITCHEN DUCT BEFORE CLEANING		CONDITION OF KITCHEN DUCT AFTER CLEANING	
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN
			<input type="checkbox"/> DIRTY
			<input type="checkbox"/> VERY DIRTY
LAST CLEANING DATE		CURRENT CLEANING DATE	
		<i>04-11-2018</i>	
		<i>04-05-2019</i>	
CHEMICALS & EQUIPMENTS USED			
<input checked="" type="checkbox"/> High/Low Pressure Jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Degreaser Chemical <input checked="" type="checkbox"/> Plastic Roll <input checked="" type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials.			
TEAM <input checked="" type="checkbox"/>		TEAM LEADER <i>Bishal Rai</i>	
COMMENTS & RECOMMENDATIONS: <i>Kitchen disinfected</i>			
The above kitchen exhaust duct was successfully degreased and cleaned as per local municipality guidelines.			
Crystalline Representative: <i>Bishal Rai</i>		Signature: <i>[Signature]</i>	

Kitchen hood and duct cleaned & disinfected




CRYSTALLINE
ENVIRONMENTAL SERVICES



Date of Cleaning: 04-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- HOT KITCHEN 1

BEFORE

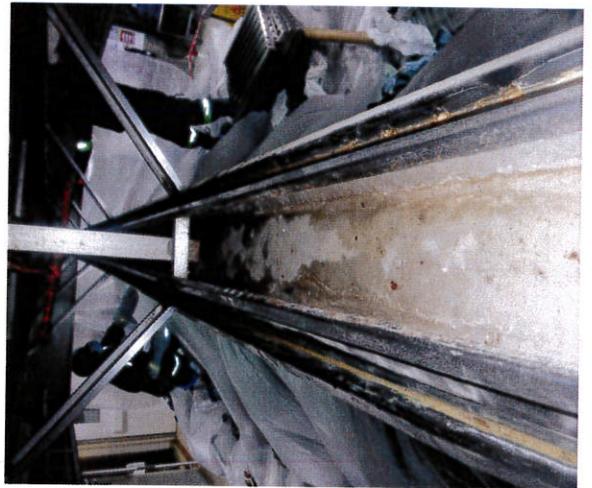

AFTER

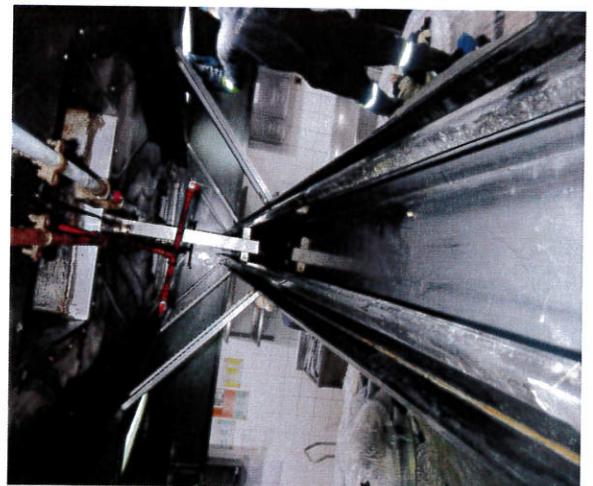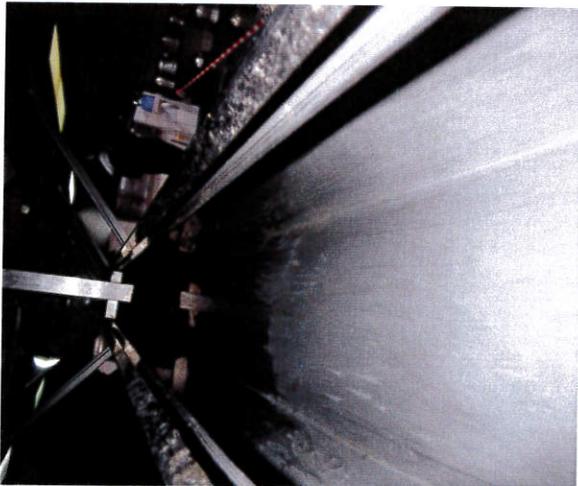

CLEANER WATER GREENER TOMORROW



CRYSTALLINE
ENVIRONMENTAL SERVICES


Date of Cleaning: 04-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- HOT KITCHEN 1

BEFORE



AFTER

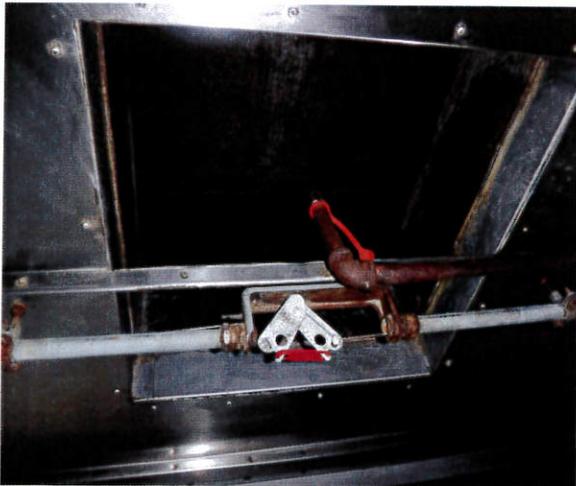

CLEANER WATER GREENER TOMORROW

Date of Cleaning: 04-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- HOT KITCHEN 1

BEFORE



AFTER



CLEANER WATER GREENER TOMORROW


Date of Cleaning: 04-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- HOT KITCHEN 1

BEFORE



AFTER

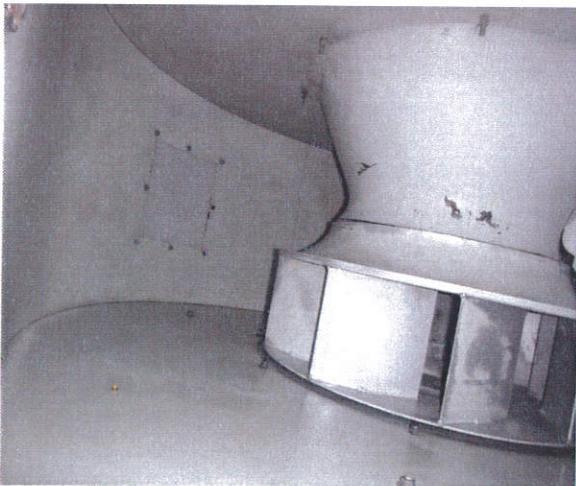



KITCHEN EXHAUST SYSTEM – AFTER SERVICE REPORT

CUSTOMER: <i>Al Reem Hospira Company LLC</i>		CONTACT PERSON: <i>Ferdinand</i>	
SITE DETAILS: <i>Tawam Hospital main kitchen</i>		CONTACT NO: <i>052-6209566</i>	
NAME OF KITCHEN/DETAILS: <i>hot kitchen hood-1</i>		LOCATION OF KITCHEN: <i>level-1 Al Reem</i>	
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> RESIDENTIAL <input type="checkbox"/> EDUCATIONAL <input type="checkbox"/> INDUSTRIAL			
<i>hot-1 Exhaust fan m-T 1636 cleaned & disinfected</i>			
COOKING VOLUME	<input type="checkbox"/> HIGH	<input checked="" type="checkbox"/> MEDIUM	<input type="checkbox"/> LOW
TYPE OF FILTERS	<input checked="" type="checkbox"/> MESH	<input type="checkbox"/> BAFFLE	<input type="checkbox"/> N/A
FILTERS IN PLACE	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> N/A
EXHAUST FAN	<input checked="" type="checkbox"/> UPBLAST	<input type="checkbox"/> INLINE	<input type="checkbox"/> UTILITY
CONDITION OF DUCT	<input type="checkbox"/> DAMAGED	<input checked="" type="checkbox"/> NOT DAMAGED	<input type="checkbox"/> N/A
FILTER CLEANING FREQUENCY	<input type="checkbox"/> DAILY	<input type="checkbox"/> WEEKLY	<input type="checkbox"/> MONTHLY
	<input type="checkbox"/> BIMONTHLY	<input type="checkbox"/> QUARTERLY	HALF YEARLY <input checked="" type="checkbox"/>
DOORS/PLATES PRESENT	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	HOW MANY DOORS <i>04</i>
DOORS/PANELS INSTALLED	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	HOW MANY PANELS <i>04</i>
			HOW MANY DOORS <input checked="" type="checkbox"/>
DOORS/PANELS INSTALLED	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	HOW MANY PANELS <input checked="" type="checkbox"/>
			HOW MANY DOORS <input checked="" type="checkbox"/>
CONDITION OF ROOF/WALL	<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
CONDITION OF KITCHEN DUCT BEFORE CLEANING		CONDITION OF KITCHEN DUCT AFTER CLEANING	
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN
			<input type="checkbox"/> DIRTY
			<input type="checkbox"/> VERY DIRTY
LAST CLEANING DATE		CURRENT CLEANING DATE	
		<i>06-11-2018</i>	
		<i>06-05-2019</i>	
CHEMICALS & EQUIPMENTS USED			
<input checked="" type="checkbox"/> High/Low Pressure Jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Degreaser Chemical <input checked="" type="checkbox"/> Plastic Roll <input checked="" type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials.			
TEAM <input checked="" type="checkbox"/>		TEAM LEADER <i>Bishal Rai</i>	
COMMENTS & RECOMMENDATIONS: <i>kitchen disinfected</i> The above kitchen exhaust duct was successfully degreased and cleaned as per local municipality guidelines.			
Crystalline Representative: <i>Bishal Rai</i>		Signature: <i>Bishal Rai</i>	

kitchen hood and duct cleaned & disinfected




CRYSTALLINE
ENVIRONMENTAL SERVICES


Date of Cleaning: 06-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- HOT KITCHEN 2

BEFORE

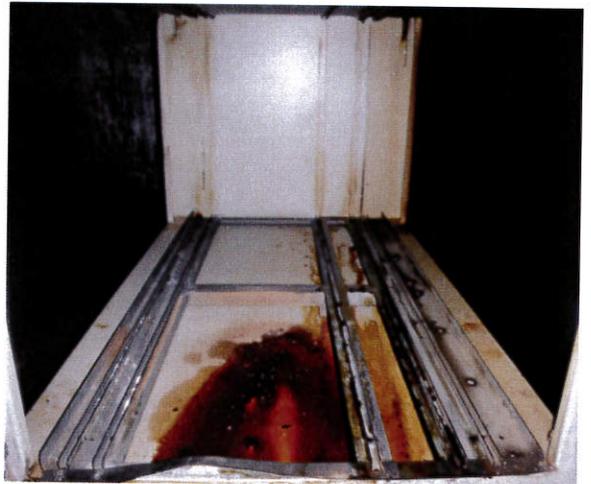

AFTER

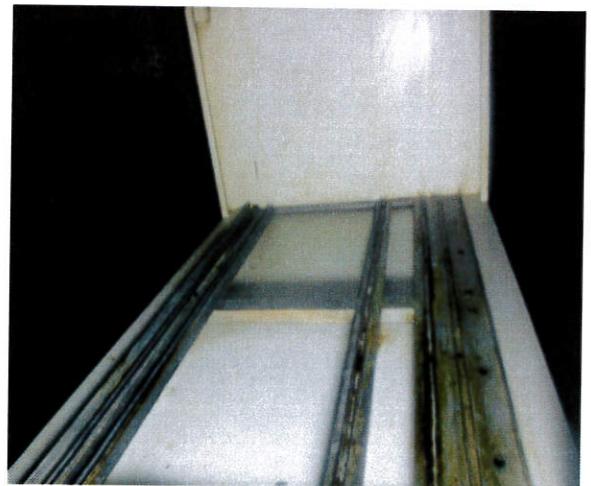

CLEANER WATER GREENER TOMORROW

Date of Cleaning: 06-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- HOT KITCHEN 2

BEFORE




AFTER




Date of Cleaning: 06-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- HOT KITCHEN 2

BEFORE

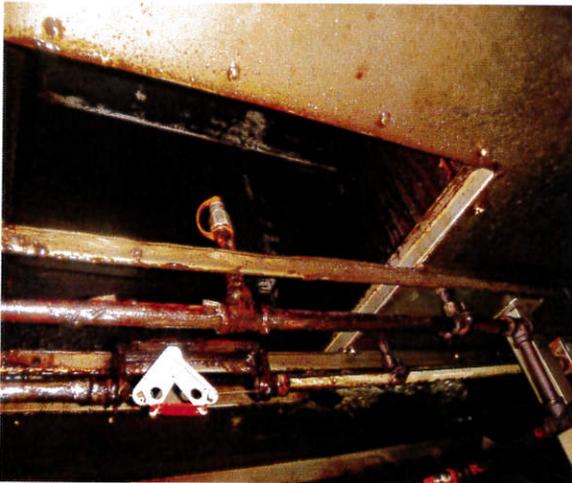

AFTER

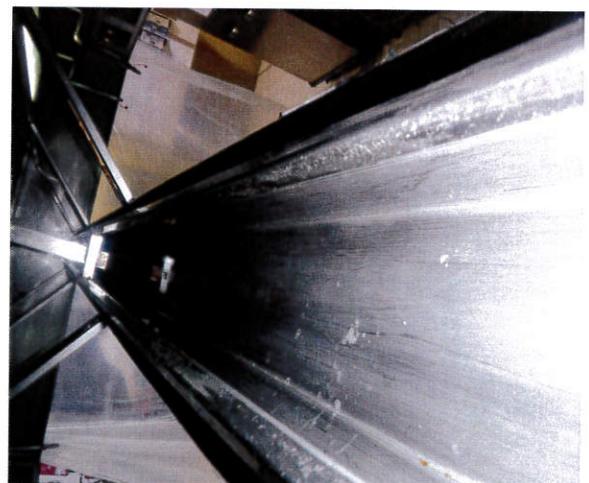



KITCHEN EXHAUST SYSTEM – AFTER SERVICE REPORT

CUSTOMER: <i>All Reem Hospico Company LLC</i>	CONTACT PERSON: <i>Ferdinand</i>
SITE DETAILS: <i>Tawam Hospital main kitchen</i>	CONTACT NO: <i>052-6209566</i>
NAME OF KITCHEN/DETAILS: <i>dish wash kitchen hood</i>	LOCATION OF KITCHEN: <i>level-1 Al Reem</i>
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> RESIDENTIAL <input type="checkbox"/> EDUCATIONAL <input type="checkbox"/> INDUSTRIAL	

dish wash - 5 Exhaust fan m-t 1640 cleaned & disinfected

COOKING VOLUME	<input type="checkbox"/> HIGH	<input checked="" type="checkbox"/> MEDIUM	<input type="checkbox"/> LOW
TYPE OF FILTERS	<input checked="" type="checkbox"/> MESH	<input type="checkbox"/> BAFFLE	<input type="checkbox"/> N/A
FILTERS IN PLACE	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> N/A
EXHAUST FAN	<input checked="" type="checkbox"/> UPBLAST	<input type="checkbox"/> INLINE	<input type="checkbox"/> UTILITY
CONDITION OF DUCT	<input type="checkbox"/> DAMAGED	<input type="checkbox"/> NOT DAMAGED	<input type="checkbox"/> N/A
FILTER CLEANING FREQUENCY	<input type="checkbox"/> DAILY	<input type="checkbox"/> WEEKLY	<input type="checkbox"/> MONTHLY
	<input type="checkbox"/> BIMONTHLY	<input type="checkbox"/> QUARTERLY	HALF YEARLY <input checked="" type="checkbox"/>
DOORS/PANES PRESENT	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	HOW MANY DOORS <i>02</i>
			HOW MANY PANELS <i>02</i>
DOORS/PANELS INSTALLED	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	HOW MANY DOORS <input checked="" type="checkbox"/>
			HOW MANY PANELS <input checked="" type="checkbox"/>
CONDITION OF ROOF/WALL	<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY

CONDITION OF KITCHEN DUCT BEFORE CLEANING

CONDITION OF KITCHEN DUCT AFTER CLEANING

<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
--------------------------------	---	-------------------------------------	---	--------------------------------	-------------------------------------

LAST CLEANING DATE

CURRENT CLEANING DATE

NEXT CLEANING DATE

07-11-2018

07-05-2019

CHEMICALS & EQUIPMENTS USED

- High/Low Pressure Jet
- Extension Cords
- LED Lights
- Ladder
- Ventilating Fan
- Degreaser Chemical
- Plastic Roll
- Vacuum Cleaner
- Cleaning Materials.

TEAM <input checked="" type="checkbox"/>	TEAM LEADER <i>Bishal Rai</i>
--	-------------------------------

COMMENTS & RECOMMENDATIONS: *Kitchen disinfected*

The above kitchen exhaust duct was successfully degreased and cleaned as per local municipality guidelines.

Crystalline Representative: <i>Bishal Rai</i>	Signature: <i>[Signature]</i>
---	-------------------------------

Kitchen hood and duct cleaned & disinfected



CRYSTALLINE
ENVIRONMENTAL SERVICES


Date of Cleaning: 07-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- DISH WASH KITCHEN

BEFORE



AFTER

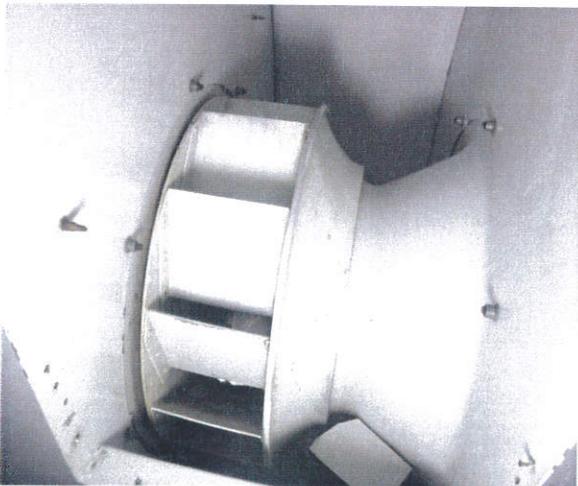

CLEANER WATER GREENER TOMORROW


Date of Cleaning: 07-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- DISH WASH KITCHEN

BEFORE



AFTER

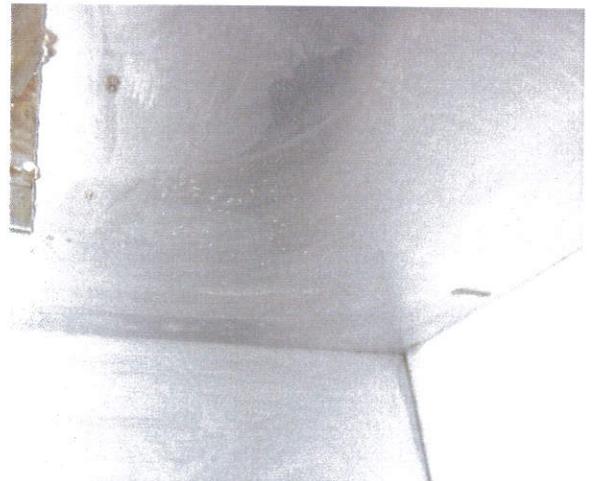

Date of Cleaning: 07-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- DISH WASH KITCHEN

BEFORE



AFTER





KITCHEN EXHAUST SYSTEM – AFTER SERVICE REPORT

CUSTOMER: <i>Al Reem Hospico Company ll.c</i>	CONTACT PERSON: <i>ferdinad</i>
SITE DETAILS: <i>Tawam Hospital main kitchen</i>	CONTACT NO: <i>052-6209566</i>
NAME OF KITCHEN/DETAILS: <i>Cafeteria kitchen hood</i>	LOCATION OF KITCHEN: <i>level-2 Al Ain</i>
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> RESIDENTIAL <input type="checkbox"/> EDUCATIONAL <input type="checkbox"/> INDUSTRIAL	

Cafeteria-6 Exhaust fan m-T 1641 cleaned & disinfected

COOKING VOLUME	<input type="checkbox"/> HIGH	<input checked="" type="checkbox"/> MEDIUM	<input type="checkbox"/> LOW
TYPE OF FILTERS	<input checked="" type="checkbox"/> MESH	<input type="checkbox"/> BAFFLE	<input type="checkbox"/> N/A
FILTERS IN PLACE	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> N/A
EXHAUST FAN	<input checked="" type="checkbox"/> UPBLAST	<input type="checkbox"/> INLINE	<input type="checkbox"/> UTILITY
CONDITION OF DUCT	<input type="checkbox"/> DAMAGED	<input type="checkbox"/> NOT DAMAGED	<input type="checkbox"/> N/A
FILTER CLEANING FREQUENCY	<input type="checkbox"/> DAILY	<input type="checkbox"/> WEEKLY	<input type="checkbox"/> MONTHLY
	<input type="checkbox"/> BIMONTHLY	<input type="checkbox"/> QUARTERLY	HALF YEARLY <input checked="" type="checkbox"/>
DOORS/PANES PRESENT	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	HOW MANY DOORS <i>02</i> HOW MANY PANELS <i>02</i>
DOORS/PANES INSTALLED	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	HOW MANY DOORS <i>✓</i> HOW MANY PANELS <i>✓</i>
CONDITION OF ROOF/WALL	<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY

CONDITION OF KITCHEN DUCT BEFORE CLEANING

CONDITION OF KITCHEN DUCT AFTER CLEANING

<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
--------------------------------	---	-------------------------------------	---	--------------------------------	-------------------------------------

LAST CLEANING DATE

CURRENT CLEANING DATE

NEXT CLEANING DATE

08-11-2018

08-05-2019

CHEMICALS & EQUIPMENTS USED

- High/Low Pressure Jet
- Extension Cords
- LED Lights
- Ladder
- Ventilating Fan
- Degreaser Chemical
- Plastic Roll
- Vacuum Cleaner
- Cleaning Materials.

TEAM <input checked="" type="checkbox"/>	TEAM LEADER <i>Bishal Rai</i>
--	-------------------------------

COMMENTS & RECOMMENDATIONS: *kitchen disinfected*

The above kitchen exhaust duct was successfully degreased and cleaned as per local municipality guidelines.


Crystalline Representative: <i>Bishal Rai</i>	Signature:
---	------------

kitchen hood and duct cleaned & disinfected


Date of Cleaning: 08-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- CAFETERIA KITCHEN

BEFORE

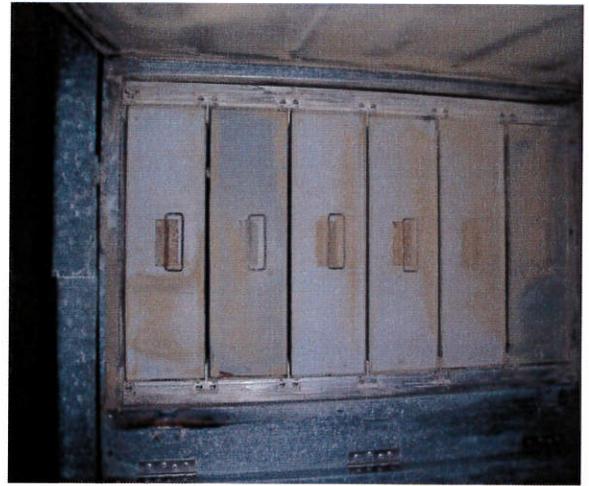


AFTER

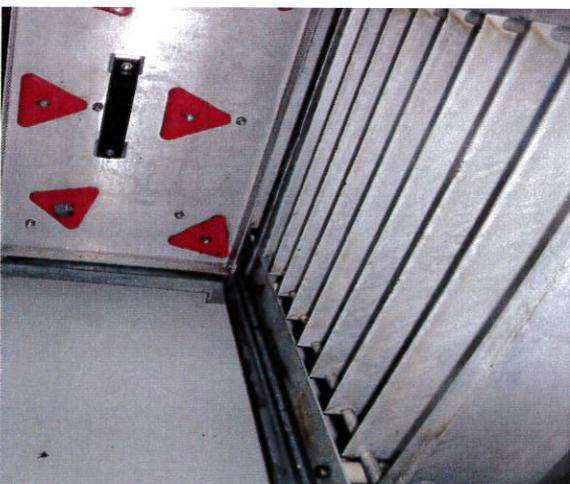


Date of Cleaning: 08-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- CAFETERIA KITCHEN

BEFORE

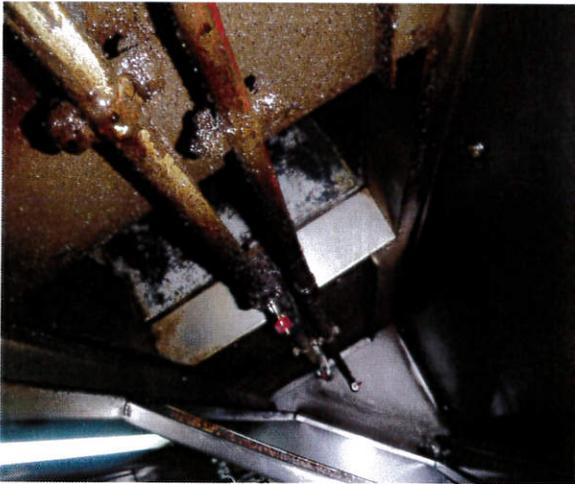



AFTER

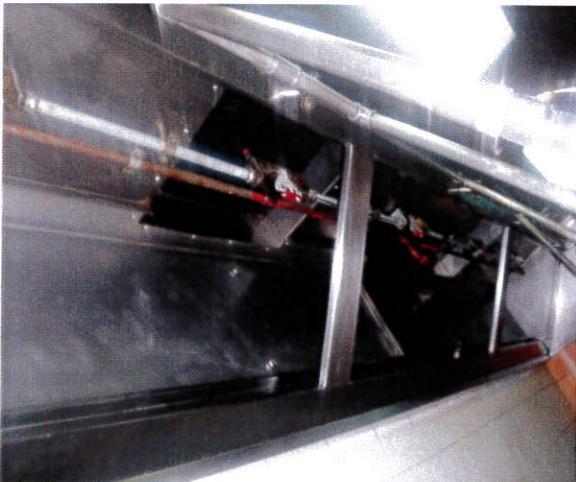

Date of Cleaning: 08-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- CAFETERIA KITCHEN

BEFORE

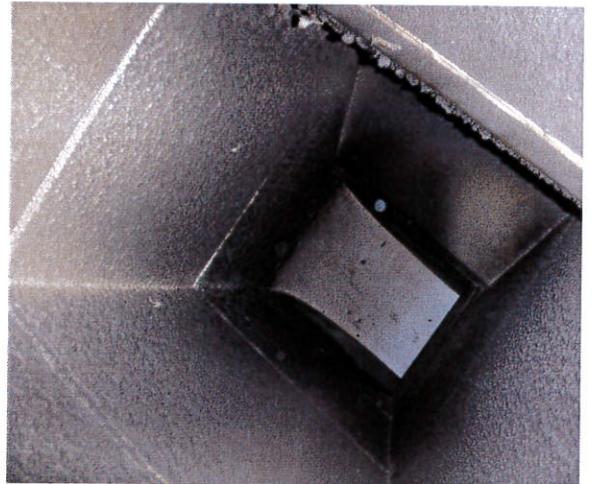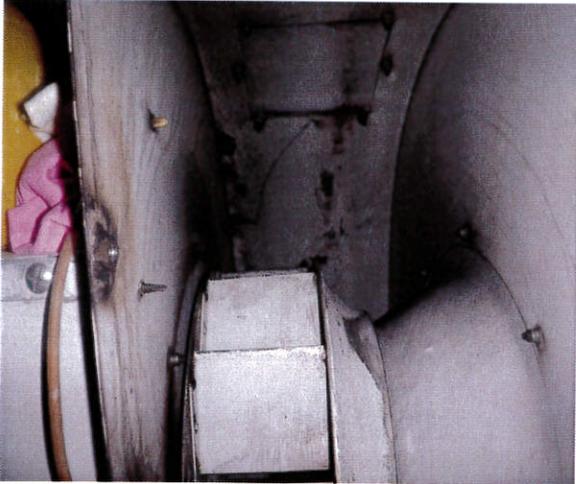

AFTER





KITCHEN EXHAUST SYSTEM – AFTER SERVICE REPORT

CUSTOMER: <i>Al Reem Hospico Company LLC</i>	CONTACT PERSON: <i>ferdinad</i>
SITE DETAILS: <i>Tawam Hospital main kitchen</i>	CONTACT NO: <i>052-6209566</i>
NAME OF KITCHEN/DETAILS: <i>Bakery kitchen hood-3</i>	LOCATION OF KITCHEN: <i>level-1 Al Ain</i>
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> RESIDENTIAL <input type="checkbox"/> EDUCATIONAL <input type="checkbox"/> INDUSTRIAL	

Bakery-3 Exhaust fan m.T 1638 cleaned & disinfected

COOKING VOLUME	<input type="checkbox"/> HIGH	<input checked="" type="checkbox"/> MEDIUM	<input type="checkbox"/> LOW
TYPE OF FILTERS	<input checked="" type="checkbox"/> MESH	<input type="checkbox"/> BAFFLE	<input type="checkbox"/> N/A
FILTERS IN PLACE	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> N/A
EXHAUST FAN	<input checked="" type="checkbox"/> UPBLAST	<input type="checkbox"/> INLINE	<input type="checkbox"/> UTILITY
CONDITION OF DUCT	<input type="checkbox"/> DAMAGED	<input type="checkbox"/> NOT DAMAGED	<input type="checkbox"/> N/A
FILTER CLEANING FREQUENCY	<input type="checkbox"/> DAILY	<input type="checkbox"/> WEEKLY	<input type="checkbox"/> MONTHLY
	<input type="checkbox"/> BIMONTHLY	<input type="checkbox"/> QUARTERLY	HALF YEARLY <input checked="" type="checkbox"/>
DOORS/PLATES PRESENT	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	HOW MANY DOORS <i>02</i>
			HOW MANY PANELS <i>02</i>
DOORS/PANELS INSTALLED	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	HOW MANY DOORS <input checked="" type="checkbox"/>
			HOW MANY PANELS <input checked="" type="checkbox"/>
CONDITION OF ROOF/WALL	<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY

CONDITION OF KITCHEN DUCT BEFORE CLEANING

CONDITION OF KITCHEN DUCT AFTER CLEANING

<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
--------------------------------	---	-------------------------------------	---	--------------------------------	-------------------------------------

LAST CLEANING DATE

CURRENT CLEANING DATE

NEXT CLEANING DATE

10-11-2018

10-05-2019

CHEMICALS & EQUIPMENTS USED

- High/Low Pressure Jet
 Extension Cords
 LED Lights
 Ladder
 Ventilating Fan
 Degreaser Chemical
 Plastic Roll
 Vacuum Cleaner
 Cleaning Materials.

TEAM <input checked="" type="checkbox"/>	TEAM LEADER <i>Bishal Rai</i>
---	--------------------------------------

COMMENTS & RECOMMENDATIONS: *Kitchen disinfected*
 The above kitchen exhaust duct was successfully degreased and cleaned as per local municipality guidelines.

Crystalline Representative: <i>Bishal Rai</i>	Signature:
--	-------------------

Kitchen hood and duct cleaned & disinfected


Date of Cleaning: 10-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- BAKERY KITCHEN

BEFORE




AFTER

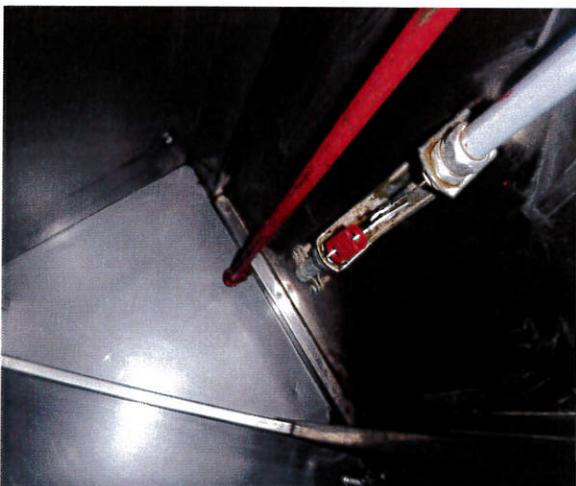

Date of Cleaning: 10-11-2018

PHOTOGRAPHS
KITCHEN DUCT CLEANING- BAKERY KITCHEN

BEFORE

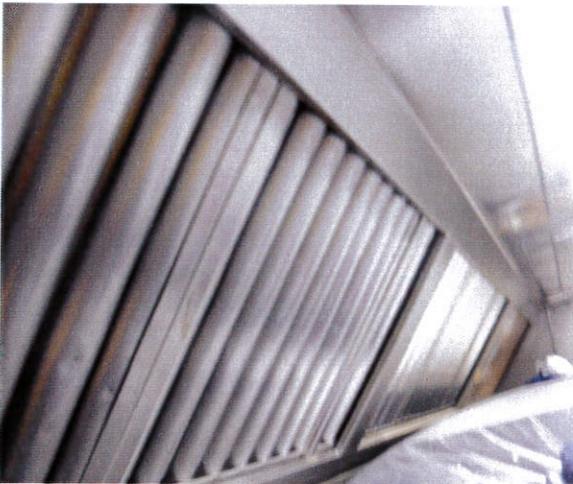

AFTER





METHODOLOGY:

- ✓ Preliminary site visit. To choose the effective procedure.
- ✓ Live Camera Inspection for the internal duct.
- ✓ Safety clothing/equipment required: overalls, safety boots, eye protection, gloves and correct respirators.
- ✓ Conduct safety briefing with client's representative to ensure all possible hazards are identified and reported immediately if assistance is required for the control of hazards.
- ✓ Ensure spill control Kit and fire extinguisher is available.
- ✓ Digital photo taken for the proof of cleaning process.
- ✓ Access holes in ducts shall be cut if required.
- ✓ Fans shall be isolated and warning labels should be placed on isolation switches.
- ✓ Areas of duct to be cleaned to bare metal.
- ✓ Toxic or flammable products shall not be used.
- ✓ Waste rags and lint will be disposed of in the client's waste disposal facilities.
- ✓ Record any areas unable to be cleaned giving exact reasons.

If you have any queries concerning our services, please contact: +971 2 6508930

Thank you for your business!

Crystalline Cleaning & Environmental Services

CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

CLEANING & DISINFECTION CERTIFICATE

CLIENT NAME : AL REEM HOSPICO COMPANY LLC.
CLIENT ADDRESS : P.O. BOX: 81379, AL AIN, ABU DHABI.
CONTACT PERSON : MR. FERDINAND.
SITE DETAILS : TAWAM HOSPITAL, AL AIN, UAE.
DETAILS : KITCHEN EXHAUST SYSTEM CLEANING
DATE OF CLEANING : NOVEMBER 2018
FREQUENCY OF CLEANING : EVERY SIX (6) MONTHS
DATE OF NEXT CLEANING : MAY 2018

The procedures employed in this cleaning and disinfection comply with Abu Dhabi Municipality guidelines

The entire Kitchen Duct should be cleaned and degreased minimum every six (6) months depending upon the condition.



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES