

WATER TANK CLEANING & DISINFECTION

COMPLETION REPORT

FOR

serco

Bringing service to life

Client : SERCO MIDDLE EAST.
Contact Person: Mr. Zidhikkul Akbar
Accommodation Supervisor.
Site Details : Serco Staff Accommodation,
Abu Dhabi, UAE.
Date : 28 November 2018



CRYSTALLINE
ENVIRONMENTAL SERVICES

CRYSTALLINE ENVIRONMENTAL
SERVICES

P.O. BOX 131463, Abu Dhabi, U.A.E.

TEL: 02 6508930 FAX: 02 6508942

info@crystalline-uae.com

www.crystalline-uae.com





CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

18601

CUSTOMER: <u>SERCO FIM</u>			CONTACT PERSON: <u>MR. ISRAR</u>		
SITE DETAILS: <u>ABU DHABI</u> <u>SERCO ACCOMADATION</u>			CONTACT NO: <u>0569924012</u>		
TANK DETAILS: <u>R.C.C. WATER TANK</u>			LOCATION DETAILS: <u>UNDER GARROUD</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL <input checked="" type="checkbox"/> RESIDENTIAL <input type="checkbox"/> OTHERS					
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED	<input type="checkbox"/> POLYURETHANE		<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE	<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED	<input type="checkbox"/> NA
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>12.11.2018</u>		<u>12.05.2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO</u> Quantity <u>500ML</u>					
2. <u>CARECO BIO plus</u> Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input checked="" type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input checked="" type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input checked="" type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
<u>MENTIONED WATER TANK ARE CLEANED AND DISINFECTED</u>					
Crystalline Representative: <u>HARIS</u>			Signature: <u>HARIS</u>		




CRYSTALLINE
ENVIRONMENTAL SERVICES


Date of Cleaning: 11-11-2018

PHOTOGRAPHS
UNDER GROUND RCC WATER TANK

BEFORE

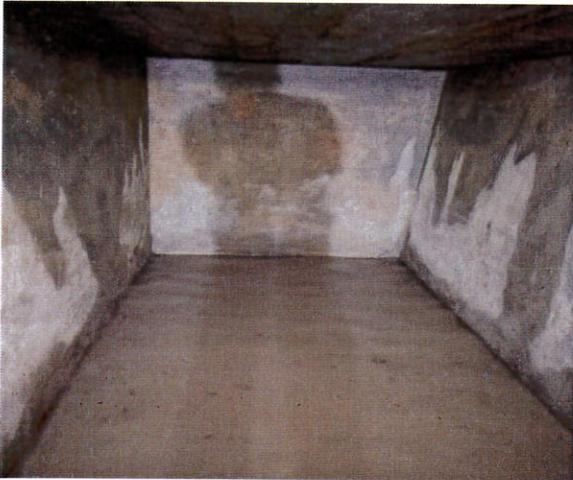

AFTER

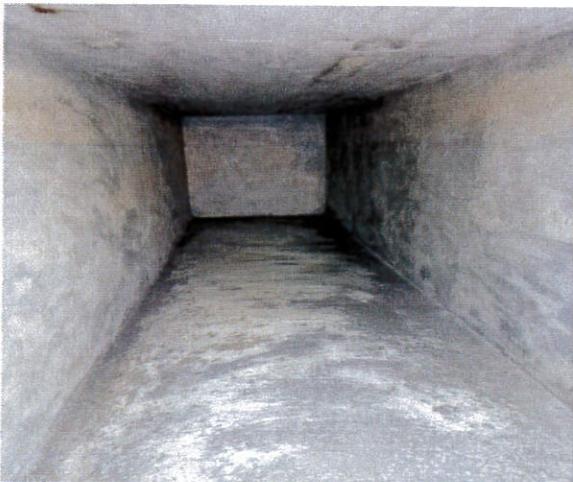

CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT


20831

CUSTOMER: <u>Serco</u>			CONTACT PERSON: <u>Mr Isfar</u>		
SITE DETAILS: <u>Serco Accommodation Abu Dhabi</u>			CONTACT NO: <u>0569924072</u>		
TANK DETAILS: <u>Water Tank</u>			LOCATION DETAILS: <u>Roof Top</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input checked="" type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>3000</u> USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> LADDER IN	<input type="checkbox"/> LADDER OUT	LEAKS		DRAIN LINE	
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>13-11-2018</u>		<u>13-06-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>Charlar Bios Plus</u> Quantity <u>2000m</u>					
2. <u>pump, hose, brush, bucket, extension</u> Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input checked="" type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
<u>Ready for usage tank well cleaned & disinfected</u>					
Crystalline Representative: <u>Cannick</u>			Signature:		

Date of Cleaning: 13-11-2018

PHOTOGRAPHS
ROOF TOP SINTEX WATER TANK - 01

BEFORE

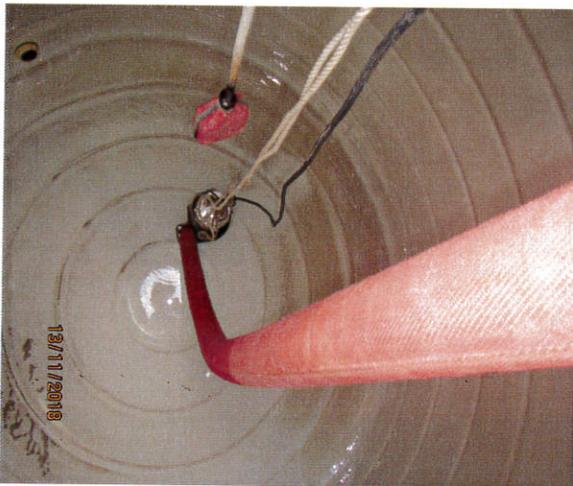

AFTER





CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

20832

CUSTOMER: <u>Serco</u>			CONTACT PERSON: <u>Mr J Sarar</u>		
SITE DETAILS: <u>Serco Accommodation Abu Dhabi</u>			CONTACT NO: <u>0589924072</u>		
TANK DETAILS: <u>Water Tank 2</u>			LOCATION DETAILS: <u>ROOF TOP</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL <input checked="" type="checkbox"/> RESIDENTIAL <input type="checkbox"/> OTHERS					
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input checked="" type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>300</u>	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF <input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE	<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED	<input type="checkbox"/> NA
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>7/3/19/2018</u>		<u>7/3/06/2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>Choribat Bios Plus</u> Quantity <u>250ml</u>					
2. <u>Pump, Hose, bucket, brush, cloth, etc</u> Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input checked="" type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS: <u>Tank well cleaned and disinfected ready for usage.</u>					
Crystalline Representative: <u>Yannick</u>			Signature: <u>[Signature]</u>		



Date of Cleaning: 13-11-2018

PHOTOGRAPHS
ROOF TOP SINTEX WATER TANK - 02

BEFORE



AFTER

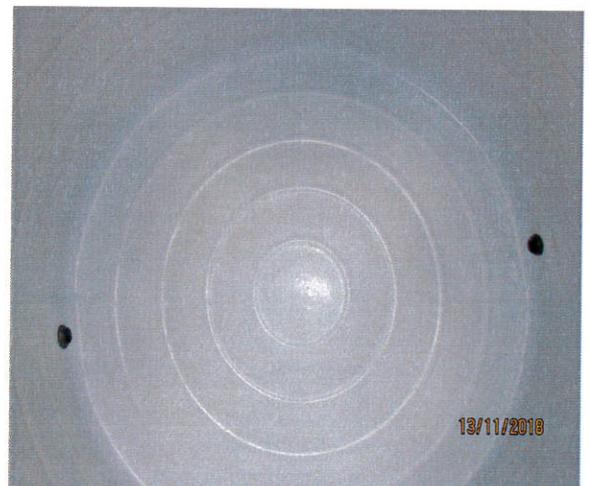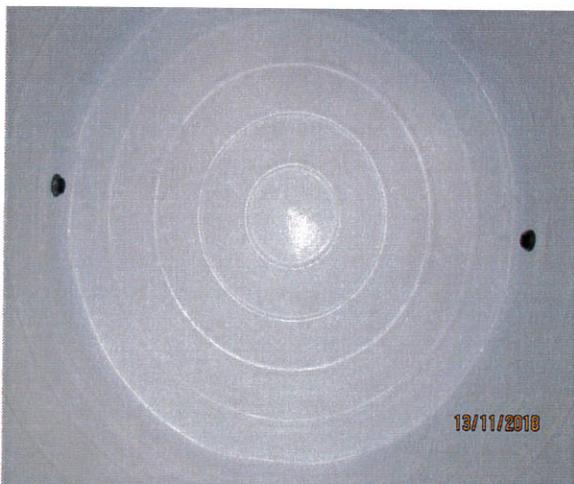



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

20833

CUSTOMER: <i>Gerco</i>			CONTACT PERSON: <i>Mr Jasar</i>		
SITE DETAILS: <i>gerco Accommodation Abu Dhabi</i>			CONTACT NO: <i>0569924072</i>		
TANK DETAILS: <i>water 3</i>			LOCATION DETAILS: <i>Roof Top</i>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input checked="" type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<i>3000</i>	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF
<input type="checkbox"/> EMPTY					
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	
<input type="checkbox"/> DAMAGED		<input type="checkbox"/> NA			
LADDER IN		LADDER OUT		LEAKS	
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	
DRAIN LINE		VALVES		FLOAT VALVE	
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO <input checked="" type="checkbox"/> NA	
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<i>13/7/2018</i>		<i>13/06/2019</i>	
CHEMICALS & EQUIPMENTS USED					
<ol style="list-style-type: none"> <i>Chorlar bios plus</i> Quantity <i>280ml</i> <i>Pump, hose, brush, bucket, etc</i> Quantity _____ 					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input checked="" type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS: <i>Tank cleaned and disinfected and Ready for useage.</i>					
Crystalline Representative: <i>Vannick</i>			Signature: <i>[Signature]</i>		


Date of Cleaning: 13-11-2018

PHOTOGRAPHS
ROOF TOP SINTEX WATER TANK - 03

BEFORE



AFTER

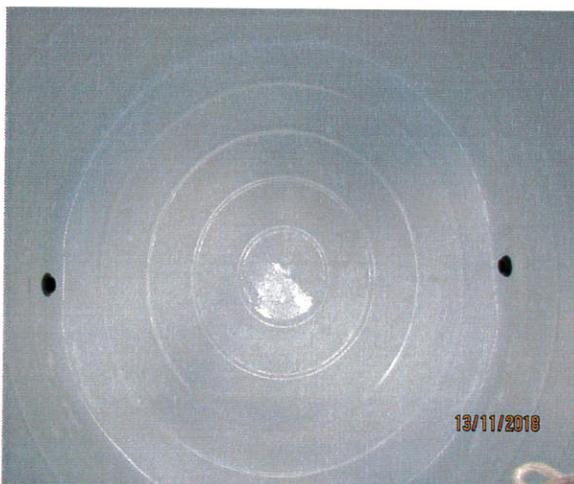



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

20834

CUSTOMER: <u>SERCO</u>			CONTACT PERSON: <u>Mr Jaber</u>		
SITE DETAILS: <u>SERCO Accommodation Abu Dhabi</u>			CONTACT NO: <u>05699244072</u>		
TANK DETAILS: <u>Water tank 4</u>			LOCATION DETAILS: <u>ROOF TOP</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input checked="" type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>3000</u> USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> LADDER IN	<input type="checkbox"/> LADDER OUT	LEAKS		DRAIN LINE	
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>13/11/2018</u>		<u>13/06/2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>Chlorox Plus</u> Quantity <u>250ml</u>					
2. <u>Pump, hose, brush, bucket, cloth, etc</u> Quantity _____					
<input checked="" type="checkbox"/> Submersible Pump <input type="checkbox"/> High/Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input checked="" type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Meter <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS: <u>Tank well cleaned and disinfected ready for usage.</u>					
Crystalline Representative: <u>Yannick</u>			Signature: <u>[Signature]</u>		




CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 13-11-2018

PHOTOGRAPHS
ROOF TOP SINTEX WATER TANK - 04

BEFORE

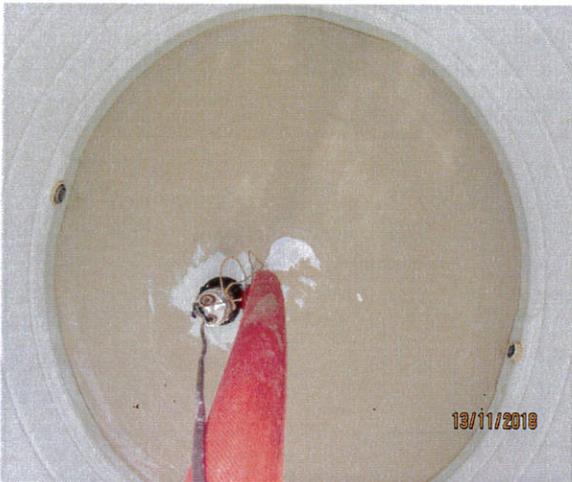

AFTER



CLEANER WATER GREENER TOMORROW

CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

CLEANING & DISINFECTION CERTIFICATE

POTABLE WATER TANKS

CLIENT NAME : SERCO MIDDLE EAST.

CLIENT ADDRESS : SERCO STAFF ACCOMMODATION,
ABU DHABI, UAE.

CONTACT PERSON : MR. ZIDHIKKUL AKBAR.

SITE DETAILS : SERCO STAFF ACCOMMODATION,
ABU DHABI, UAE.

DETAILS : WATER TANK CLEANING

DATE OF CLEANING : 12 -13 NOVEMBER 2018

FREQUENCY OF CLEANING : EVERY SIX MONTHS

DATE OF NEXT CLEANING : 12 MAY 2019

The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.

The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES