

AIR CONDITION DUCT CLEANING AND SANITIZING

COMPLETION REPORT

For



Client : Squad Line General Contracting &
Maintenance L.L.C.
Contact Person: Mr. Ansari K.
Asst. Manager
Site Details : Apartment No. 1002,
M/s Bin Hayai Bldg, Block A,
Abu Dhabi, UAE
Date : 08 January 2019



CRYSTALLINE
ENVIRONMENTAL SERVICES

**Crystalline environmental
services**

P.O. Box 131463, Abu Dhabi, U.A.E.

Tel: 02 6508930 Fax: 02 6508942

info@crystalline-uae.com

www.crystalline-uae.com



CRYSTALLINE ENVIROMENTAL SERVICES

AC DUCT - AFTER SERVICE REPORT

1004

CUSTOMER: Squad Line General Contracting		CONTACT PERSON: Mr. Shahid / Mrs. Shahidullah	
SITE DETAILS: BUILDING A-Blocks		CONTACT NO.: 0553117251	
AC DETAILS: A/C Duct and UNIT		LOCATION DETAILS: 10 th FLOOR FLATE 1002	
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL <input type="checkbox"/> OTHER	
AIR CONDITIONING MACHINE:		NO. OF ROOMS SUPPLIED BY A/C:	
Type of A/C:	<input checked="" type="checkbox"/> Package Unit	<input type="checkbox"/> AHU	<input type="checkbox"/> Fan Coil / Split Unit
Tilted correctly:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
Drip tray accessible:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	
Drip tray:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	
Direct drain:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
Condition of Drip tray cleaned:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input type="checkbox"/> Slime	<input type="checkbox"/> Mould <input type="checkbox"/> Rusty <input type="checkbox"/> Damage
TYPE OF FILTERS: FILTER CLEANING FREQUENCY:			
Filters:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
Location of filters:	<input checked="" type="checkbox"/> Duct	<input type="checkbox"/> Machine	
DUCTWORK:			
Only physical entry into ducts:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Partly
Access with tools only:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Partly
NUMBER OF SUPPLY GRILLS:		NUMBER OF RETURN GRILLS:	
Type of grill:	<input checked="" type="checkbox"/> Square	<input checked="" type="checkbox"/> Rectangle	<input type="checkbox"/> Slot <input type="checkbox"/> Round
Fresh air inlet:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Open <input type="checkbox"/> Closed
Return air:	<input type="checkbox"/> Ducts	<input type="checkbox"/> Cavity	
Flow dumpers:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
Sensors:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	
Damaged:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
Internal acoustic insulation:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
Type:	<input type="checkbox"/> Polystyrene	<input type="checkbox"/> Rockwood	<input checked="" type="checkbox"/> Foam
External insulation:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
Type:	<input type="checkbox"/> Polystyrene	<input type="checkbox"/> Rockwood	<input checked="" type="checkbox"/> Foam
Covering insulation:	<input checked="" type="checkbox"/> Canvas	<input type="checkbox"/> Aluminum	<input type="checkbox"/> Others
Sanitization of ducts:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
Entire system cleaned:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	If no, give details
Access doors/panels present:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	How many 06
Access doors/panels fitted:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	How many 02
Ducts damaged:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	Where
Where installed:	A/S		
Ducts size and approximate length:			
LAST CLEANED:	CURRENT CLEANING DATE:	NEXT CLEANING DATE:	
	05-01-2019	05-01-2020	
CHEMICALS & EQUIPMENTS USED			
Quantity: Vacuum machine, special cleaner, Air Compressor, sanitization, Tools ...			
Comments & recommendations:			
There is No Vacuum duct cleaning			
Crystalline Representative		Signature:	
Client Representative:		Signature:	



CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 05-01-2019

PHOTOGRAPHS
A C DUCT CLEANING & SANITIZING- 1002

BEFORE



AFTER



CLEANER WATER GREENER TOMORROW




CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 05-01-2019

PHOTOGRAPHS
A C DUCT CLEANING & SANITIZING- 1002

BEFORE

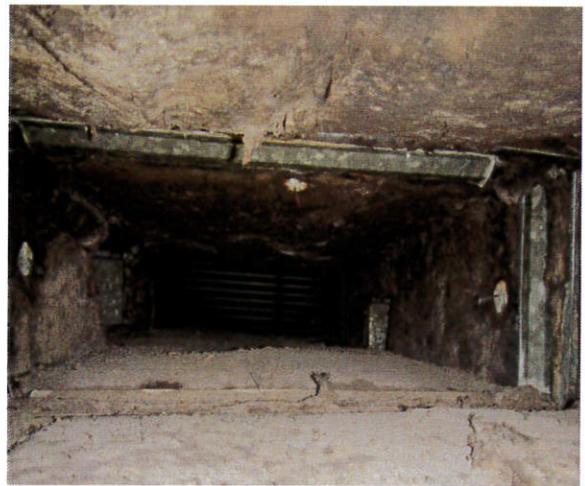

AFTER



CLEANER WATER GREENER TOMORROW



CRYSTALLINE
ENVIRONMENTAL SERVICES


Date of Cleaning: 05-01-2019

PHOTOGRAPHS
AC DUCT CLEANING & SANITIZING- 1002

BEFORE



AFTER

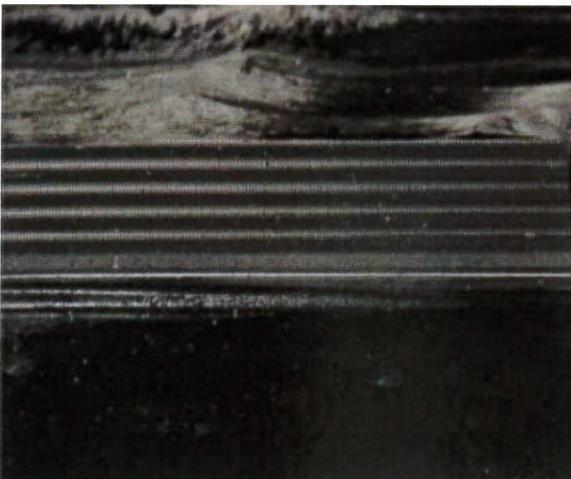

CLEANER WATER GREENER TOMORROW



Date of Cleaning: 05-01-2019

PHOTOGRAPHS
A C DUCT CLEANING & SANITIZING- 1002

BEFORE



AFTER



CLEANER WATER GREENER TOMORROW



Date of Cleaning: 05-01-2019

PHOTOGRAPHS
A C DUCT CLEANING & SANITIZING- 1002

BEFORE



AFTER




Date of Cleaning: 05-01-2019

PHOTOGRAPHS
A C DUCT CLEANING & SANITIZING- 1002

BEFORE




AFTER

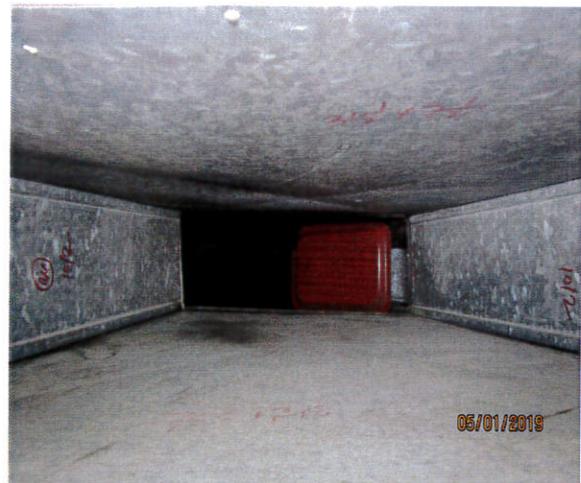

Date of Cleaning: 05-01-2019

PHOTOGRAPHS
A C DUCT CLEANING & SANITIZING- 1002

BEFORE

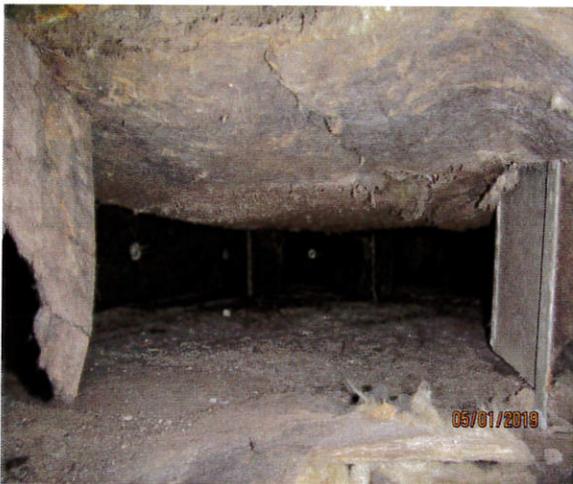

AFTER






Date of Cleaning: 05-01-2019

PHOTOGRAPHS
A C DUCT CLEANING & SANITIZING- 1002

BEFORE



AFTER

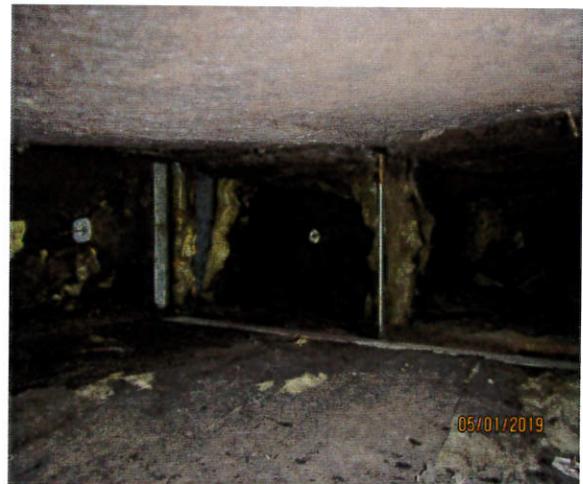

Date of Cleaning: 05-01-2019

PHOTOGRAPHS
A C DUCT CLEANING & SANITIZING- 1002

BEFORE



AFTER



CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

CLEANING & DISINFECTION CERTIFICATE

CLIENT NAME : SQUAD LINE GENERAL CONTRACTING & MAINTENANCE L.L.C.

CLIENT ADDRESS : P.O. BOX 52945, ABU DHABI, UAE.

CONTACT PERSON : MR. ANSARI K.

SITE DETAILS : FLAT 1002, M/S BIN HAYAI BLDG, BLOCK A, DHARATUL MIA, ABU DHABI, UAE

DETAILS : AIR CONDITION DUCT CLEANING & SANITIZING

DATE OF CLEANING : 5 JANUARY 2019

FREQUENCY OF CLEANING : EVERY ONE (1) YEAR

DATE OF NEXT CLEANING : 5 JANUARY 2020

The procedures employed in this cleaning and degreasing comply with Abu Dhabi Municipality guidelines

The entire AC Duct should be cleaned and Degreased minimum every one (1) Year depending upon the condition.



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES