

WATER TANK CLEANING & DISINFECTION

COMPLETION REPORT

FOR

TARGET

Client : **TARGET ENGINEERING
CONSTRUCTION COMPANY.**
Contact Person: Mr. Khalid Usman
Camp Boss
Site Details : GNC Camp, Ruwais, Gayathi,
Abu Dhabi, UAE.
Date : 30 January 2019



CRYSTALLINE
ENVIRONMENTAL SERVICES

CRYSTALLINE ENVIRONMENTAL
SERVICES

P.O. BOX 131463, Abu Dhabi, U.A.E.

TEL: 02 6508930 FAX: 02 6508942

info@crystalline-uae.com

www.crystalline-uae.com





CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17472

CUSTOMER: TARGET CNC			CONTACT PERSON: MR. KHALID		
SITE DETAILS: TARGET LABOUR CAMP RUWAIS			CONTACT NO: 056-5336647		
TANK DETAILS: BINTEX TANK			LOCATION DETAILS: GROUND - SW-1		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	10000	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF
<input type="checkbox"/> EMPTY					
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input checked="" type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	
<input type="checkbox"/> DAMAGED		<input type="checkbox"/> NA			
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO <input type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		27-01-2019		27-07-2019	
CHEMICALS & EQUIPMENTS USED					
1. CARECO BIO PLUS Quantity 150ML					
2. Quantity					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: KANBARI			Signature:		



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17473


CUSTOMER: TARGET GNC			CONTACT PERSON: MR-KHALID			
SITE DETAILS: TARGET LABOUR CAMP RUWAIS-			CONTACT NO: 056-5336647			
TANK DETAILS: SINTEX TANK			LOCATION DETAILS: GROUND-SW-3			
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS		
TYPE OF TANK						
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC	
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS			
SIZE OF TANK			QUANTITY OF WATER			
M3	10000	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING			
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED	<input type="checkbox"/> NA
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE	
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED		
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO <input type="checkbox"/> NA	
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE		
		27-01-2019		27-07-2019		
CHEMICALS & EQUIPMENTS USED						
1. CARECO BIO Plus Quantity 150 ML						
2. Quantity						
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials						
COMMENTS & RECOMMENDATIONS:						
Crystalline Representative: K.ANSARI			Signature:			

Date of Cleaning: 27-01-2019

PHOTOGRAPHS
FRP WATER TANK (STAFF CAMP AREA)

BEFORE


FRP WATER TANK - 01

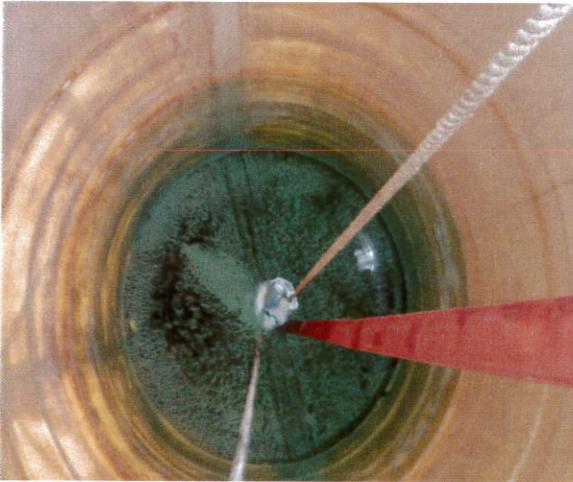

FRP WATER TANK - 03



AFTER

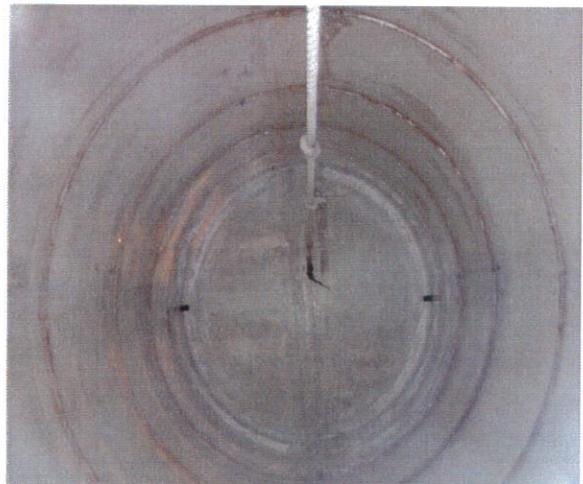



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17474

CUSTOMER: <u>TARGET CINC</u>			CONTACT PERSON: <u>MR-KHALID</u>			
SITE DETAILS: <u>TARGET LABOUR CAMP</u> <u>ROWAIS</u>			CONTACT NO: <u>056-5336647</u>			
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND-SW-4</u>			
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS		
TYPE OF TANK						
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC	
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS			
SIZE OF TANK			QUANTITY OF WATER			
M3	<u>10000</u>	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING			
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED	<input type="checkbox"/> NA
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE	
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED		
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO <input type="checkbox"/> NA	
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE		
		<u>27-01-2019</u>		<u>27-07-2019</u>		
CHEMICALS & EQUIPMENTS USED						
1. <u>CARECO BIO PLUS</u> Quantity <u>150 ML</u>						
2. _____ Quantity _____						
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials						
COMMENTS & RECOMMENDATIONS:						
Crystalline Representative: <u>K ANSARI</u>			Signature: <u>[Signature]</u>			



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17475

CUSTOMER: <u>TARGET CNC</u>			CONTACT PERSON: <u>MR - KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR CAMP</u> <u>RUWAIS -</u>			CONTACT NO: <u>056 - 5836647</u>		
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND - SW - 5</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>10000</u>	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF
			<input type="checkbox"/> EMPTY		
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input checked="" type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	
				<input type="checkbox"/> DAMAGED	
				<input type="checkbox"/> NA	
LADDER IN		LADDER OUT		LEAKS	
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	
DRAIN LINE		VALVES		FLOAT VALVE	
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO <input type="checkbox"/> NA	
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>27-01-2019</u>		<u>27-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO PLUS</u> Quantity <u>150 ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>KANSARI</u>			Signature: <u>K.A</u>		



Date of Cleaning: 27-01-2019

PHOTOGRAPHS
FRP WATER TANK (STAFF CAMP AREA)

BEFORE

FRP WATER TANK - 04



FRP WATER TANK - 05



AFTER





CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17476

CUSTOMER: <u>TARGET CNC</u>			CONTACT PERSON: <u>MR-KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR CAMP</u> <u>RUWAIS</u>			CONTACT NO: <u>056-5336647</u>		
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND-SW-6</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>10000</u>	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF
<input type="checkbox"/> EMPTY					
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	
<input type="checkbox"/> DAMAGED		<input type="checkbox"/> NA			
LADDER IN		LADDER OUT		LEAKS	
DRAIN LINE		VALVES		FLOAT VALVE	
<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO
<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO
<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO
<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>27-01-2019</u>		<u>27-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO PLUS</u> Quantity <u>150 ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>KANSARI</u>			Signature: <u>[Signature]</u>		



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17477

CUSTOMER: <u>TARGET CNC</u>			CONTACT PERSON: <u>MR - KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR CAMP</u> <u>RUWAIS</u>			CONTACT NO: <u>056 - 5336647</u>		
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND - SW - 7</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>10000</u>	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF
<input type="checkbox"/> EMPTY					
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input checked="" type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	
<input type="checkbox"/> DAMAGED		<input type="checkbox"/> NA			
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO <input type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>27-01-2019</u>		<u>27-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO Plus</u> Quantity <u>200 ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>LEANSARI</u>			Signature: <u>[Signature]</u>		



Date of Cleaning: 27-01-2019

PHOTOGRAPHS
FRP WATER TANK (STAFF CAMP AREA)

BEFORE

FRP WATER TANK - 06



FRP WATER TANK - 07



AFTER





CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17478

CUSTOMER: <u>TARGET OINC</u>			CONTACT PERSON: <u>MR - KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR CAMP</u> <u>RUWAIIS</u>			CONTACT NO: <u>056-5336647</u>		
TANK DETAILS: <u>8INTEX TANK</u>			LOCATION DETAILS: <u>GROUND SW-8</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>10000</u>	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF
<input type="checkbox"/> EMPTY					
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA					
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO <input type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>27-01-2019</u>		<u>27-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO PLUS</u> Quantity <u>200 ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>K ANSARI</u>			Signature: <u>[Signature]</u>		



CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 27-01-2019

PHOTOGRAPHS
FRP WATER TANK- 08 (STAFF CAMP AREA)

BEFORE



AFTER



CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17439

CUSTOMER: <u>TARGET QNC</u>			CONTACT PERSON: <u>MR. KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR CAMP</u> <u>RUWAIS</u>			CONTACT NO: <u>056-5336647</u>		
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND - KW-1</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>5000</u>	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF <input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED <input type="checkbox"/> DAMAGED <input type="checkbox"/> NA	
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO <input type="checkbox"/> NA	
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>28-01-2019</u>		<u>28-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO PLUS</u> Quantity <u>100 ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>K. ANSARI</u>			Signature: <u>[Signature]</u>		



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17440

CUSTOMER: <u>TARGET QNC</u>			CONTACT PERSON: <u>MR-KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR CAMP RUWAIS</u>			CONTACT NO: <u>056-5336647</u>		
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND-KW-2</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP-TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>5000</u>	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF
<input type="checkbox"/> EMPTY					
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	
<input type="checkbox"/> DAMAGED		<input type="checkbox"/> NA			
LADDER IN		LADDER OUT		LEAKS	
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO <input type="checkbox"/> NA	
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>28-01-2019</u>		<u>28-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO PLUS</u> Quantity <u>100ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>KANBARI</u>			Signature: <u>[Signature]</u>		



CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 28-01-2019

PHOTOGRAPHS
FRP WATER TANK (KITCHEN AREA)

BEFORE



FRP WATER TANK - 01



FRP WATER TANK - 02



AFTER

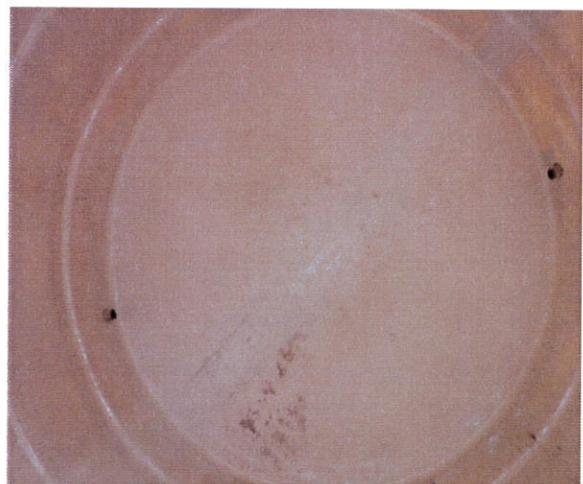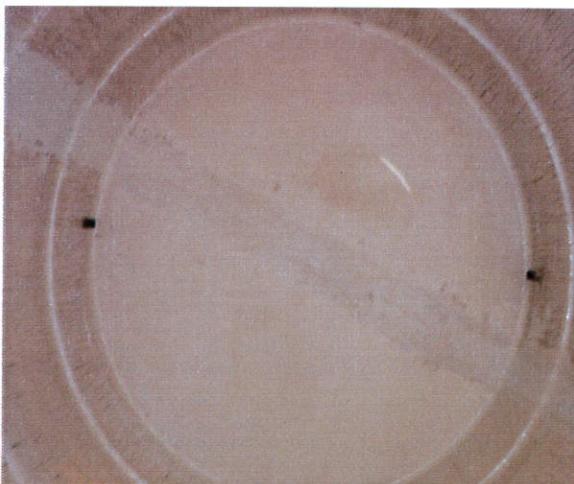

CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17479

CUSTOMER: TARGET QNC			CONTACT PERSON: MR. KHALID		
SITE DETAILS: TARGET LABOUR CAMP RUWAIS			CONTACT NO: 056-5336647		
TANK DETAILS: SINTEX TANK			LOCATION DETAILS: GROUND - K-W-4		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	5000	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF <input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input checked="" type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED <input type="checkbox"/> NA
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO			
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO <input type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		28-01-2019		28-07-2019	
CHEMICALS & EQUIPMENTS USED					
1. CARECO BIO PLUS Quantity 100 ML					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: KANBARI			Signature: KA		



CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 28-01-2019

PHOTOGRAPHS
FRP WATER TANK (KITCHEN AREA)

BEFORE

FRP WATER TANK - 03



FRP WATER TANK - 04



AFTER



CLEANER WATER GREENER TOMORROW



CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 28-01-2019

PHOTOGRAPHS
FRP WATER TANK - 05 (KITCHEN AREA)

BEFORE



AFTER



CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17444

CUSTOMER: <u>TARGET OMC</u>			CONTACT PERSON: <u>MR-KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR CAMP RUWAIS</u>			CONTACT NO: <u>056-533 6647</u>		
TANK DETAILS: <u>8 INTEX TANK</u>			LOCATION DETAILS: <u>GROUND-LW-14</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>10000</u>	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF <input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input checked="" type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED <input type="checkbox"/> NA
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO			
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO <input type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>28-01-2019</u>		<u>28-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO 8 PLUS</u> Quantity <u>200ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>ICANBARI</u>			Signature: <u>[Signature]</u>		



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17441

CUSTOMER: <u>TARGET GNC</u>			CONTACT PERSON: <u>MR-KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR CAMP</u> <u>RUWAIS</u>			CONTACT NO: <u>056-5336647</u>		
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND-LW-16</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>10000</u>	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF
<input type="checkbox"/> EMPTY					
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input checked="" type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	
<input type="checkbox"/> DAMAGED		<input type="checkbox"/> NA			
LADDER IN		LADDER OUT		LEAKS	
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO <input type="checkbox"/> NA	
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>28-01-2019</u>		<u>28-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO 8 PLUS</u> Quantity <u>200ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>K. ANSARI</u>			Signature: <u>[Signature]</u>		



CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 28-01-2019

PHOTOGRAPHS
FRP WATER TANK (LABOUR AREA)

BEFORE

FRP WATER TANK - 14



FRP WATER TANK - 16



AFTER



CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17443

CUSTOMER: <u>TARGET QWC</u>			CONTACT PERSON: <u>MR-KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR CAMP</u> <u>ROWAIS</u>			CONTACT NO: <u>056-5336647</u>		
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND-LW-19</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>10000</u>	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF <input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input checked="" type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED <input type="checkbox"/> NA
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO			
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO <input type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>28-01-2019</u>		<u>28-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO 8 PLUS</u> Quantity <u>200ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>KANBARI</u>			Signature: <u>[Signature]</u>		



Date of Cleaning: 28-01-2019

PHOTOGRAPHS
FRP WATER TANK (LABOUR AREA)

BEFORE


FRP WATER TANK - 18



FRP WATER TANK - 19



AFTER

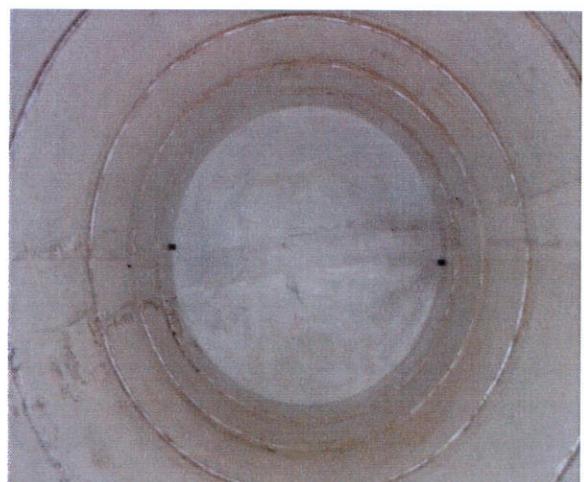



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17447

CUSTOMER: <u>TARGET CNC</u>			CONTACT PERSON: <u>MR. KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR CAMP</u> <u>ROWAIS</u>			CONTACT NO: <u>056-5336647</u>		
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND-LW-2</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL <input checked="" type="checkbox"/> RESIDENTIAL <input type="checkbox"/> OTHERS					
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>10000</u>	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF <input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input checked="" type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED <input type="checkbox"/> DAMAGED <input type="checkbox"/> NA	
LADDER IN		LADDER OUT		LEAKS	
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO <input type="checkbox"/> NA	
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>29-01-2019</u>		<u>29-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO 8 PLUS</u> Quantity <u>200ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>KANBARI</u>			Signature: <u>[Signature]</u>		



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17448


CUSTOMER: <u>TARGET GNC</u>			CONTACT PERSON: <u>MR-KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR RUWAIS - CAMP</u>			CONTACT NO: <u>056-5336647</u>		
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND-LW-4</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>10000</u>	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF <input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input checked="" type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED <input type="checkbox"/> DAMAGED <input type="checkbox"/> NA	
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO <input type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>29-01-2019</u>		<u>29-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO 8 PLUS</u> Quantity <u>200 ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>K ANSARI</u>			Signature: <u>le. A [Signature]</u>		

Date of Cleaning: 29-01-2019

PHOTOGRAPHS
FRP WATER TANK (LABOUR CAMP AREA)

BEFORE



FRP WATER TANK - 02

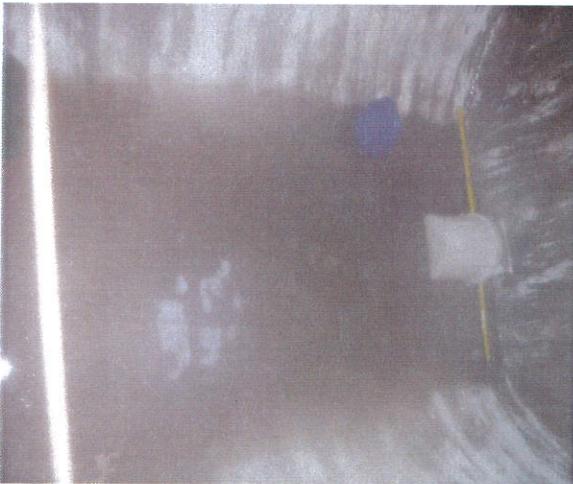

FRP WATER TANK - 04



AFTER

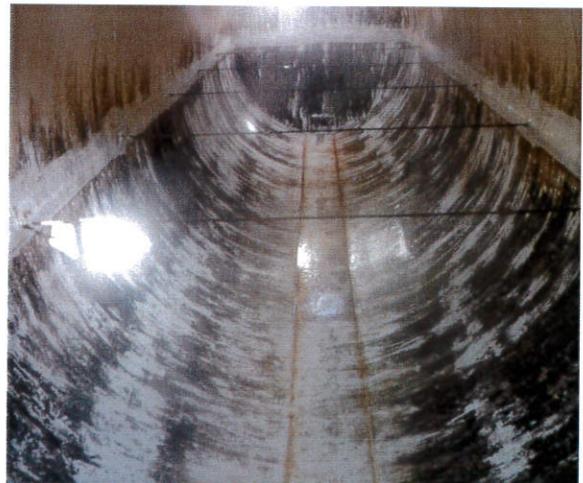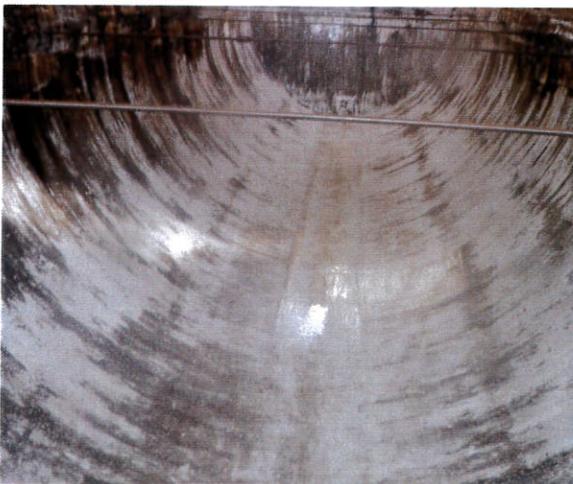



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17449

CUSTOMER: <u>TARGET QNC</u>			CONTACT PERSON: <u>MR-KHALID</u>		
SITE DETAILS: <u>TARGET HARBOUR CAMP RUWAIIS</u>			CONTACT NO: <u>056-5336647</u>		
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND-LW-5</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>10000</u>	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF <input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input checked="" type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED <input type="checkbox"/> DAMAGED <input type="checkbox"/> NA	
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO <input type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>29-01-2019</u>		<u>29-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO 8 PLUS</u> Quantity <u>200 ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input checked="" type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>K ANSARI</u>			Signature: <u>[Signature]</u>		



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17482

CUSTOMER: <u>TARGET CNC</u>		CONTACT PERSON: <u>MR. KHALID</u>	
SITE DETAILS: <u>TARGET LABOUR CAMP RUWAIS</u>		CONTACT NO: <u>086-5336647</u>	
TANK DETAILS: <u>SINTEX TANK</u>		LOCATION DETAILS: <u>GROUND LW-6</u>	
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL	
TYPE OF TANK			
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED
<input type="checkbox"/> CONCRETE COATED	<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS	<input type="checkbox"/> STEEL PANEL
<input type="checkbox"/> PLASTIC			
SIZE OF TANK		QUANTITY OF WATER	
M3	<u>10000</u> USG	L*B*H	<input checked="" type="checkbox"/> FULL
		<input type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING		CONDITION OF WATER TANK AFTER CLEANING	
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> DIRTY
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input checked="" type="checkbox"/> RUST	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS
<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> MOULDS
<input type="checkbox"/> ACCESS	<input type="checkbox"/> MANHOLE	<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> LADDER IN	<input type="checkbox"/> LADDER OUT	<input type="checkbox"/> LEAKS	<input type="checkbox"/> NA
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
<input type="checkbox"/> DRAIN LINE	<input type="checkbox"/> VALVES	<input type="checkbox"/> FLOAT VALVE	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO
PIPES DISINFECTED			
<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE	
		<u>29-01-2019</u>	
NEXT CLEANING DATE			
		<u>29-07-2019</u>	
CHEMICALS & EQUIPMENTS USED			
1. <u>CARECO BIO 8 PLUS</u> Quantity <u>200ML</u>			
2. _____ Quantity _____			
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder			
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials			
COMMENTS & RECOMMENDATIONS:			
Crystalline Representative: <u>K ANSARI</u>		Signature: <u>KANSARI</u>	




CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 29-01-2019

PHOTOGRAPHS
FRP WATER TANK (LABOUR CAMP AREA)

BEFORE

FRP WATER TANK - 05

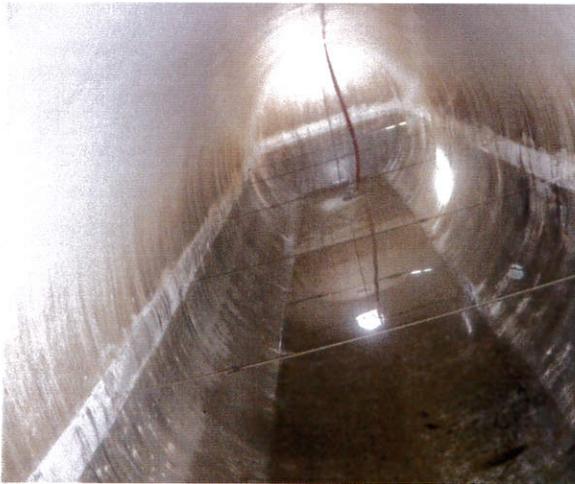

FRP WATER TANK - 06



AFTER



CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17446

CUSTOMER: <u>TARGET PWC</u>			CONTACT PERSON: <u>MR-KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR CAMP</u> <u>RUWAIS</u>			CONTACT NO: <u>056-5336647</u>		
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND-LW-15</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>10000</u>	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF
			<input type="checkbox"/> EMPTY		
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input checked="" type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	
				<input type="checkbox"/> DAMAGED	
				<input type="checkbox"/> NA	
LADDER IN		LADDER OUT		LEAKS	
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO <input type="checkbox"/> NA	
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>29-01-2019</u>		<u>29-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO 8 PLUS</u> Quantity <u>200 ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>KANSARI</u>			Signature: <u>[Signature]</u>		



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17445

CUSTOMER: <u>TARGET PNC</u>			CONTACT PERSON: <u>MR-KHALID</u>		
SITE DETAILS: <u>TARGET LABOUR CAMP</u> <u>RUWAIS</u>			CONTACT NO: <u>056-5336647</u>		
TANK DETAILS: <u>SINTEX TANK</u>			LOCATION DETAILS: <u>GROUND-LW-17</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL <input checked="" type="checkbox"/> RESIDENTIAL <input type="checkbox"/> OTHERS					
TYPE OF TANK					
<input type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input checked="" type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	<u>10000</u>	USG	L*B*H	<input checked="" type="checkbox"/> FULL	<input type="checkbox"/> HALF <input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input checked="" type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED <input type="checkbox"/> NA
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO			
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO <input type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>29-01-2019</u>		<u>29-07-2019</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARECO BIO S Plus</u> Quantity <u>200 ML</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
Crystalline Representative: <u>K. ANSARI</u>			Signature: <u>K. Ansari</u>		



CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 29-01-2019

PHOTOGRAPHS
FRP WATER TANK (LABOUR CAMP AREA)

BEFORE

FRP WATER TANK - 17



FRP WATER TANK - 15



AFTER



CLEANER WATER GREENER TOMORROW

CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

CLEANING & DISINFECTION CERTIFICATE

POTABLE WATER TANKS

CLIENT NAME : TARGET ENGINEERING CONSTRUCTION CO.
CLIENT ADDRESS : P.O. BOX: 960, ABU DHABI, UAE.
CONTACT PERSON : MR. KHALID USMAN.
SITE DETAILS : GNC CAMP, RUWAIS, GHAYTHI,
ABU DHABI, UAE.
DETAILS : WATER TANK CLEANING
DATE OF CLEANING : JANUARY 2019
FREQUENCY OF CLEANING : EVERY SIX MONTHS
DATE OF NEXT CLEANING : JULY 2019

The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.

The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES