

WATER TANK CLEANING  
&  
DISINFECTION  
COMPLETION REPORT

FOR



Client : DEERFIELDS TOWN SQUARE.  
Contact Person: Mr. Benjamin Panis  
FM Supervisor  
Site Details : Deerfields Mall, Shahama,  
Abu Dhabi, UAE.  
Date : 13 January 2019



CRYSTALLINE  
ENVIRONMENTAL SERVICES

CRYSTALLINE ENVIRONMENTAL  
SERVICES

P.O. BOX 131463, Abu Dhabi, U.A.E.

TEL: 02 6508930 FAX: 02 6508942

[info@crystalline-uae.com](mailto:info@crystalline-uae.com)

[www.crystalline-uae.com](http://www.crystalline-uae.com)





# CRYSTALLINE ENVIRONMENTAL SERVICES

## WATER TANK - AFTER SERVICE REPORT


17402

CUSTOMER: <i>Al Shirawi F/M</i>			CONTACT PERSON:		
SITE DETAILS: <i>Al Shaha, Abu Dhabi</i>			CONTACT NO:		
TANK DETAILS: <i>R.C.C Fire Domestic Water Tank</i>			LOCATION DETAILS: <i>Basement</i>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
<b>TYPE OF TANK</b>					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
<b>SIZE OF TANK</b>			<b>QUANTITY OF WATER</b>		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
<b>CONDITION OF WATER TANK BEFORE CLEANING</b>			<b>CONDITION OF WATER TANK AFTER CLEANING</b>		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input checked="" type="checkbox"/> VERY DIRTY	<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
<b>ACCESS</b>		<b>MANHOLE</b>		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA					
<b>LADDER IN</b>	<b>LADDER OUT</b>	<b>LEAKS</b>	<b>DRAIN LINE</b>	<b>VALVES</b>	<b>FLOAT VALVE</b>
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
<b>TANK CLEANED</b>		<b>TANK DISINFECTED</b>		<b>PIPES DISINFECTED</b>	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input type="checkbox"/> NA
<b>LAST CLEANING DATE</b>		<b>CURRENT CLEANING DATE</b>		<b>NEXT CLEANING DATE</b>	
		<i>02/01/2019</i>		<i>02/07/2019</i>	
<b>CHEMICALS &amp; EQUIPMENTS USED</b>					
1. <i>Carb bio and plus</i> Quantity <i>250ml</i>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel   Pump <input checked="" type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
<b>COMMENTS &amp; RECOMMENDATIONS:</b>					
<i>Mentioned water tank is cleaned and disinfected</i>					
Crystalline Representative: <i>Mansour</i>			Signature: <i>Mansour</i>		



Date of Cleaning: 02-01-2019

**PHOTOGRAPHS**  
**BASEMENT LEVEL FIRE DOMESTIC RCC WATER TANK**

**BEFORE**

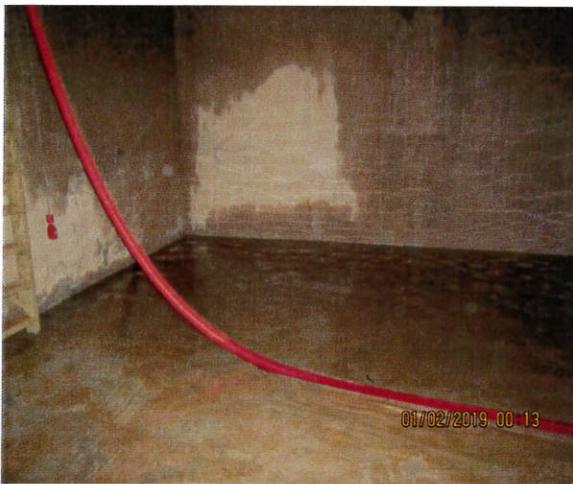

**AFTER**

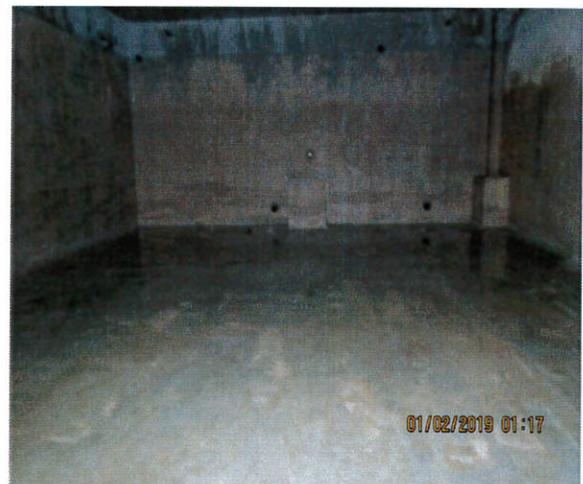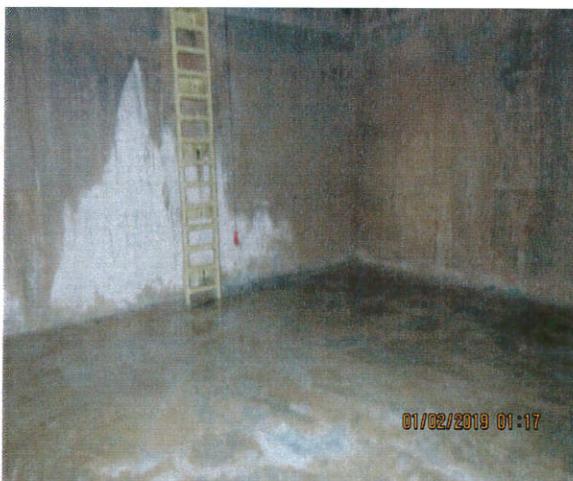



# CRYSTALLINE ENVIRONMENTAL SERVICES

## WATER TANK - AFTER SERVICE REPORT

17403

CUSTOMER: <i>Al Shraaie F/M</i>			CONTACT PERSON:		
SITE DETAILS: <i>Al Shahama, Abu Dhabi</i>			CONTACT NO:		
TANK DETAILS: <i>Filtered Domestic R.C.C. with Filter</i>			LOCATION DETAILS: <i>Basement</i>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
<b>TYPE OF TANK</b>					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
<b>SIZE OF TANK</b>			<b>QUANTITY OF WATER</b>		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
<b>CONDITION OF WATER TANK BEFORE CLEANING</b>			<b>CONDITION OF WATER TANK AFTER CLEANING</b>		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input checked="" type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
<b>ACCESS</b>		<b>MANHOLE</b>		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED <input type="checkbox"/> NA
<b>LADDER IN</b>	<b>LADDER OUT</b>	<b>LEAKS</b>		<b>DRAIN LINE</b>	<b>VALVES</b>
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
<b>TANK CLEANED</b>		<b>TANK DISINFECTED</b>		<b>PIPES DISINFECTED</b>	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> NA	
<b>LAST CLEANING DATE</b>		<b>CURRENT CLEANING DATE</b>		<b>NEXT CLEANING DATE</b>	
		<i>12/01/2019</i>		<i>02/07/2019</i>	
<b>CHEMICALS &amp; EQUIPMENTS USED</b>					
1. <i>Carbo bio and plus</i> Quantity <i>250ml</i>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel   Pump <input checked="" type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
<b>COMMENTS &amp; RECOMMENDATIONS:</b>					
<i>mentioned water tank is cleaned and disinfected</i>					
Crystalline Representative: <i>Mansour</i>			Signature: <i>Mansour</i>		



**CRYSTALLINE**  
ENVIRONMENTAL SERVICES


Date of Cleaning: 02-01-2019

**PHOTOGRAPHS**  
**FILTERED DOMESTIC RCC WATER TANK - 01**

**BEFORE**



**AFTER**

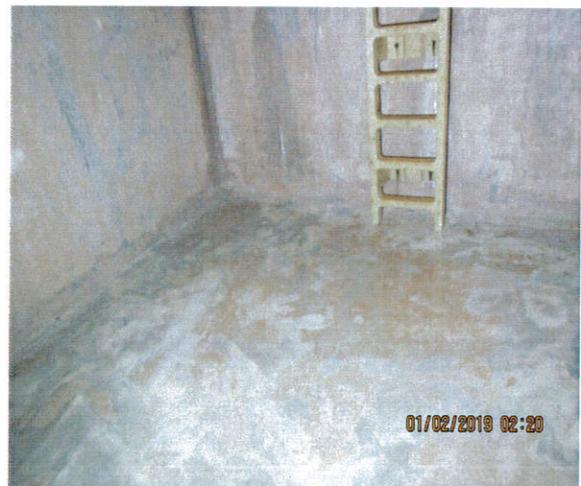

**CLEANER WATER GREENER TOMORROW**



# CRYSTALLINE ENVIRONMENTAL SERVICES

## WATER TANK - AFTER SERVICE REPORT

17413


CUSTOMER: <i>Al Shirawi F/M</i>			CONTACT PERSON:		
SITE DETAILS: <i>Deerfield Mall, Alrudhah, Al Shabaha</i>			CONTACT NO:		
TANK DETAILS: <i>P.C.C Domestic water tank</i>			LOCATION DETAILS: <i>Basement</i>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
<b>TYPE OF TANK</b>					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
<b>SIZE OF TANK</b>			<b>QUANTITY OF WATER</b>		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
<b>CONDITION OF WATER TANK BEFORE CLEANING</b>			<b>CONDITION OF WATER TANK AFTER CLEANING</b>		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input checked="" type="checkbox"/> VERY DIRTY	<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
<b>ACCESS</b>		<b>MANHOLE</b>		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED <input type="checkbox"/> NA
<b>LADDER IN</b>	<b>LADDER OUT</b>	<b>LEAKS</b>	<b>DRAIN LINE</b>	<b>VALVES</b>	<b>FLOAT VALVE</b>
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
<b>TANK CLEANED</b>		<b>TANK DISINFECTED</b>		<b>PIPES DISINFECTED</b>	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input type="checkbox"/> NA
<b>LAST CLEANING DATE</b>		<b>CURRENT CLEANING DATE</b>		<b>NEXT CLEANING DATE</b>	
		<i>02/01/2019</i>		<i>02/02/2019</i>	
<b>CHEMICALS &amp; EQUIPMENTS USED</b>					
1. <i>Carolo bio and plus</i> Quantity <i>250ml</i>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel   Pump <input type="checkbox"/> High /Low Pressure jet <input type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder					
<input type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
<b>COMMENTS &amp; RECOMMENDATIONS:</b>					
<i>mentioned water tank is cleaned and disinfected</i>					
Crystalline Representative: <i>Mansour</i>			Signature: <i>Mansour</i>		

*Mansour*

Date of Cleaning: 02-01-2019

**PHOTOGRAPHS**  
**BASEMENT LEVEL DOMESTIC RCC WATER TANK- 01**

**BEFORE**

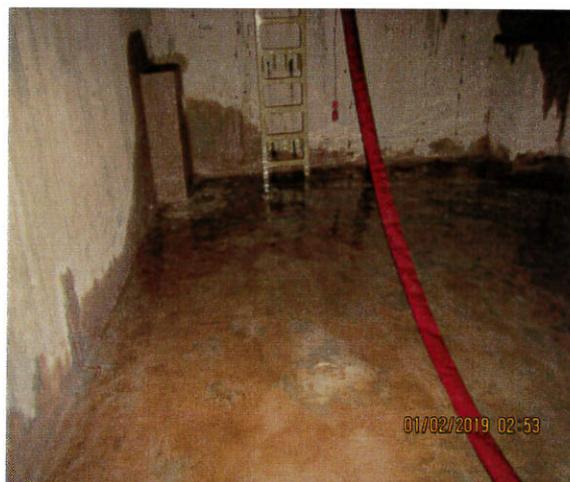

**AFTER**





# CRYSTALLINE ENVIRONMENTAL SERVICES

## WATER TANK - AFTER SERVICE REPORT

17404

CUSTOMER: <i>Al Ibrahim F/M</i>			CONTACT PERSON:		
SITE DETAILS: <i>Al Shahama, Abu Dhabi</i>			CONTACT NO:		
TANK DETAILS: <i>K.C.C Domestic w. tank</i>			LOCATION DETAILS: <i>Basement</i>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
<b>TYPE OF TANK</b>					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
<b>SIZE OF TANK</b>			<b>QUANTITY OF WATER</b>		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
<b>CONDITION OF WATER TANK BEFORE CLEANING</b>			<b>CONDITION OF WATER TANK AFTER CLEANING</b>		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input checked="" type="checkbox"/> VERY DIRTY	<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
<b>ACCESS</b>		<b>MANHOLE</b>		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA					
<b>LADDER IN</b>		<b>LADDER OUT</b>		<b>LEAKS</b>	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<b>DRAIN LINE</b>	
<b>TANK CLEANED</b>		<b>TANK DISINFECTED</b>		<b>VALVES</b>	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
<b>TANK DISINFECTED</b>		<b>PIPES DISINFECTED</b>		<b>FLOAT VALVE</b>	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
<b>LAST CLEANING DATE</b>		<b>CURRENT CLEANING DATE</b>		<b>NEXT CLEANING DATE</b>	
		<i>02/01/2019</i>		<i>02/07/2019</i>	
<b>CHEMICALS &amp; EQUIPMENTS USED</b>					
1. <i>Carbo bio anal plus</i> Quantity <i>250ml</i>					
2. _____ Quantity _____					
<input type="checkbox"/> Submersibel   Pump <input type="checkbox"/> High /Low Pressure jet <input type="checkbox"/> Extension Cords <input type="checkbox"/> TED Lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input type="checkbox"/> Ventilating Fan <input type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
<b>COMMENTS &amp; RECOMMENDATIONS:</b>					
<i>mentioned water tank is cleaned and disinfected</i>					
Crystalline Representative: <i>Mary</i>			Signature: <i>Mgoheer</i>		

*K. Alkhatib*  
*14.10.19*



**CRYSTALLINE**  
ENVIRONMENTAL SERVICES


Date of Cleaning: 02-01-2019

**PHOTOGRAPHS**  
**BASEMENT LEVEL DOMESTIC WATER TANK -02**

**BEFORE**



**AFTER**

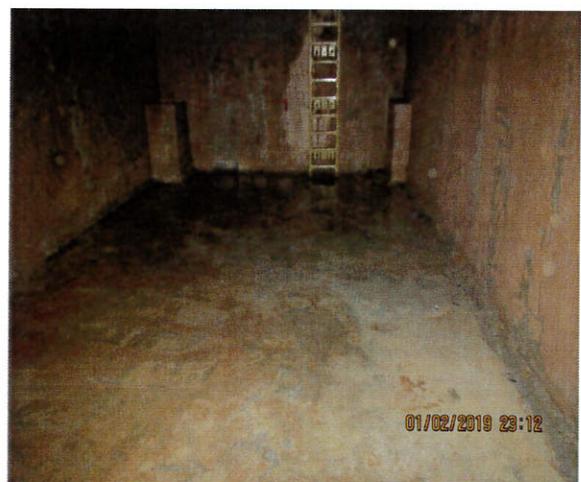

**CLEANER WATER GREENER TOMORROW**



# CRYSTALLINE ENVIRONMENTAL SERVICES

## WATER TANK - AFTER SERVICE REPORT

17405

CUSTOMER: <i>Al Shurawi F/M</i>			CONTACT PERSON:		
SITE DETAILS: <i>Al Shakhama, Abu Dhabi</i>			CONTACT NO:		
TANK DETAILS: <i>Cooling tower Make up tank</i>			LOCATION DETAILS: <i>Basement</i>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
<b>TYPE OF TANK</b>					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
<b>SIZE OF TANK</b>			<b>QUANTITY OF WATER</b>		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
<b>CONDITION OF WATER TANK BEFORE CLEANING</b>			<b>CONDITION OF WATER TANK AFTER CLEANING</b>		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input checked="" type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
<b>ACCESS</b>		<b>MANHOLE</b>		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA					
<b>LADDER IN</b>	<b>LADDER OUT</b>	<b>LEAKS</b>	<b>DRAIN LINE</b>	<b>VALVES</b>	<b>FLOAT VALVE</b>
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
<b>TANK CLEANED</b>		<b>TANK DISINFECTED</b>		<b>PIPES DISINFECTED</b>	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
<b>LAST CLEANING DATE</b>		<b>CURRENT CLEANING DATE</b>		<b>NEXT CLEANING DATE</b>	
		<i>03/01/2019</i>		<i>03/07/2019</i>	
<b>CHEMICALS &amp; EQUIPMENTS USED</b>					
1. <i>Carbo bio and plus</i> Quantity <i>250ml</i>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel   Pump <input checked="" type="checkbox"/> High /Low Pressure jet <input type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input checked="" type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
<b>COMMENTS &amp; RECOMMENDATIONS:</b>					
<i>mentioned water tank is cleaned and disinfected</i>					
Crystalline Representative: <i>Mansour</i>			Signature: <i>Mansour</i>		

*U. Alkayoum*  
*le. with*



**CRYSTALLINE**  
ENVIRONMENTAL SERVICES

Date of Cleaning: 03-01-2019


## PHOTOGRAPHS

**BASEMENT LEVEL COOLING TOWER MAKE UP RCC WATER TANK - 01**

### BEFORE



### AFTER

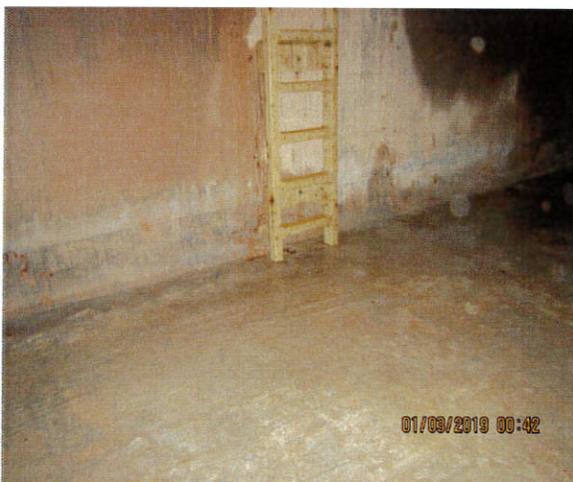

**CLEANER WATER GREENER TOMORROW**



# CRYSTALLINE ENVIRONMENTAL SERVICES

## WATER TANK - AFTER SERVICE REPORT

17409


CUSTOMER: <i>Al Shirawi F/M</i>			CONTACT PERSON:		
SITE DETAILS: <i>Al Shahama, Abu Dhabi</i>			CONTACT NO:		
TANK DETAILS: <i>Filtered Domestic W. Tank</i>			LOCATION DETAILS: <i>Basement</i>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
<b>TYPE OF TANK</b>					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
<b>SIZE OF TANK</b>			<b>QUANTITY OF WATER</b>		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
<b>CONDITION OF WATER TANK BEFORE CLEANING</b>			<b>CONDITION OF WATER TANK AFTER CLEANING</b>		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input checked="" type="checkbox"/> VERY DIRTY	<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
<b>ACCESS</b>		<b>MANHOLE</b>		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA					<input type="checkbox"/> NA
<b>LADDER IN</b>		<b>LADDER OUT</b>		<b>LEAKS</b>	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO
<b>DRAIN LINE</b>		<b>VALVES</b>		<b>FLOAT VALVE</b>	
<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO
<b>TANK CLEANED</b>		<b>TANK DISINFECTED</b>		<b>PIPES DISINFECTED</b>	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO
<b>LAST CLEANING DATE</b>		<b>CURRENT CLEANING DATE</b>		<b>NEXT CLEANING DATE</b>	
		<i>04/01/2019</i>		<i>04/07/2019</i>	
<b>CHEMICALS &amp; EQUIPMENTS USED</b>					
1. <i>Carb bio and plus</i> Quantity <i>250ml</i>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel   Pump <input checked="" type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
<b>COMMENTS &amp; RECOMMENDATIONS:</b>					
<i>mentioned water tank is cleaned and disinfected</i>					
Crystalline Representative: <i>Mansur</i>			Signature: <i>Mansur</i>		

*Handwritten signatures and notes at the bottom of the page.*



Date of Cleaning: 04-01-2019

**PHOTOGRAPHS**  
**BASEMENT LEVEL RCC FILTERED DOMESTIC WATER TANK - 02**

**BEFORE**

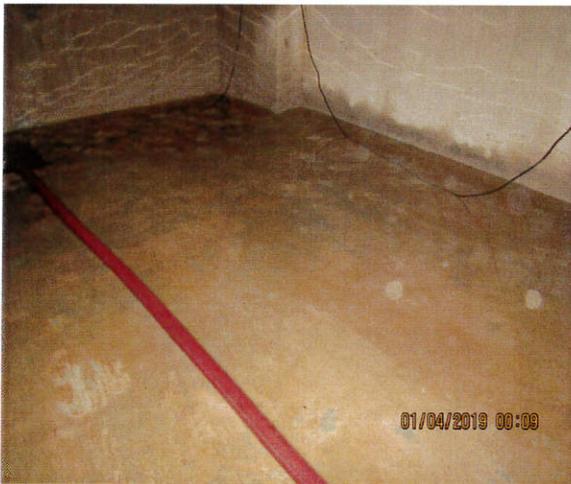

**AFTER**

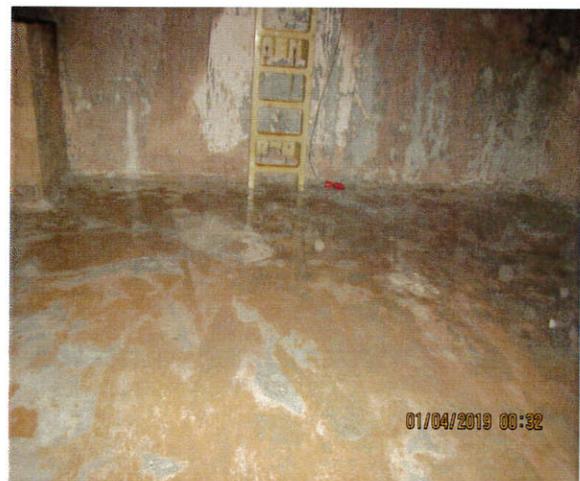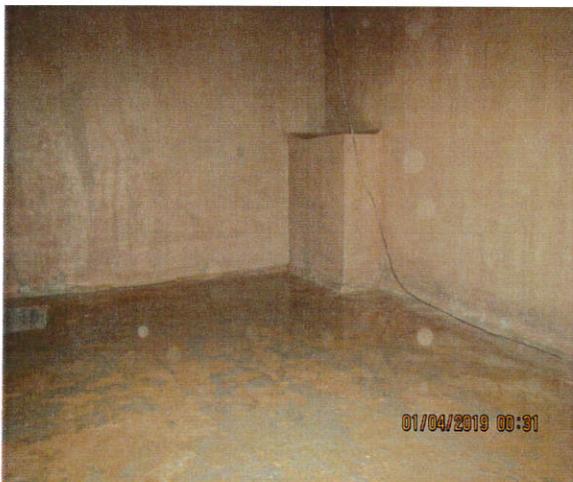



# CRYSTALLINE ENVIRONMENTAL SERVICES

## WATER TANK - AFTER SERVICE REPORT

17410


CUSTOMER: <u>Al Shirazi F/M</u>			CONTACT PERSON:		
SITE DETAILS: <u>Al Shahama, Abudhabi</u>			CONTACT NO:		
TANK DETAILS: <u>Coding Tower Make-up Tank-2</u>			LOCATION DETAILS: <u>Basement</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
<b>TYPE OF TANK</b>					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
<b>SIZE OF TANK</b>			<b>QUANTITY OF WATER</b>		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
<b>CONDITION OF WATER TANK BEFORE CLEANING</b>			<b>CONDITION OF WATER TANK AFTER CLEANING</b>		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input checked="" type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
<b>ACCESS</b>		<b>MANHOLE</b>		<input checked="" type="checkbox"/> COVERED	
<input type="checkbox"/> DAMAGED		<input type="checkbox"/> DAMAGED		<input type="checkbox"/> NA	
<b>LADDER IN</b>		<b>LADDER OUT</b>		<b>LEAKS</b>	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	
<b>TANK CLEANED</b>		<b>TANK DISINFECTED</b>		<b>PIPES DISINFECTED</b>	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO <input checked="" type="checkbox"/> NA	
<b>LAST CLEANING DATE</b>		<b>CURRENT CLEANING DATE</b>		<b>NEXT CLEANING DATE</b>	
		<u>04/01/2019</u>		<u>04/07/2019</u>	
<b>CHEMICALS &amp; EQUIPMENTS USED</b>					
1. <u>Corobio and plus</u> Quantity <u>250ml</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel   Pump <input type="checkbox"/> High /Low Pressure jet <input type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
<b>COMMENTS &amp; RECOMMENDATIONS:</b>					
<u>Mentioned water tank is cleaned and disinfected</u>					
Crystalline Representative: <u>Manoj</u>			Signature: <u>Manoj</u>		

Date of Cleaning: 04-01-2019



## PHOTOGRAPHS

**BASEMENT LEVEL RCC COOLING TOWER MAKEUP WATER TANK - 02**

**BEFORE**

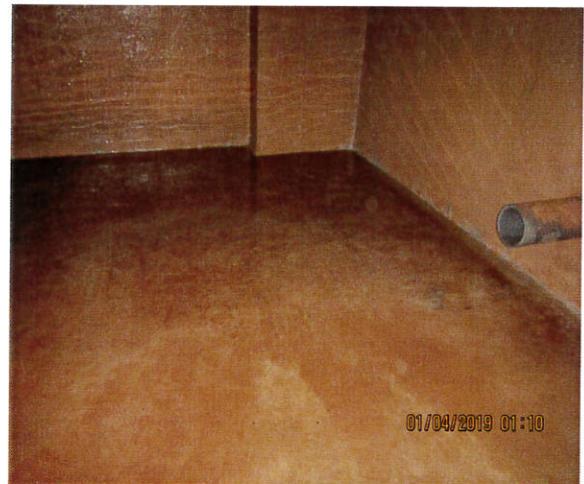

**AFTER**

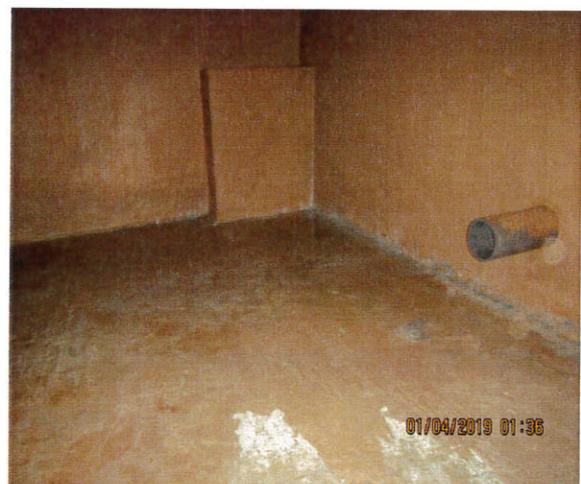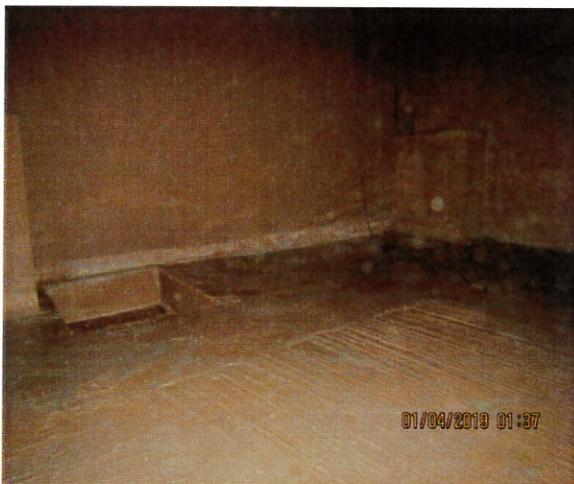



# CRYSTALLINE ENVIRONMENTAL SERVICES

## WATER TANK - AFTER SERVICE REPORT

17411

CUSTOMER: <i>Al Shiraawi F/M</i>			CONTACT PERSON:		
SITE DETAILS: <i>Al Shahama, Abu Dhabi</i>			CONTACT NO:		
TANK DETAILS: <i>Filtered Grey water tank</i>			LOCATION DETAILS: <i>Basement</i>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL <input type="checkbox"/> RESIDENTIAL <input type="checkbox"/> OTHERS					
<b>TYPE OF TANK</b>					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED	<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS			
<b>SIZE OF TANK</b>			<b>QUANTITY OF WATER</b>		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
<b>CONDITION OF WATER TANK BEFORE CLEANING</b>			<b>CONDITION OF WATER TANK AFTER CLEANING</b>		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input checked="" type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
<b>ACCESS</b>		<b>MANHOLE</b>		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED <input type="checkbox"/> NA
<b>LADDER IN</b>	<b>LADDER OUT</b>	<b>LEAKS</b>	<b>DRAIN LINE</b>	<b>VALVES</b>	<b>FLOAT VALVE</b>
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
<b>TANK CLEANED</b>		<b>TANK DISINFECTED</b>		<b>PIPES DISINFECTED</b>	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
<b>LAST CLEANING DATE</b>		<b>CURRENT CLEANING DATE</b>		<b>NEXT CLEANING DATE</b>	
		<i>06/01/2018</i>		<i>06/07/2019</i>	
<b>CHEMICALS &amp; EQUIPMENTS USED</b>					
1. <i>Carbo bio and plus</i> Quantity <i>500ml</i>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel   Pump <input type="checkbox"/> High /Low Pressure jet <input type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input type="checkbox"/> Ventilating Fan <input type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Mater <input checked="" type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
<b>COMMENTS &amp; RECOMMENDATIONS:</b>					
<i>Mentioned water tank is cleaned and disinfected</i>					
Crystalline Representative: <i>Mansour</i>			Signature: <i>Mansour</i>		


Date of Cleaning: 06-01-2019

**PHOTOGRAPHS**  
**BASEMENT LEVEL RCC FILTERED GREY WATER TANK - 02**

**BEFORE**



**AFTER**

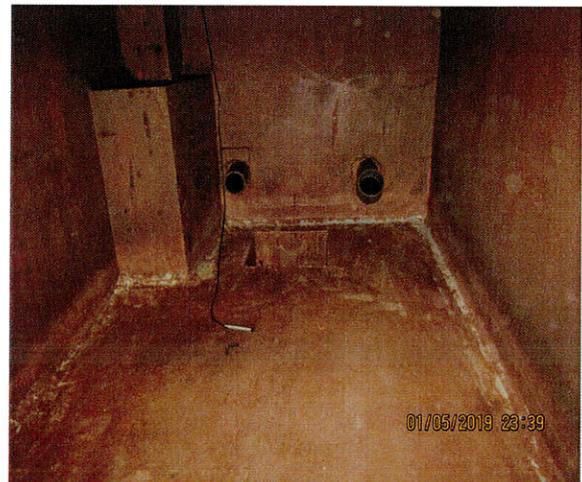



# CRYSTALLINE ENVIRONMENTAL SERVICES

## WATER TANK - AFTER SERVICE REPORT

17412



CUSTOMER: <i>Al Shirawi F/M</i>			CONTACT PERSON:		
SITE DETAILS: <i>Deerfield Mall, Al Shaha</i> <i>Abu Dhabi</i>			CONTACT NO:		
TANK DETAILS: <i>Five, Domestic water tanks</i>			LOCATION DETAILS: <i>Basement</i>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
<b>TYPE OF TANK</b>					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
<b>SIZE OF TANK</b>			<b>QUANTITY OF WATER</b>		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
<b>CONDITION OF WATER TANK BEFORE CLEANING</b>			<b>CONDITION OF WATER TANK AFTER CLEANING</b>		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input checked="" type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
<b>ACCESS</b>		<b>MANHOLE</b>		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA					<input type="checkbox"/> NA
<b>LADDER IN</b>	<b>LADDER OUT</b>	<b>LEAKS</b>	<b>DRAIN LINE</b>	<b>VALVES</b>	<b>FLOAT VALVE</b>
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
<b>TANK CLEANED</b>		<b>TANK DISINFECTED</b>		<b>PIPES DISINFECTED</b>	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
<b>LAST CLEANING DATE</b>		<b>CURRENT CLEANING DATE</b>		<b>NEXT CLEANING DATE</b>	
		<i>06/01/2019</i>		<i>06/07/2019</i>	
<b>CHEMICALS &amp; EQUIPMENTS USED</b>					
1. <i>Carbo bio and plus</i> Quantity <i>250ml</i>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel   Pump <input checked="" type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input type="checkbox"/> Ventilating Fan <input type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
<b>COMMENTS &amp; RECOMMENDATIONS:</b>					
<i>Mentioned water tank is cleaned and disinfected</i>					
Crystalline Representative: <i>Manoj</i>			Signature: <i>Nguyen</i>		

*11. Alsharawi  
Le. Alsharawi*



Date of Cleaning: 06-01-2019

**PHOTOGRAPHS**  
**BASEMENT LEVEL FIRE DOMESTIC WATER TANK -02**

**BEFORE**

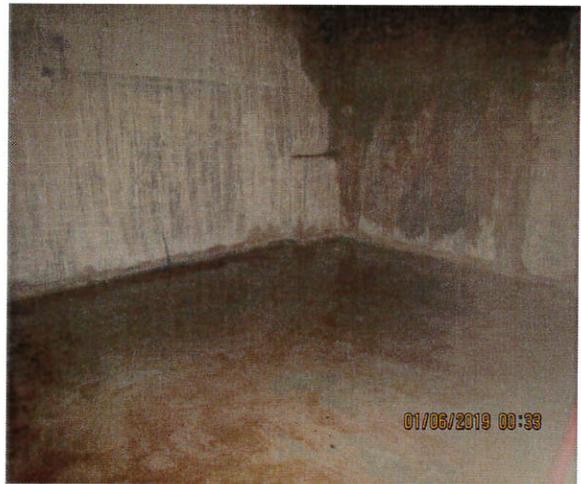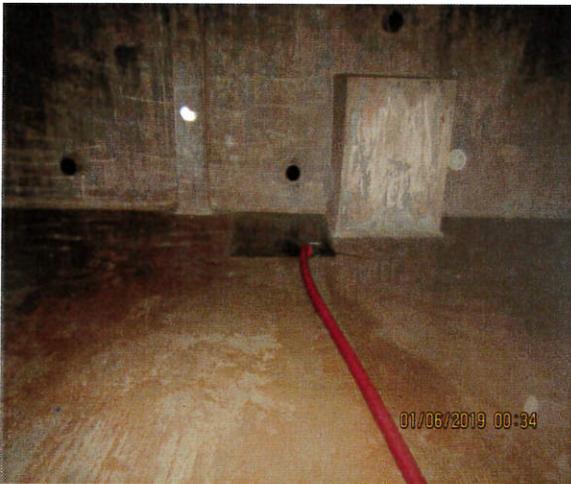

**AFTER**

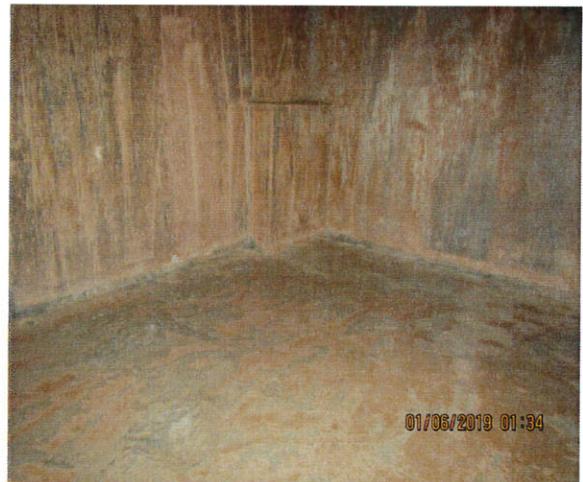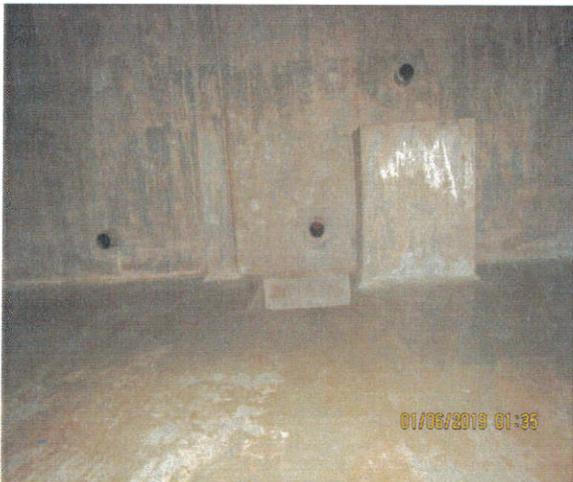





**CRYSTALLINE**  
ENVIRONMENTAL SERVICES

Date of Cleaning: 06-01-2019

**PHOTOGRAPHS**  
**BASEMENT LEVEL FILTERED GREY WATER TANK -02**

**BEFORE**



**AFTER**



**CLEANER WATER GREENER TOMORROW**



# CRYSTALLINE ENVIRONMENTAL SERVICES

## WATER TANK - AFTER SERVICE REPORT

17415

CUSTOMER: <i>Al Shiraawi F/H</i>			CONTACT PERSON:		
SITE DETAILS: <i>Deerfield, Abu Dhabi</i>			CONTACT NO:		
TANK DETAILS: <i>Corey P.C.C. water tank</i>			LOCATION DETAILS: <i>Room</i>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL <input type="checkbox"/> RESIDENTIAL <input type="checkbox"/> OTHERS					
<b>TYPE OF TANK</b>					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED	<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS			
<b>SIZE OF TANK</b>			<b>QUANTITY OF WATER</b>		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
<b>CONDITION OF WATER TANK BEFORE CLEANING</b>			<b>CONDITION OF WATER TANK AFTER CLEANING</b>		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input checked="" type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
<b>ACCESS</b>		<b>MANHOLE</b>	<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED	<input type="checkbox"/> NA
<b>LADDER IN</b>	<b>LADDER OUT</b>	<b>LEAKS</b>	<b>DRAIN LINE</b>	<b>VALVES</b>	<b>FLOAT VALVE</b>
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
<b>TANK CLEANED</b>		<b>TANK DISINFECTED</b>		<b>PIPES DISINFECTED</b>	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
<b>LAST CLEANING DATE</b>		<b>CURRENT CLEANING DATE</b>		<b>NEXT CLEANING DATE</b>	
		<i>06/01/2018</i>		<i>06/07/2019</i>	
<b>CHEMICALS &amp; EQUIPMENTS USED</b>					
1. <i>Carbolic acid plus</i> Quantity <i>250ml</i>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersible Pump <input checked="" type="checkbox"/> High/Low Pressure jet <input type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Meter <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
<b>COMMENTS &amp; RECOMMENDATIONS:</b>					
<i>mentioned water tank is cleaned and disinfected</i>					
Crystalline Representative: <i>Mansour</i>			Signature: <i>Mansour</i>		

*Mansour*  
*Le m... →*



**CRYSTALLINE**  
ENVIRONMENTAL SERVICES


Date of Cleaning: 06-01-2019

**PHOTOGRAPHS**  
**BASEMENT LEVEL RCC GREY WATER TANK**

**BEFORE**



**AFTER**

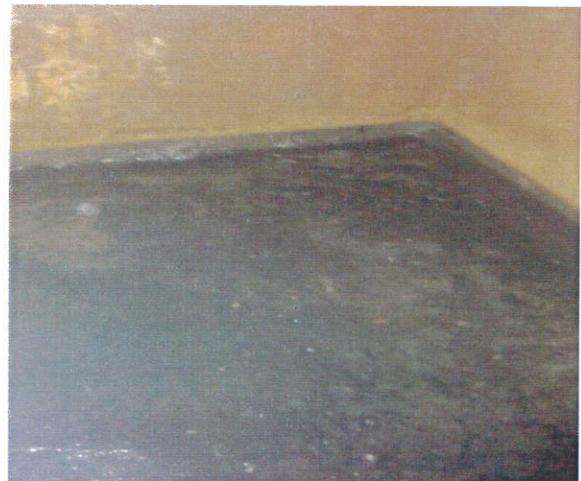

**CLEANER WATER GREENER TOMORROW**



# CRYSTALLINE ENVIRONMENTAL SERVICES

## WATER TANK - AFTER SERVICE REPORT

17416


CUSTOMER: <i>Al Shirqawi F/m</i>			CONTACT PERSON:		
SITE DETAILS: <i>Deerfield Mall Abu Dhabi</i>			CONTACT NO:		
TANK DETAILS: <i>Raw water R.C.C tank</i>			LOCATION DETAILS: <i>Basement</i>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
<b>TYPE OF TANK</b>					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
<b>SIZE OF TANK</b>			<b>QUANTITY OF WATER</b>		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
<b>CONDITION OF WATER TANK BEFORE CLEANING</b>			<b>CONDITION OF WATER TANK AFTER CLEANING</b>		
<input type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input checked="" type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
<b>ACCESS</b>		<b>MANHOLE</b>		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA					<input type="checkbox"/> NA
<b>LADDER IN</b>	<b>LADDER OUT</b>	<b>LEAKS</b>	<b>DRAIN LINE</b>	<b>VALVES</b>	<b>FLOAT VALVE</b>
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
<b>TANK CLEANED</b>		<b>TANK DISINFECTED</b>		<b>PIPES DISINFECTED</b>	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input type="checkbox"/> NA
<b>LAST CLEANING DATE</b>		<b>CURRENT CLEANING DATE</b>		<b>NEXT CLEANING DATE</b>	
		<i>08/01/2019</i>		<i>08/07/2019</i>	
<b>CHEMICALS &amp; EQUIPMENTS USED</b>					
1. <i>Carolo bio and plus</i> Quantity <i>250ml</i>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel   Pump <input checked="" type="checkbox"/> High /Low Pressure jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input checked="" type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input checked="" type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
<b>COMMENTS &amp; RECOMMENDATIONS:</b>					
<i>mentioned water tank is cleaned and disinfected</i>					
Crystalline Representative: <i>Mang</i>			Signature: <i>Mang</i>		

*1c with...*

Date of Cleaning: 08-01-2019

**PHOTOGRAPHS**  
**BASEMENT LEVEL RAW RCC GREY WATER TANK**

**BEFORE**

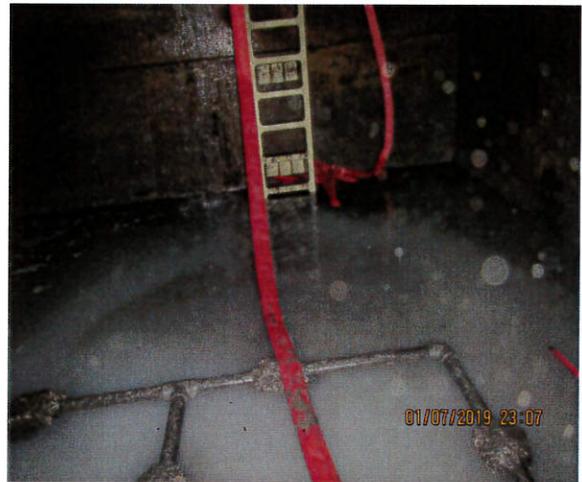

**AFTER**



# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

**CLIENT NAME** : DEERFIELDS TOWNSQUARE LLC.

**CLIENT ADDRESS** : P.O. BOX: 39996, ABU DHABI, UAE.

**CONTACT PERSON** : MR. BENJAMIN PANIS

**SITE DETAILS** : DEERFIELDS MALL, SHAHAMA, ABU DHABI.

**DETAILS** : WATER TANK CLEANING

**DATE OF CLEANING** : JANUARY 2019

**FREQUENCY OF CLEANING** : EVERY SIX MONTHS

**DATE OF NEXT CLEANING** : JULY 2019

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES