

**ENVIRONMENTAL
SERVICES FOR
A GREENER
TOMORROW...
ONE STEP AT
A TIME.**



Completion Report for
Water Tank Cleaning & Disinfection

Date: **27 August 2019**
Client Name: **Deerfield mall**
Contact Person: **Benjamin Panis**
Designation: **FM Supervisor**
Site Detail: **Deerfield Mall**





CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17190

CUSTOMER: <u>AL SHIRAWI FIM</u>			CONTACT PERSON: <u>MR-RANJAMIN</u>		
SITE DETAILS: <u>DEERFIELD MALL</u>			CONTACT NO: <u>0561991971</u>		
TANK DETAILS: <u>R.C.C-FILTERED DOMESTIC W-01</u>			LOCATION DETAILS: <u>BASEMENT</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED	<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS			
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE	<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED	<input type="checkbox"/> NA
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>21-08-2019</u>		<u>21-02-2020</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARELO BIO & PLUS</u> Quantity <u>500 ltr</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High/Low Pressure Jet <input type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Meter <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
COMMENTS AND RECOMMENDATION:					
<u>MENTIONED WATER TANK IS CLEANED & DISINFECTED</u>					
Crystalline representative: <u>SANKAR</u>			Signature: <u>[Signature]</u>		
Customer/Customer representative: <u>G. VIVEK</u>			Signature: <u>[Signature]</u>		

Date of Cleaning: 21-08-2019


PHOTOGRAPHS

BASEMENT LEVEL FILTERED DOMESTIC RCC WATER TANK- 01

BEFORE



AFTER

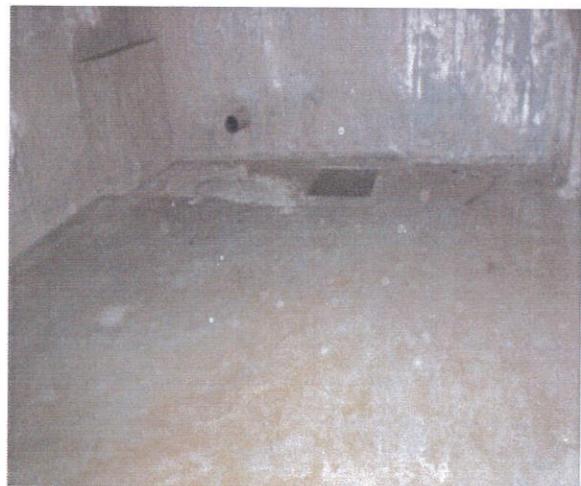

CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17191


CUSTOMER: <u>AL SHIRAWI F/M</u>			CONTACT PERSON: <u>MR-BENJAMIN</u>		
SITE DETAILS: <u>DEER FIELD MALL</u>			CONTACT NO: <u>0561991971</u>		
TANK DETAILS: <u>R-GC FIRE DOMESTIC W TANK</u>			LOCATION DETAILS: <u>BASEMENT</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA	<input type="checkbox"/> NA	<input type="checkbox"/> NA	<input type="checkbox"/> NA	<input type="checkbox"/> NA	<input type="checkbox"/> NA
LADDER IN		LADDER OUT		LEAKS	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	DRAIN LINE	
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>21-08-2019</u>		<u>21-02-2020</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARELO Bio & Plus</u> Quantity <u>500L</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input checked="" type="checkbox"/> High/Low Pressure Jet <input type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Meter <input checked="" type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
COMMENTS AND RECOMMENDATION:					
<u>MENTIONED WATER TANK IS CLEANED & DISINFECTED</u>					
Crystalline representative: <u>SANKAR</u>			Signature: <u>[Signature]</u>		
Customer/Customer representative: <u>G. VERIEK</u>			Signature: <u>[Signature]</u>		

Date of Cleaning: 21-08-2019


PHOTOGRAPHS

BASEMENT LEVEL FIRE DOMESTIC WATER TANK -02

BEFORE

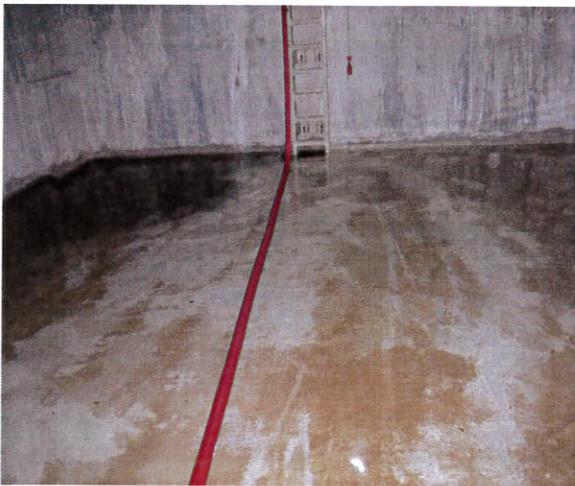

AFTER

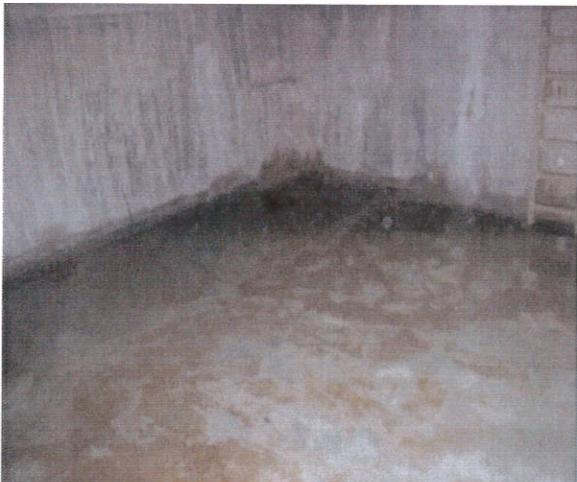



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT


17192

CUSTOMER: <u>AL SHIRAWI F/M</u>			CONTACT PERSON: <u>MR-BENJAMIN</u>		
SITE DETAILS: <u>DEER FIELD MALL</u>			CONTACT NO: <u>0561991971</u>		
TANK DETAILS: <u>R-CC DOMESTIC-W-TANK-02</u>			LOCATION DETAILS: <u>BASEMENT</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA					
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>22-08-2019</u>		<u>22-02-2020</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARELO BIO & PLUS</u> Quantity <u>500L</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input checked="" type="checkbox"/> High/Low Pressure Jet <input checked="" type="checkbox"/> Extension Cords <input type="checkbox"/> LED lights <input checked="" type="checkbox"/> Foot Bath <input checked="" type="checkbox"/> Ladder <input type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Meter <input checked="" type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS AND RECOMMENDATION:					
<u>MENTIONED WATER TANK IS CLEANED & DISINFECTED</u>					
Crystalline representative: <u>SARUKAR</u>			Signature: <u>[Signature]</u>		
Customer/Customer representative: <u>G. Y. VEK</u>			Signature: <u>[Signature]</u>		


Date of Cleaning: 22-08-2019

PHOTOGRAPHS
BASEMENT LEVEL DOMESTIC RCC WATER TANK- 02

BEFORE

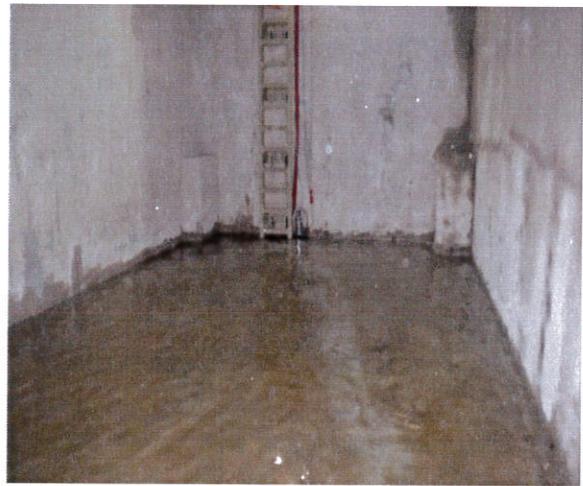

AFTER

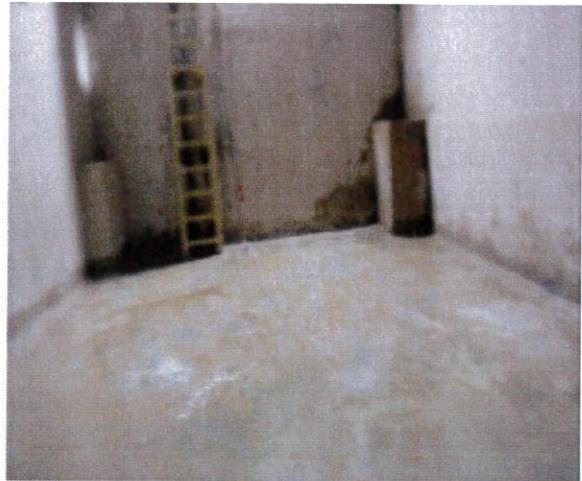

CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17193

CUSTOMER: <u>AL SHIRAWI FIM</u>			CONTACT PERSON: <u>MR-BENJAMIN</u>		
SITE DETAILS: <u>DEER FIELD MALL</u>			CONTACT NO: <u>0561991971</u>		
TANK DETAILS: <u>R.C.C COLUMN/TOWER MAKE-UP-02</u>			LOCATION DETAILS: <u>BASEMENT</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED	<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS			
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA					
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>22-02-2019</u>		<u>22-02-2020</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARELO BIO & PLUS</u> Quantity <u>500 Ltr</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input checked="" type="checkbox"/> High/Low Pressure Jet <input checked="" type="checkbox"/> Extension Cords <input type="checkbox"/> LED lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Meter <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
COMMENTS AND RECOMMENDATION:					
<u>MENTIONED WATER TANK IS CLEANED & DISINFECTED</u>					
Crystalline representative: <u>SANKAR</u>			Signature: <u>[Signature]</u>		
Customer/Customer representative: <u>G. V. V. V. V.</u>			Signature: <u>[Signature]</u>		




CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 22-08-2019

PHOTOGRAPHS

BASEMENT LEVEL RCC COOLING TOWER MAKEUP WATER TANK - 02

BEFORE

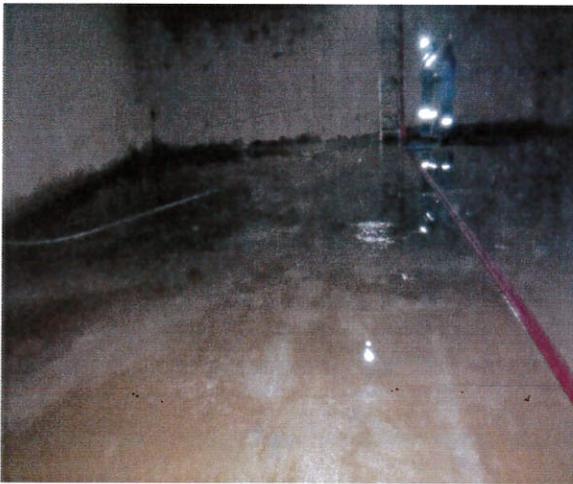

AFTER



CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT


17195

CUSTOMER: <u>AL SHIRAWI FIM</u>			CONTACT PERSON: <u>MR- BANUJAMU</u>		
SITE DETAILS: <u>DEERFIELD MALL</u>			CONTACT NO: <u>0561991971</u>		
TANK DETAILS: <u>R-GC-FIRE DOMESTIC-W-T-01</u>			LOCATION DETAILS: <u>BASEMENT</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA					
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>23-08-2019</u>		<u>23-02-2020</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARELO Bio & PLUS</u> Quantity <u>500 Bz</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input checked="" type="checkbox"/> High/Low Pressure Jet <input type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Meter <input checked="" type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
COMMENTS AND RECOMMENDATION:					
<u>MENTIONED WATER TANK IS CLEANED & DISINFECTED</u>					
Crystalline representative: <u>SANUKAR</u>			Signature: <u>[Signature]</u>		
Customer/Customer representative: <u>G. VEVEK</u>			Signature: <u>[Signature]</u>		

Date of Cleaning: 23-08-2019

PHOTOGRAPHS
BASEMENT LEVEL FIRE DOMESTIC RCC WATER TANK- 01

BEFORE

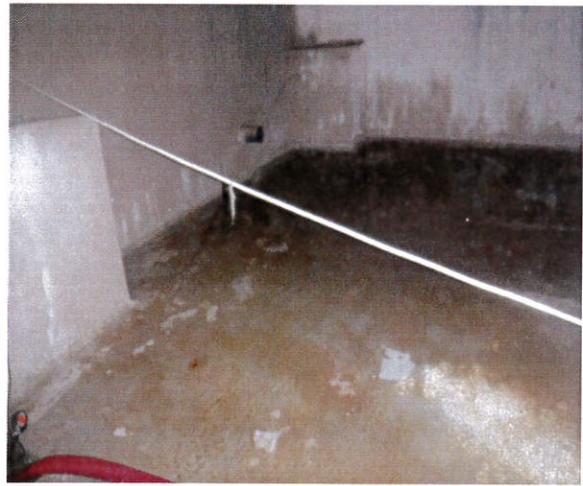

AFTER





CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17194

CUSTOMER: <u>AL SHIRAWI FIM</u>			CONTACT PERSON: <u>MR-BENJAMIN</u>		
SITE DETAILS: <u>DEERFIELD MALL</u>			CONTACT NO: <u>0561991971</u>		
TANK DETAILS: <u>R-C-C-FILTERED GREY-W-T-02</u>			LOCATION DETAILS: <u>BASEMENT</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	
<input type="checkbox"/> DAMAGED		<input type="checkbox"/> NA			
LADDER IN		LADDER OUT		LEAKS	
DRAIN LINE		VALVES		FLOAT VALVE	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>23-08-2019</u>		<u>23-02-2020</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARELO BIO & PLUS</u> Quantity <u>500 L</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High/Low Pressure Jet <input type="checkbox"/> Extension Cords <input type="checkbox"/> LED lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Meter <input checked="" type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
COMMENTS AND RECOMMENDATION:					
<u>MENTIONED WATER TANK IS CLEANED & DISINFECTED</u>					
Crystalline representative: <u>SANKAR</u>			Signature:		
Customer/Customer representative: <u>G. VZVEK</u>			Signature:		



CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 23-08-2019

PHOTOGRAPHS

BASEMENT LEVEL RCC FILTERED GREY WATER TANK - 02

BEFORE



AFTER



CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17197

CUSTOMER: <u>AL SHIRAWI FIM</u>			CONTACT PERSON: <u>MR. REIJAMIR</u>		
SITE DETAILS: <u>DEER FIELD MALL</u>			CONTACT NO: <u>0561991971</u>		
TANK DETAILS: <u>R.C.C-COOLING TOWER MAKE-UP</u>			LOCATION DETAILS: <u>BASEMENT</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL <input type="checkbox"/> RESIDENTIAL <input type="checkbox"/> OTHERS					
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED	<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS			
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE	<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED	<input type="checkbox"/> NA
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>24-08-2019</u>		<u>24-02-2020</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARELO Bio & PLUS</u> Quantity <u>500 ltr</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High/Low Pressure Jet <input type="checkbox"/> Extension Cords <input type="checkbox"/> LED lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Meter <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
COMMENTS AND RECOMMENDATION:					
<u>MENTIONED WATER TANK IS CLEANED & DISINFECTED</u>					
Crystalline representative: <u>SANKAR</u>			Signature: <u>[Signature]</u>		
Customer/Customer representative: <u>G. VOYEK</u>			Signature: <u>[Signature]</u>		





CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 24-08-2019

PHOTOGRAPHS

BASEMENT LEVEL COOLING TOWER MAKE UP RCC WATER TANK - 01

BEFORE

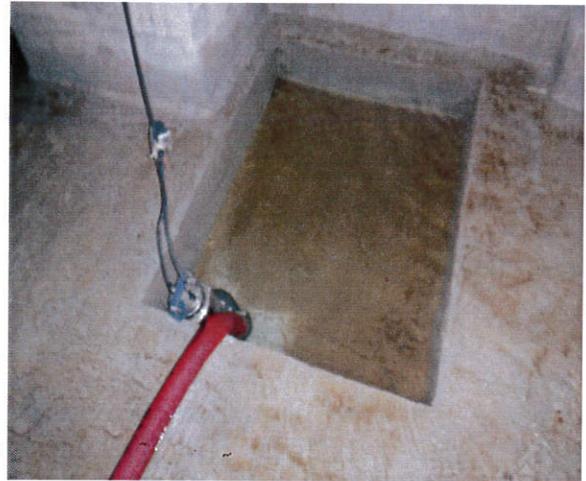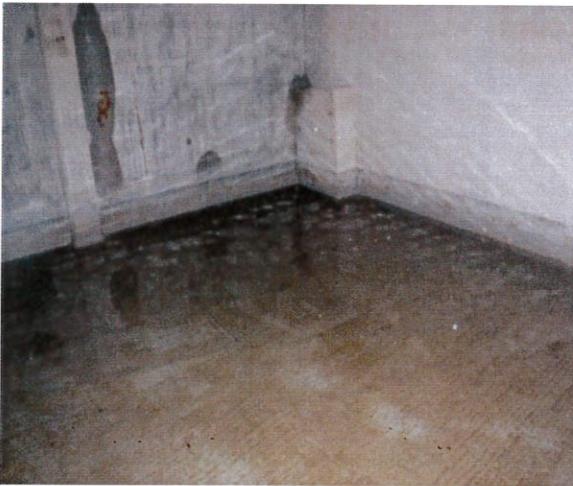

AFTER



CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17196

CUSTOMER: <u>AL SHIRAWI F/M</u>			CONTACT PERSON: <u>MR. BANJAMIN</u>		
SITE DETAILS: <u>DEER FIELD MALL</u>			CONTACT NO: <u>0561991971</u>		
TANK DETAILS: <u>R-GC-FILTERED GREY W-T-01</u>			LOCATION DETAILS: <u>BASEMENT</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> LADDER IN	<input type="checkbox"/> LADDER OUT	LEAKS		DRAIN LINE	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>24-08-2019</u>		<u>24-02-2020</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARELO BIO & PLUS</u> Quantity <u>500 ml</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input checked="" type="checkbox"/> High/Low Pressure Jet <input type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Meter <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
COMMENTS AND RECOMMENDATION:					
<u>MENTIONED WATER TANK IS CLEANED & DISINFECTED</u>					
Crystalline representative: <u>SANKAR</u>			Signature: <u>[Signature]</u>		
Customer/Customer representative: <u>G. VZVEK</u>			Signature: <u>[Signature]</u>		




CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 24-08-2019


PHOTOGRAPHS

BASEMENT LEVEL FILTERED GREY WATER TANK -01

BEFORE

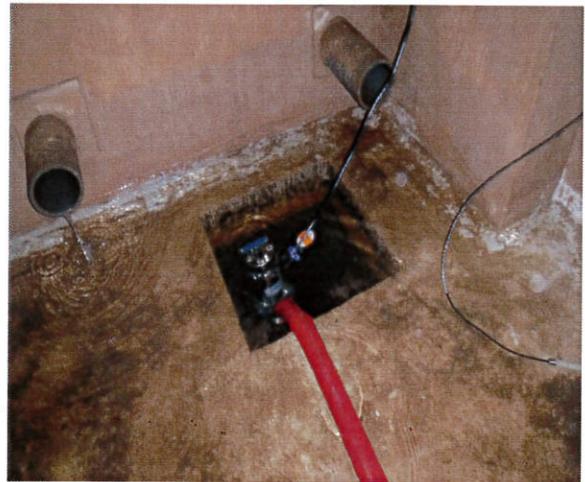

AFTER

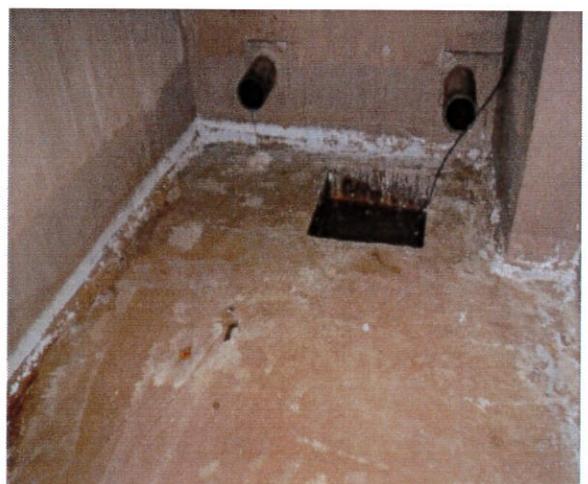

CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17198

CUSTOMER: <u>AL SHIRAWI FIRM</u>			CONTACT PERSON: <u>MR-BENJAMIN</u>		
SITE DETAILS: <u>DEER FIELD MALL</u>			CONTACT NO: <u>0561991971</u>		
TANK DETAILS: <u>R.O.C-FILTERED DOMESTIC W</u>			LOCATION DETAILS: <u>BASEMENT</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA	<input type="checkbox"/> NA	<input type="checkbox"/> NA	<input type="checkbox"/> NA	<input type="checkbox"/> NA	<input type="checkbox"/> NA
LADDER IN		LADDER OUT		LEAKS	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	DRAIN LINE	
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>25-08-2019</u>		<u>25-02-2020</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARELO Bio & PLUS</u> Quantity <u>500 ltr</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input checked="" type="checkbox"/> High/Low Pressure Jet <input type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Meter <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
COMMENTS AND RECOMMENDATION:					
<u>MENTIONED WATER TANK IS CLEANED & DISINFECTED</u>					
Crystalline representative: <u>SAIKAR</u>			Signature: <u>[Signature]</u>		
Customer/Customer representative: <u>G. V. Vek</u>			Signature: <u>[Signature]</u>		





CRYSTALLINE
ENVIRONMENTAL SERVICES

Date of Cleaning: 25-08-2019


PHOTOGRAPHS

BASEMENT LEVEL FILTERED DOMESTIC RCC WATER TANK- 02

BEFORE

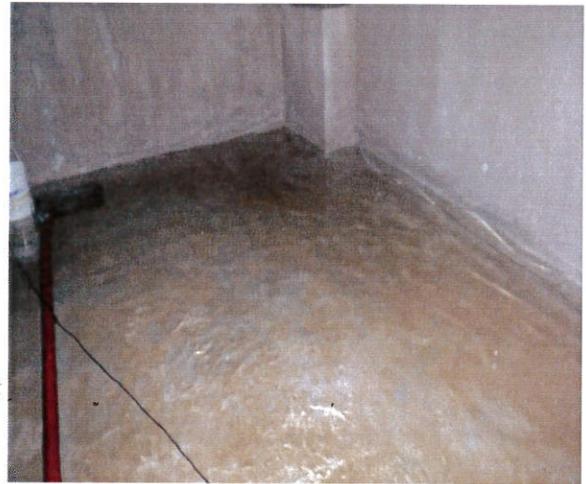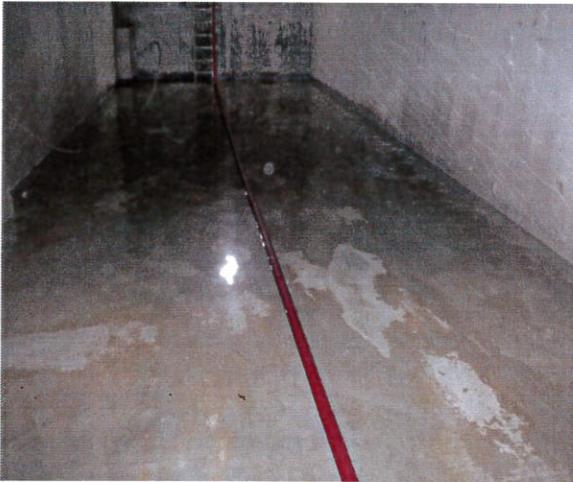

AFTER

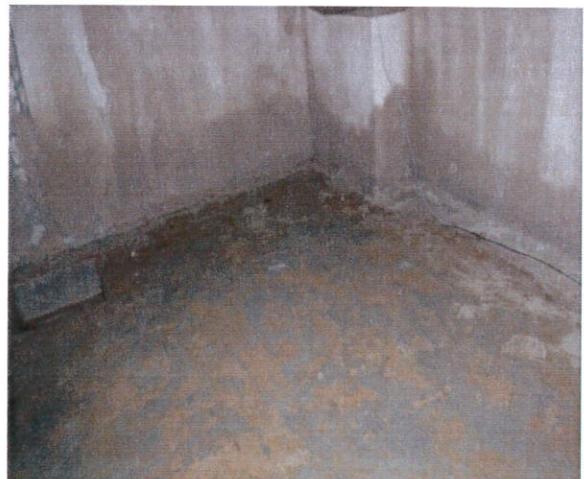

CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17199

CUSTOMER: <u>AL SHIRAWI FIM</u>			CONTACT PERSON: <u>MR-BERJAMU</u>		
SITE DETAILS: <u>DEER FIELD MALL</u>			CONTACT NO: <u>0561991971</u>		
TANK DETAILS: <u>R.C.C. DOMESTIC-W-T-01</u>			LOCATION DETAILS: <u>BASEMENT</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA	<input type="checkbox"/> NA	<input type="checkbox"/> NA	<input type="checkbox"/> NA	<input type="checkbox"/> NA	<input type="checkbox"/> NA
LADDER IN		LADDER OUT		LEAKS	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	DRAIN LINE	
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>25-08-2019</u>		<u>25-02-2020</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARELO Bio & PLUS</u> Quantity <u>500L</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input checked="" type="checkbox"/> High/Low Pressure Jet <input type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Meter <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
COMMENTS AND RECOMMENDATION:					
<u>MENTIONED WATER TANK IS CLEANED & DISINFECTED</u>					
Crystalline representative: <u>SANKAR</u>			Signature: <u>[Signature]</u>		
Customer/Customer representative: <u>G. V2Vek</u>			Signature: <u>[Signature]</u>		



Date of Cleaning: 25-08-2019

PHOTOGRAPHS
BASEMENT LEVEL RCC DOMESTIC WATER TANK - 01

BEFORE



AFTER

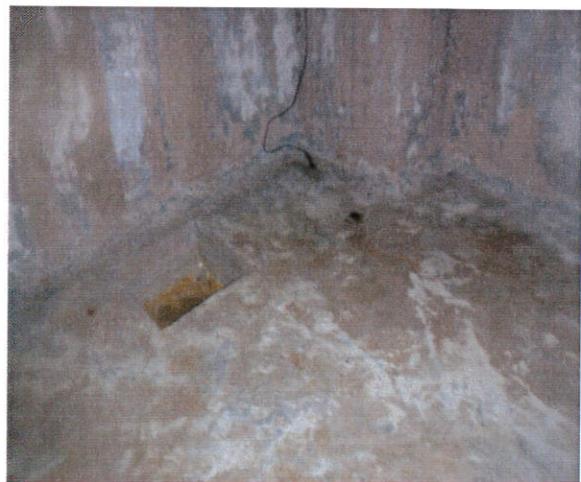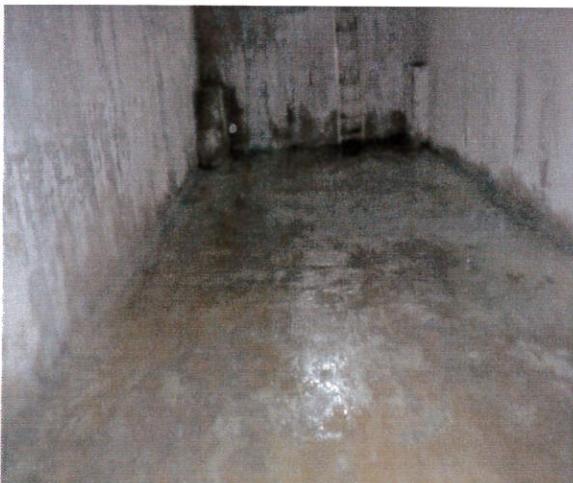



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

17200

CUSTOMER: <u>AL SHIRAWI FIM</u>			CONTACT PERSON: <u>MR-BENJAMIN</u>		
SITE DETAILS: <u>DEER FIELD MALL</u>			CONTACT NO: <u>0561991971</u>		
TANK DETAILS: <u>R-GC-RAW GREY-W-TANK-0</u>			LOCATION DETAILS: <u>BASEMENT</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED	<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS			
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA					
LADDER IN	LADDER OUT	LEAKS	DRAIN LINE	VALVES	FLOAT VALVE
<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>26-08-2019</u>		<u>26-02-2020</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARELO BIO & PLUS</u> Quantity <u>500 ltr</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High/Low Pressure Jet <input type="checkbox"/> Extension Cords <input type="checkbox"/> LED lights <input type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input type="checkbox"/> Oxygen Meter <input checked="" type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
COMMENTS AND RECOMMENDATION:					
<u>MENTIONED WATER TANK IS CLEANED & DISINFECTED</u>					
Crystalline representative: <u>SANUKAR</u>			Signature: <u>[Signature]</u>		
Customer/Customer representative: <u>G. VIVEK</u>			Signature: <u>[Signature]</u>		

Date of Cleaning: 26-08-2019

PHOTOGRAPHS
BASEMENT LEVEL RAW RCC GREY WATER TANK

BEFORE



AFTER



CLEANER WATER GREENER TOMORROW



CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT

18133

CUSTOMER: <u>AL SHIRAWI FIM</u>			CONTACT PERSON: <u>MR-DARJAMIN</u>		
SITE DETAILS: <u>DEER FIELD MALL</u>			CONTACT NO: <u>0561991971</u>		
TANK DETAILS: <u>R-CC-RAW GAEY-W-TANK-1+1</u>			LOCATION DETAILS: <u>BASEMENT, PUMP ROOM</u>		
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL		<input checked="" type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input type="checkbox"/> HALF	<input checked="" type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input checked="" type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> LADDER IN	<input type="checkbox"/> LADDER OUT	<input type="checkbox"/> LEAKS	<input type="checkbox"/> DRAIN LINE	<input type="checkbox"/> VALVES	<input type="checkbox"/> FLOAT VALVE
<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input type="checkbox"/> NO <input checked="" type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		<u>27-08-2019</u>		<u>27-02-2020</u>	
CHEMICALS & EQUIPMENTS USED					
1. <u>CARELO BIO & PLUS</u> Quantity <u>300 ltr</u>					
2. _____ Quantity _____					
<input checked="" type="checkbox"/> Submersibel Pump <input type="checkbox"/> High /Low Pressure jet <input type="checkbox"/> Extension Cords <input type="checkbox"/> LED Lights <input checked="" type="checkbox"/> Foot Bath <input type="checkbox"/> Ladder <input checked="" type="checkbox"/> Ventilating Fan <input type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Mater <input type="checkbox"/> Vacuum Cleaner <input type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
<u>MENTIONED WATER TANK IS CLEANED & DISINFECTED</u>					
Crystalline Representative: <u>SANKAR</u>			Signature: <u>[Signature]</u>		

[Signature]
(G. VIVEK)


Date of Cleaning: 27-08-2019

PHOTOGRAPHS
BASEMENT LEVEL RCC GREY WATER TANK- I & II

BEFORE



AFTER

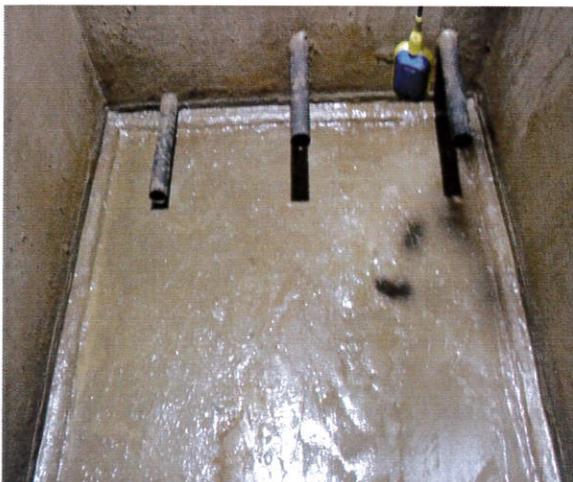

CLEANER WATER GREENER TOMORROW

CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

WATER TANK CLEANING & DISINFECTION

CLIENT NAME : DEERFIELD MALL
CONTACT PERSON : BENJAMIN PANIS
DESIGNATION : FM SUPERVISOR
SITE DETAILS : DEERFIELD MALL
DETAILS : WATER TANK CLEANING & DISINFECTION
DATE OF CLEANING : AUGUST 2019
FREQUENCY OF CLEANING : HALF YEARLY
DATE OF NEXT CLEANING : 21 FEBRUARY 2020

The above water tanks were cleaned and disinfected in accordance with the Code of Practice for the inspection and cleaning of customer water storage tanks.



Tasman Pinto

CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES