

**ENVIRONMENTAL  
SERVICES FOR  
A GREENER  
TOMORROW...  
ONE STEP AT  
A TIME.**



**CRYSTALLINE**  
ENVIRONMENTAL SERVICES



Completion Report for

## **Kitchen Hood & Exhaust System Cleaning & Degreasing**

Date: **01 January 2020**  
Client Name: **Khadamat Facilities Management  
.L.L.C**  
Contact Person: **Arockia John Paul**  
Designation: **Building Services Engineer**  
Site Detail: **UAE University Al Maqam Campus -  
Al Ain**





# CRYSTALLINE ENVIROMENTAL SERVICES

## KITCHEN EXHAUST SYSTEM - AFTER SERVICE REPORT

1855

CUSTOMER: <u>KHADAMAT</u>	CONTACT PERSON: <u>MR. SHABIR</u>
SITE DETAILS: <u>UAEU UNIVERSITY</u>	CONTACT NUMBER: <u>050-4038808</u>
NAME OF KITCHEN: <u>RICE KITCHEN</u>	LOCATION: <u>A-11 BUILDING</u>
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> HOTEL <input checked="" type="checkbox"/> RESIDENCIAL <input type="checkbox"/> RESTAURANT	

### Type & Size of Hood:

Cooking Volume:	<input checked="" type="checkbox"/> Very High	<input type="checkbox"/> High	<input type="checkbox"/> Medium	<input type="checkbox"/> Low
Type of Filters:	<input type="checkbox"/> Mesh	<input checked="" type="checkbox"/> Baffle	<input type="checkbox"/> N/A	
Filters in Place:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> N/A	
Filter Cleaning Freq.	<input type="checkbox"/> Daily	<input type="checkbox"/> Weekly	<input type="checkbox"/> Monthly	<input checked="" type="checkbox"/> Not Known

### Comments:

### FIRE PROTECTION SYSTEM

Kitchen:	<input checked="" type="checkbox"/> Powder	<input checked="" type="checkbox"/> CO2	<input type="checkbox"/> Foam	<input checked="" type="checkbox"/> Other
Cooker Hoods:	<input checked="" type="checkbox"/> CO2	<input checked="" type="checkbox"/> Sprinkler	<input type="checkbox"/> Dry Powder	<input checked="" type="checkbox"/> Other
Fire Dampers:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	Fusible Links:	<input type="checkbox"/> Yes <input type="checkbox"/> No

### DUCTWORK

Duct Made of:	<input checked="" type="checkbox"/> Galvanized Steel	<input type="checkbox"/> Stainless Steel	<input type="checkbox"/> Other
Physical Entry:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Partly
Access with Tools only:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Partly
Vertical Access:	<input type="checkbox"/> Rope access	<input type="checkbox"/> Safety Harness	<input checked="" type="checkbox"/> N/A
Entire System Cleaned	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No If No, give details	

### Comments

Doors/Plates Present:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels
Doors/Plates Installed:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels

### Where Installed:

Duct Size & Approx. Length:	Insulated:	<input type="checkbox"/> Yes	<input type="checkbox"/> No
Condition of Ducts:	<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty
Damaged:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Where <input type="checkbox"/> N/A
Exhaust Fans:	<input checked="" type="checkbox"/> Upblast	<input type="checkbox"/> Inline	<input type="checkbox"/> Utility <input type="checkbox"/> Others

Location: <u>ROOF TOP</u>	Condition of Roof: <u>GOOD</u>
---------------------------	--------------------------------

LAST CLEANING DATE	CURRENT CLEANING DATE	NEXT CLEANING DATE
	<u>25-12-2019</u>	<u>24-12-2020</u>

### CHEMICALS AND EQUIPMENTS USED

<input type="checkbox"/> JETTING MACHINE	<input checked="" type="checkbox"/> INLET WATER HOSE	<input checked="" type="checkbox"/> EXTENTION CORDS	<input type="checkbox"/> VACCUM CLEANER
<input checked="" type="checkbox"/> LED LIGHTS	<input checked="" type="checkbox"/> PLASTICS ROLL/BAGS	<input checked="" type="checkbox"/> SUITABLE PPE	<input checked="" type="checkbox"/> DEGREASER CHEMICAL
<input type="checkbox"/> LADDER			

**COMMENTS AND RECOMMENDATION:** INOS DOUBLE HOOD CLEANING & DISINFECTION COMPLETED.

Crystalline Representative: <u>LO MANJARI</u>	Signature: <u>[Signature]</u>
Customer Representative: <u>SABER AHMED</u>	Signature: <u>[Signature]</u>

CLEANER WATER GREENER TOMORROW


Web: [www.crystalline-uae.com](http://www.crystalline-uae.com)  
 E-mail: [info@crystalline-uae.com](mailto:info@crystalline-uae.com)  
 Tel.: +971 55 7167017

## Kitchen Hood & Exhaust System Cleaning


Before Photo



After Photo

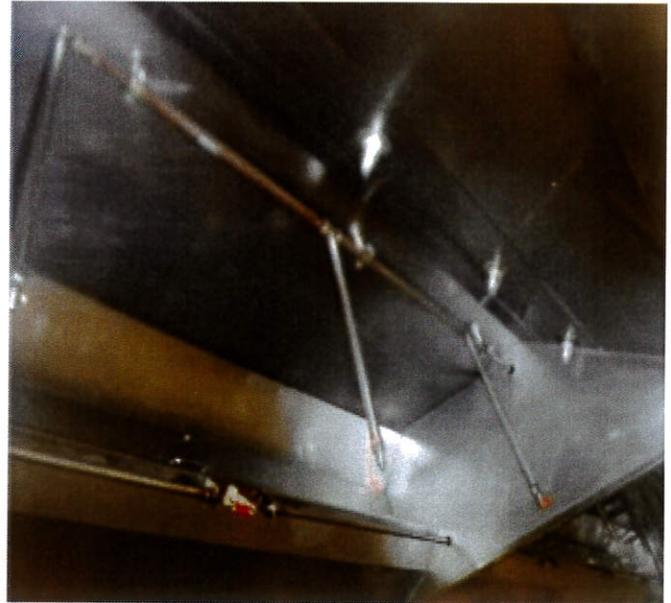

Before Photo

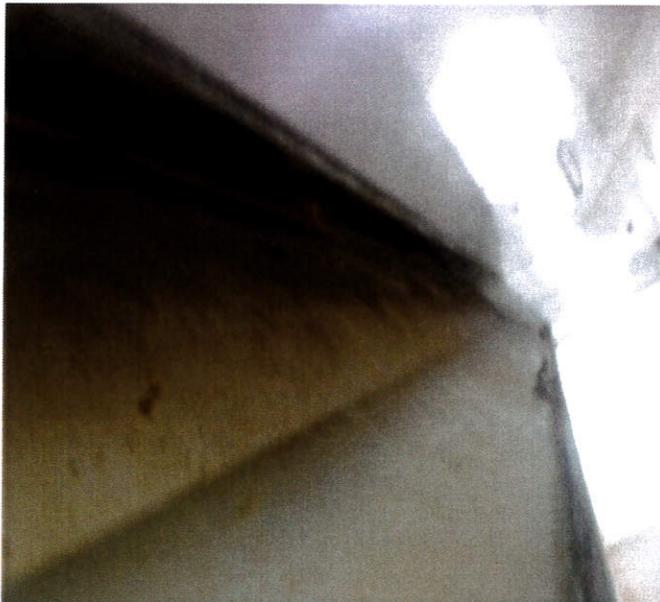

After Photo



## Kitchen Hood & Exhaust System Cleaning


Before Photo




After Photo



Before Photo

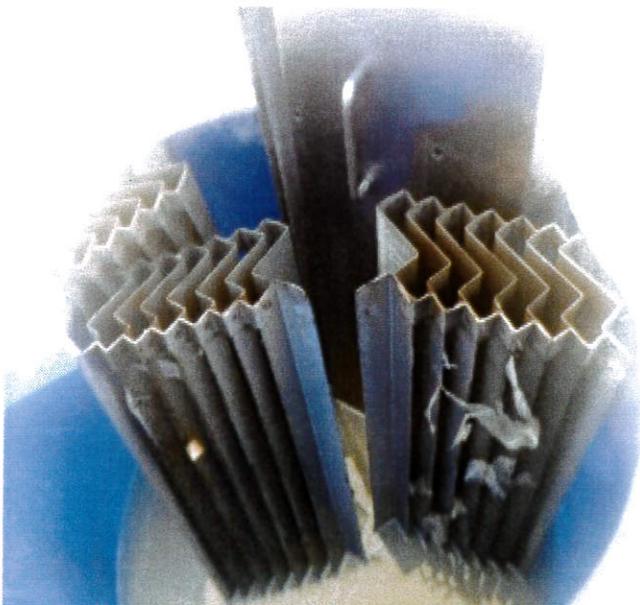

After Photo

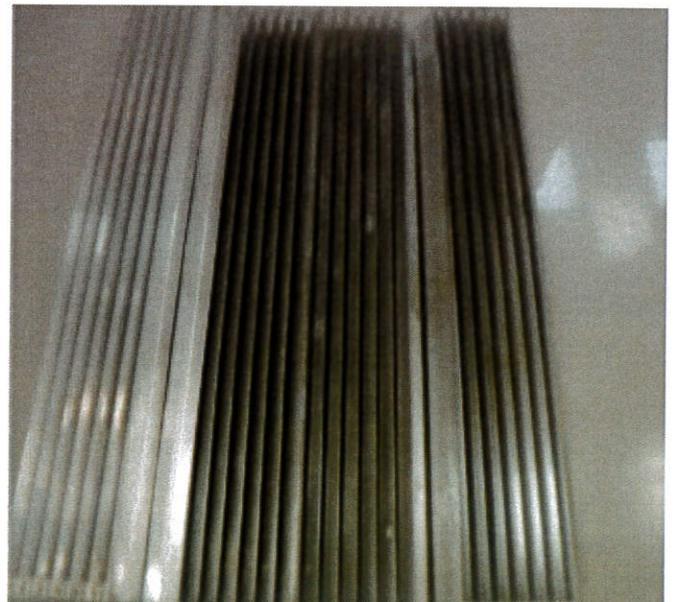



# CRYSTALLINE ENVIROMENTAL SERVICES

## KITCHEN EXHAUST SYSTEM - AFTER SERVICE REPORT

1856

CUSTOMER: KHADAMAT	CONTACT PERSON: MR. SHABEER
SITE DETAILS: UAE UNIVERSITY	CONTACT NUMBER: 076-4038808
NAME OF KITCHEN: PAROTA - CHAPPATHI	LOCATION: A11 - BUILDING
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> HOTEL <input type="checkbox"/> RESIDENCIAL <input type="checkbox"/> RESTAURANT	

### Type & Size of Hood:

Cooking Volume:	<input checked="" type="checkbox"/> Very High	<input type="checkbox"/> High	<input type="checkbox"/> Medium	<input type="checkbox"/> Low
Type of Filters:	<input type="checkbox"/> Mesh	<input checked="" type="checkbox"/> Baffle	<input type="checkbox"/> N/A	
Filters in Place:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> N/A	
Filter Cleaning Freq.	<input type="checkbox"/> Daily	<input type="checkbox"/> Weekly	<input type="checkbox"/> Monthly	<input checked="" type="checkbox"/> Not Known

### Comments:

### FIRE PROTECTION SYSTEM

Kitchen:	<input checked="" type="checkbox"/> Powder	<input checked="" type="checkbox"/> CO2	<input type="checkbox"/> Foam	<input checked="" type="checkbox"/> Other
Cooker Hoods:	<input checked="" type="checkbox"/> CO2	<input checked="" type="checkbox"/> Sprinkler	<input type="checkbox"/> Dry Powder	<input checked="" type="checkbox"/> Other
Fire Dampers:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	Fusible Links:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No

### DUCTWORK

Duct Made of:	<input checked="" type="checkbox"/> Galvanized Steel	<input type="checkbox"/> Stainless Steel	<input type="checkbox"/> Other
Physical Entry:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Partly
Access with Tools only:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Partly
Vertical Access:	<input type="checkbox"/> Rope access	<input type="checkbox"/> Safety Harness	<input checked="" type="checkbox"/> N/A
Entire System Cleaned	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No if No, give details	

### Comments

Doors/Plates Present:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels
Doors/Plates Installed:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels

### Where Installed:

Duct Size & Approx. Length:	Insulated:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
Condition of Ducts:	<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty
Damaged:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Where <input type="checkbox"/> N/A
Exhaust Fans:	<input checked="" type="checkbox"/> Upblast	<input type="checkbox"/> Inline	<input type="checkbox"/> Utility <input type="checkbox"/> Others

### Location:

### Condition of Roof:

### LAST CLEANING DATE

### CURRENT CLEANING DATE

### NEXT CLEANING DATE

26-12-2019

25-12-2020

### CHEMICALS AND EQUIPMENTS USED

<input checked="" type="checkbox"/> JETTING MACHINE	<input checked="" type="checkbox"/> INLET WATER HOSE	<input checked="" type="checkbox"/> EXTENTION CORDS	<input type="checkbox"/> VACCUM CLEANER
<input checked="" type="checkbox"/> LED LIGHTS	<input type="checkbox"/> PLASTICS ROLL/BAGS	<input type="checkbox"/> SUITABLE PPE	<input checked="" type="checkbox"/> DEGREASER CHEMICAL
<input checked="" type="checkbox"/> LADDER			

COMMENTS AND RECOMMENDATION: INOS DOUBLE HOOD CLEANING GRILS WASHING & DISINFECTION COMPLETED.


Crystalline Representative: K. ANSARI	Signature:
Customer Representative: SHABEER AHMED	Signature:

## Kitchen Hood & Exhaust System Cleaning

Before Photo



After Photo

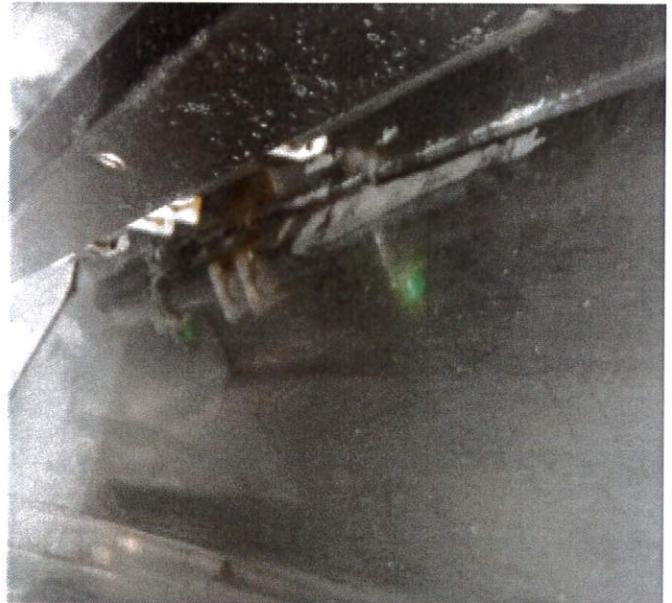

Before Photo




After Photo



## Kitchen Hood & Exhaust System Cleaning

Before Photo

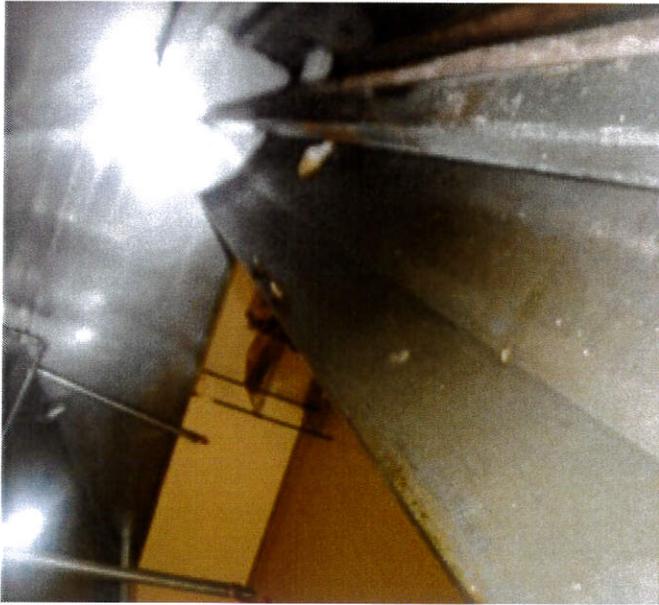


After Photo



Before Photo



After Photo

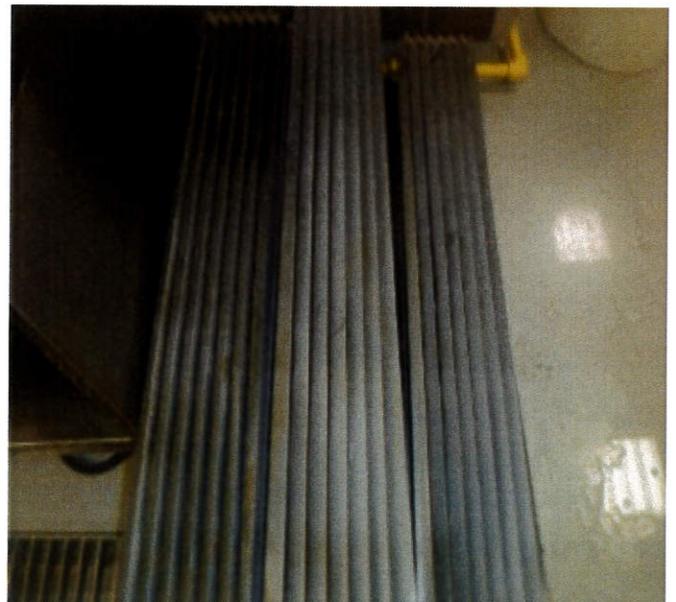



# CRYSTALLINE ENVIROMENTAL SERVICES

## KITCHEN EXHAUST SYSTEM - AFTER SERVICE REPORT

1857

CUSTOMER: <u>KHADAMAT</u>	CONTACT PERSON: <u>MR. SHADEER-</u>
SITE DETAILS: <u>UAU UNIVERSITY</u>	CONTACT NUMBER: <u>056-402 8808</u>
NAME OF KITCHEN: <u>OVEN-GRILL-BAKERY</u>	LOCATION: <u>A-11 BUILDING</u>
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> HOTEL <input type="checkbox"/> RESIDENCIAL <input type="checkbox"/> RESTAURANT	

### Type & Size of Hood:

Cooking Volume:	<input checked="" type="checkbox"/> Very High	<input type="checkbox"/> High	<input type="checkbox"/> Medium	<input type="checkbox"/> Low
Type of Filters:	<input type="checkbox"/> Mesh	<input checked="" type="checkbox"/> Baffle	<input type="checkbox"/> N/A	
Filters in Place:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> N/A	
Filter Cleaning Freq.	<input type="checkbox"/> Daily	<input type="checkbox"/> Weekly	<input type="checkbox"/> Monthly	<input checked="" type="checkbox"/> Not Known

Comments:

### FIRE PROTECTION SYSTEM

Kitchen:	<input checked="" type="checkbox"/> Powder	<input checked="" type="checkbox"/> CO2	<input type="checkbox"/> Foam	<input checked="" type="checkbox"/> Other
Cooker Hoods:	<input checked="" type="checkbox"/> CO2	<input checked="" type="checkbox"/> Sprinkler	<input type="checkbox"/> Dry Powder	<input checked="" type="checkbox"/> Other
Fire Dampers:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	Fusible Links:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No

### DUCTWORK

Duct Made of:	<input checked="" type="checkbox"/> Galvanized Steel	<input type="checkbox"/> Stainless Steel	<input type="checkbox"/> Other
Physical Entry:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Partly
Access with Tools only:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Partly
Vertical Access:	<input type="checkbox"/> Rope access	<input type="checkbox"/> Safety Harness	<input checked="" type="checkbox"/> N/A
Entire System Cleaned	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No if No, give details	

Comments

Doors/Plates Present:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels
Doors/Plates Installed:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels

Where Installed:

Duct Size & Approx. Length:	Insulated:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Condition of Ducts:	<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty
Damaged:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Where <input type="checkbox"/> N/A
Exhaust Fans:	<input checked="" type="checkbox"/> Upblast	<input type="checkbox"/> Inline	<input type="checkbox"/> Utility <input type="checkbox"/> Others

Location: Condition of Roof:

LAST CLEANING DATE	CURRENT CLEANING DATE	NEXT CLEANING DATE
	<u>27-12-2019</u>	<u>26-12-2020</u>

### CHEMICALS AND EQUIPMENTS USED


<input checked="" type="checkbox"/> JETTING MACHINE	<input checked="" type="checkbox"/> INLET WATER HOSE	<input checked="" type="checkbox"/> EXTENTION CORDS	<input checked="" type="checkbox"/> VACCUM CLEANER
<input checked="" type="checkbox"/> LED LIGHTS	<input checked="" type="checkbox"/> PLASTICS ROLL/BAGS	<input checked="" type="checkbox"/> SUITABLE PPE	<input checked="" type="checkbox"/> DEGREASER CHEMICAL
<input type="checkbox"/> LADDER			

COMMENTS AND RECOMMENDATION: 3 NOS SINGLE HOOD CLEANED, GRILLS CLEANED & ALL HOODS DISINFECTION COMPLETED.

Crystalline Representative: <u>M. ANSARI</u>	Signature: <u>[Signature]</u>
Customer Representative: <u>SABER AHMED</u>	Signature: <u>[Signature]</u>

## Kitchen Hood & Exhaust System Cleaning

Before Photo

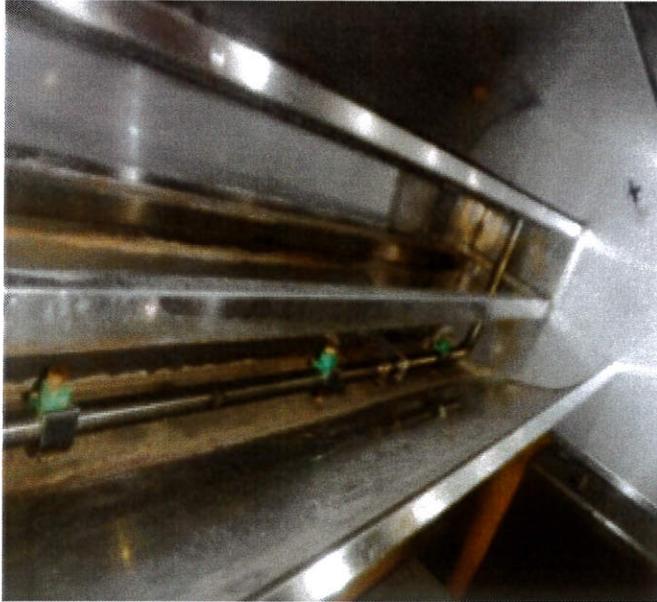


After Photo



Before Photo



After Photo

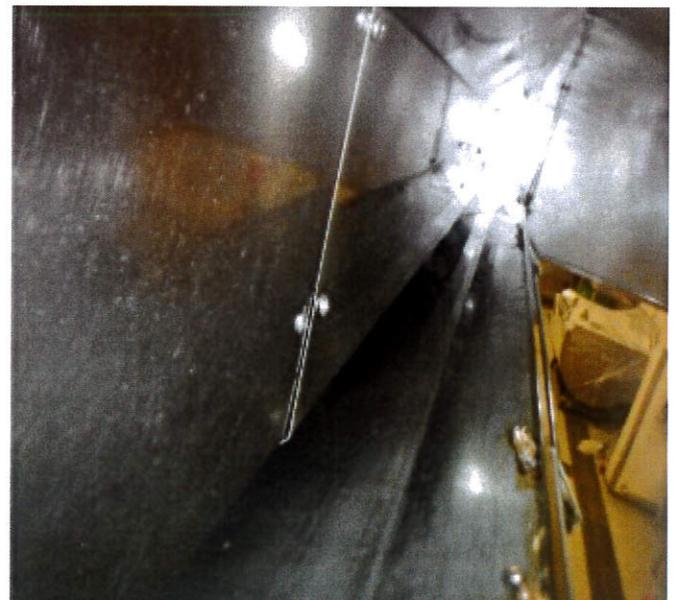

## Kitchen Hood & Exhaust System Cleaning

Before Photo



After Photo



Before Photo



After Photo




## Kitchen Hood & Exhaust System Cleaning

Before Photo



After Photo

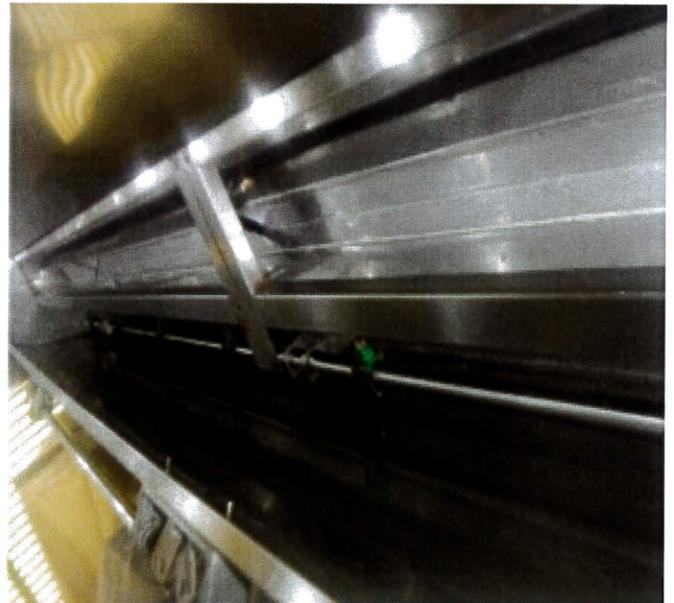

Before Photo



After Photo





# CRYSTALLINE ENVIROMENTAL SERVICES

## KITCHEN EXHAUST SYSTEM - AFTER SERVICE REPORT

1858

CUSTOMER: <u>KHADAMAT</u>	CONTACT PERSON: <u>MR. CHABEER</u>
SITE DETAILS: <u>UAEU UNIVERSITY</u>	CONTACT NUMBER: <u>056-4038808</u>
NAME OF KITCHEN: <u>EXHAUST FAN</u>	LOCATION: <u>A-11 ROOF TOP</u>
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> HOTEL <input type="checkbox"/> RESIDENCIAL <input type="checkbox"/> RESTAURANT	

### Type & Size of Hood:

Cooking Volume:	<input checked="" type="checkbox"/> Very High	<input type="checkbox"/> High	<input type="checkbox"/> Medium	<input type="checkbox"/> Low
Type of Filters:	<input type="checkbox"/> Mesh	<input checked="" type="checkbox"/> Baffle	<input type="checkbox"/> N/A	
Filters in Place:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> N/A	
Filter Cleaning Freq.	<input type="checkbox"/> Daily	<input type="checkbox"/> Weekly	<input type="checkbox"/> Monthly	<input checked="" type="checkbox"/> Not Known

Comments:

### FIRE PROTECTION SYSTEM

Kitchen:	<input checked="" type="checkbox"/> Powder	<input checked="" type="checkbox"/> CO2	<input type="checkbox"/> Foam	<input checked="" type="checkbox"/> Other
Cooker Hoods:	<input checked="" type="checkbox"/> CO2	<input checked="" type="checkbox"/> Sprinkler	<input type="checkbox"/> Dry Powder	<input checked="" type="checkbox"/> Other
Fire Dampers:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	Fusible Links:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No

### DUCTWORK

Duct Made of:	<input checked="" type="checkbox"/> Galvanized Steel	<input type="checkbox"/> Stainless Steel	<input type="checkbox"/> Other
Physical Entry:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Partly
Access with Tools only:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Partly
Vertical Access:	<input type="checkbox"/> Rope access	<input type="checkbox"/> Safety Harness	<input checked="" type="checkbox"/> N/A
Entire System Cleaned	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No if No, give details	

Comments

Doors/Plates Present:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels
Doors/Plates Installed:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels

Where Installed:

Duct Size & Approx. Length:	Insulated:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Condition of Ducts:	<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty
Damaged:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Where <input type="checkbox"/> N/A
Exhaust Fans:	<input checked="" type="checkbox"/> Upblast	<input type="checkbox"/> Inline	<input type="checkbox"/> Utility <input type="checkbox"/> Others

Location: <u>ROOF TOP</u>	Condition of Roof: <u>GOOD</u>
---------------------------	--------------------------------

LAST CLEANING DATE	CURRENT CLEANING DATE	NEXT CLEANING DATE
	<u>28-12-2019</u>	<u>27-12-2020</u>

### CHEMICALS AND EQUIPMENTS USED

<input checked="" type="checkbox"/> JETTING MACHINE	<input checked="" type="checkbox"/> INLET WATER HOSE	<input checked="" type="checkbox"/> EXTENTION CORDS	<input type="checkbox"/> VACCUM CLEANER
<input checked="" type="checkbox"/> LED LIGHTS	<input type="checkbox"/> PLASTICS ROLL/BAGS	<input checked="" type="checkbox"/> SUITABLE PPE	<input checked="" type="checkbox"/> DEGREASER CHEMICAL
<input checked="" type="checkbox"/> LADDER			

COMMENTS AND RECOMMENDATION: 5 NOS EXHAUST CLEANED. INSIDE OUTSIDE POLISHED.

Crystalline Representative: <u>ANISARI</u>	Signature: <u>[Signature]</u>
Customer Representative: <u>CHABEER AHMED</u>	Signature: <u>[Signature]</u>

## Kitchen Hood & Exhaust System Cleaning

Before Photo



After Photo



Before Photo



After Photo



## Kitchen Hood & Exhaust System Cleaning

Before Photo




After Photo



Before Photo



After Photo

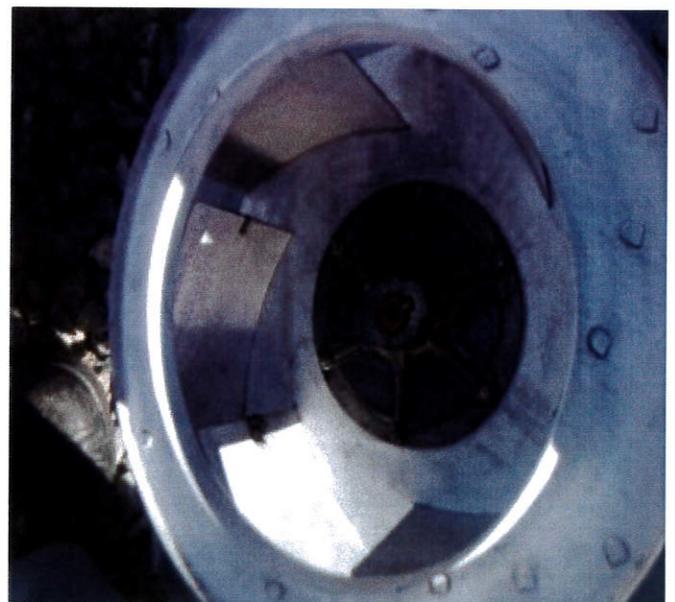

## Kitchen Hood & Exhaust System Cleaning

Before Photo




After Photo



Before Photo




After Photo

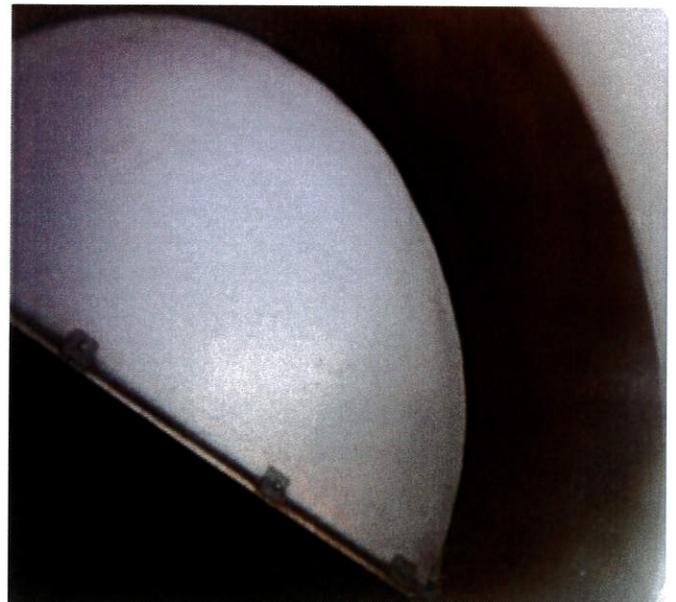

## Kitchen Hood & Exhaust System Cleaning

Before Photo

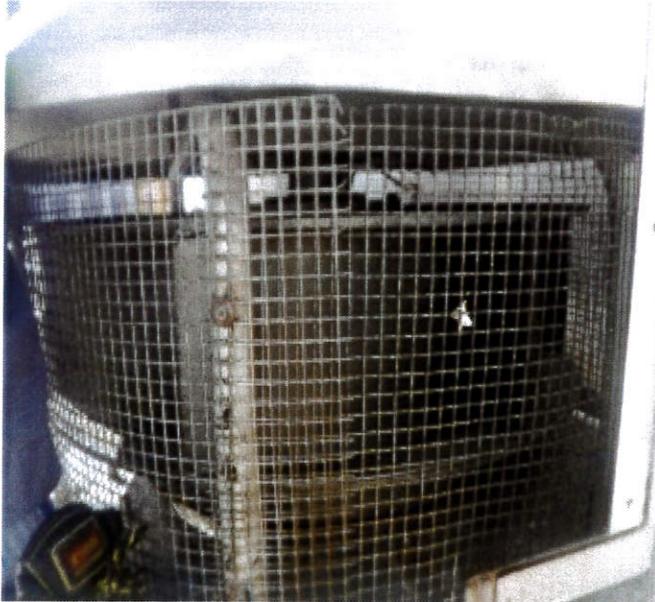

After Photo



Before Photo



After Photo





# CRYSTALLINE ENVIROMENTAL SERVICES

## KITCHEN EXHAUST SYSTEM - AFTER SERVICE REPORT

1859

CUSTOMER: <u>KHADAMAT</u>	CONTACT PERSON: <u>MR. SHADEER</u>
SITE DETAILS: <u>UAEU UNIVERSITY</u>	CONTACT NUMBER: <u>056-403 8808</u>
NAME OF KITCHEN: <u>EXHAUST FAN</u>	LOCATION: <u>ROOF TOP</u>
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> HOTEL <input type="checkbox"/> RESIDENCIAL <input type="checkbox"/> RESTAURANT	

**Type & Size of Hood:**

Cooking Volume:	<input checked="" type="checkbox"/> Very High	<input type="checkbox"/> High	<input type="checkbox"/> Medium	<input type="checkbox"/> Low
Type of Filters:	<input type="checkbox"/> Mesh	<input checked="" type="checkbox"/> Baffle	<input type="checkbox"/> N/A	
Filters in Place:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> N/A	
Filter Cleaning Freq.	<input type="checkbox"/> Daily	<input type="checkbox"/> Weekly	<input type="checkbox"/> Monthly	<input checked="" type="checkbox"/> Not Known

Comments:

**FIRE PROTECTION SYSTEM**

Kitchen:	<input checked="" type="checkbox"/> Powder	<input checked="" type="checkbox"/> CO2	<input type="checkbox"/> Foam	<input checked="" type="checkbox"/> Other
Cooker Hoods:	<input checked="" type="checkbox"/> CO2	<input checked="" type="checkbox"/> Sprinkler	<input type="checkbox"/> Dry Powder	<input checked="" type="checkbox"/> Other
Fire Dampers:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	Fusible Links:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No

**DUCTWORK**

Duct Made of:	<input checked="" type="checkbox"/> Galvanized Steel	<input type="checkbox"/> Stainless Steel	<input type="checkbox"/> Other
Physical Entry:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Partly
Access with Tools only:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Partly
Vertical Access:	<input type="checkbox"/> Rope access	<input type="checkbox"/> Safety Harness	<input checked="" type="checkbox"/> N/A
Entire System Cleaned	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No if No, give details	

Comments:

Doors/Plates Present:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels
Doors/Plates Installed:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels

Where Installed:

Duct Size & Approx. Length:	Insulated:	<input type="checkbox"/> Yes	<input type="checkbox"/> No
Condition of Ducts:	<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty
Damaged:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Where <input type="checkbox"/> N/A
Exhaust Fans:	<input checked="" type="checkbox"/> Upblast	<input type="checkbox"/> Inline	<input type="checkbox"/> Utility <input type="checkbox"/> Others
Location: <u>ROOF TOP</u>	Condition of Roof: <u>GOOD</u>		

LAST CLEANING DATE	CURRENT CLEANING DATE	NEXT CLEANING DATE
	<u>29-12-2019</u>	<u>28-12-2020</u>

**CHEMICALS AND EQUIPMENTS USED**


<input checked="" type="checkbox"/> JETTING MACHINE	<input checked="" type="checkbox"/> INLET WATER HOSE	<input checked="" type="checkbox"/> EXTENTION CORDS	<input checked="" type="checkbox"/> VACCUM CLEANER
<input type="checkbox"/> LED LIGHTS	<input type="checkbox"/> PLASTICS ROLL/BAGS	<input checked="" type="checkbox"/> SUITABLE PPE	<input type="checkbox"/> DEGREASER CHEMICAL
<input checked="" type="checkbox"/> LADDER			

**COMMENTS AND RECOMMENDATION:** 3 NOS EXHAUST FAN CLEANED & POLISHED.

Crystalline Representative: <u>L ANSARI</u>	Signature: <u>[Signature]</u>
Customer Representative: <u>SABER AHMED</u>	Signature: <u>[Signature]</u>

## Kitchen Hood & Exhaust System Cleaning


Before Photo

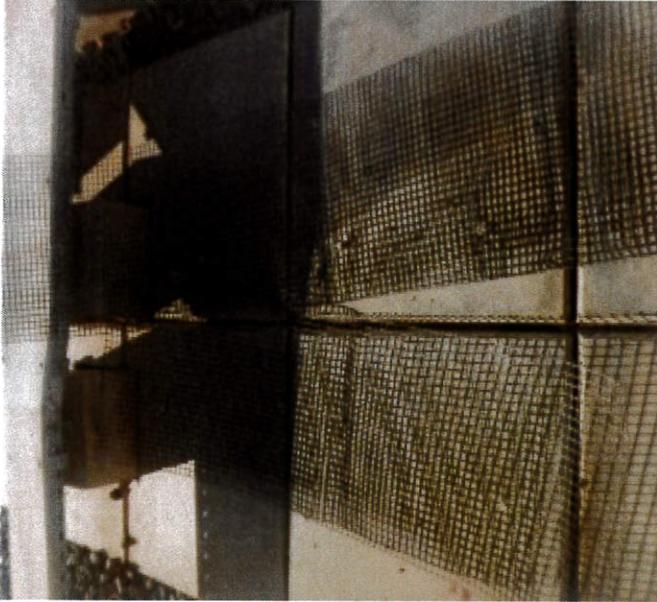


After Photo



Before Photo

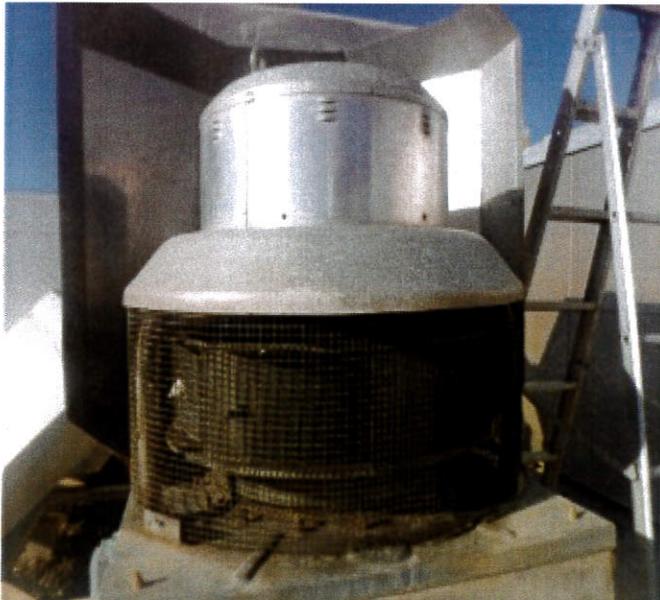


After Photo

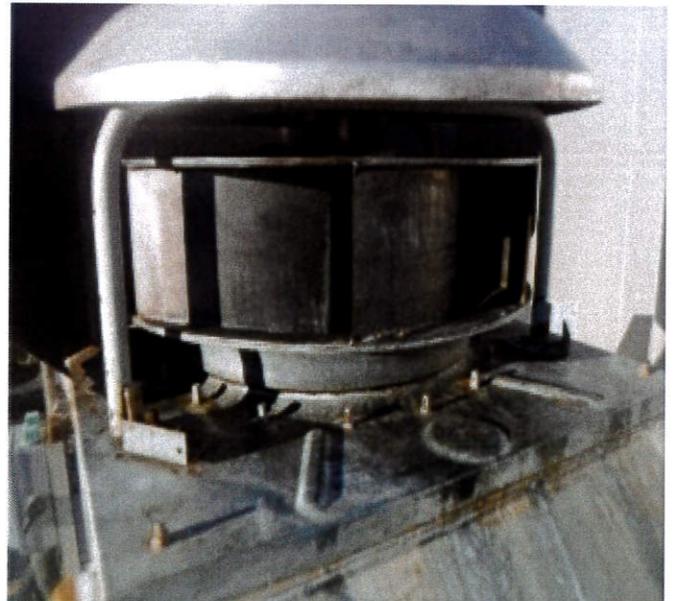

## Kitchen Hood & Exhaust System Cleaning

Before Photo

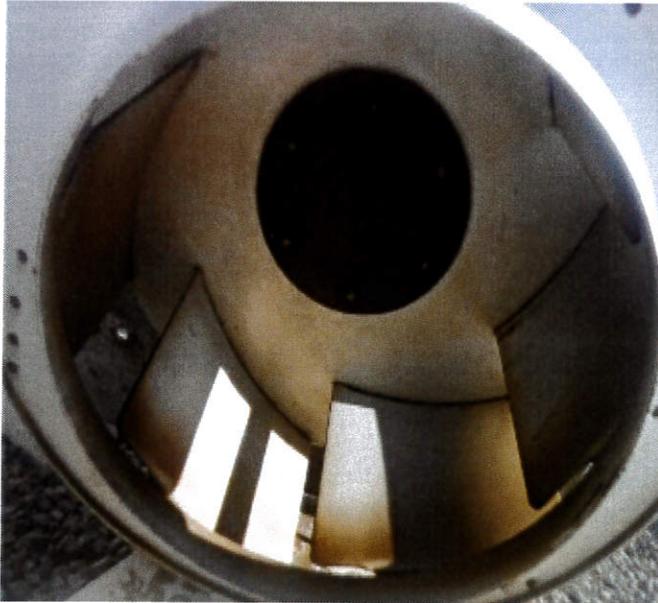

After Photo



Before Photo




After Photo



## Kitchen Hood & Exhaust System Cleaning


Before Photo

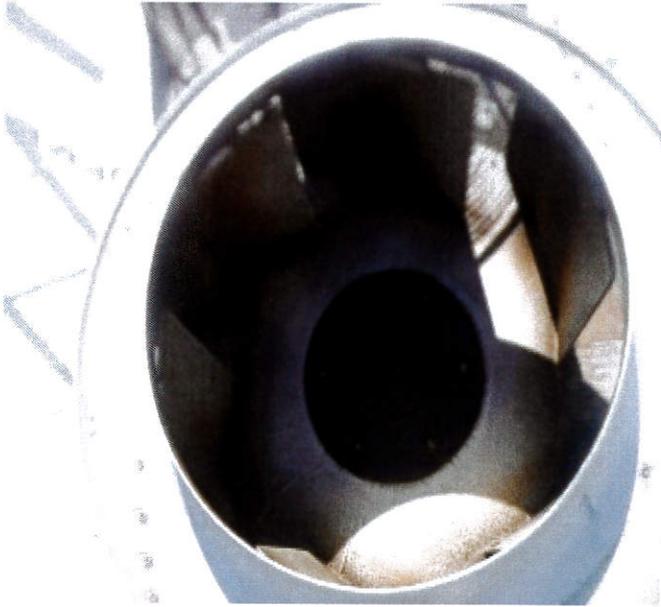

After Photo



Before Photo

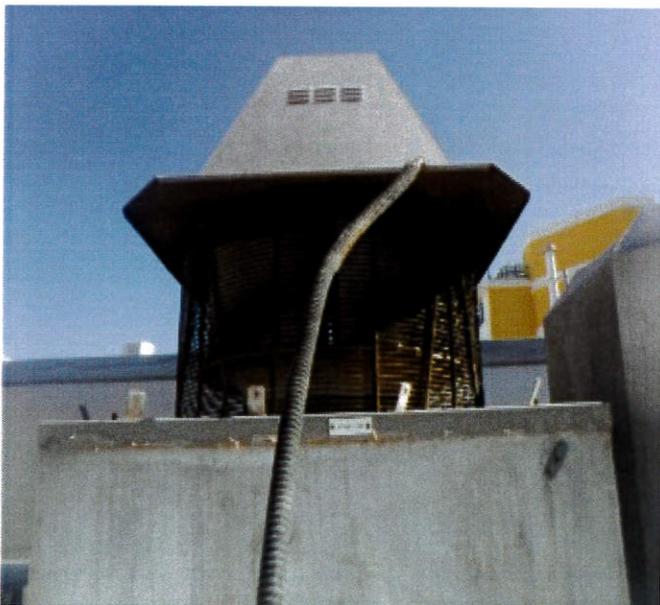

After Photo





# CRYSTALLINE ENVIROMENTAL SERVICES

## KITCHEN EXHAUST SYSTEM - AFTER SERVICE REPORT

1860

CUSTOMER: <u>KHADAMAT</u>	CONTACT PERSON: <u>MR. SHABEER</u>
SITE DETAILS: <u>UAEU UNIVERSITY</u>	CONTACT NUMBER: <u>056-4028808</u>
NAME OF KITCHEN: <u>DUCT</u>	LOCATION: <u>A-11 CEILING INSIDE</u>
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL <input type="checkbox"/> HOTEL <input type="checkbox"/> RESIDENCIAL <input type="checkbox"/> RESTAURANT	

### Type & Size of Hood:

Cooking Volume:	<input checked="" type="checkbox"/> Very High	<input type="checkbox"/> High	<input type="checkbox"/> Medium	<input type="checkbox"/> Low
Type of Filters:	<input type="checkbox"/> Mesh	<input checked="" type="checkbox"/> Baffle	<input type="checkbox"/> N/A	
Filters in Place:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> N/A	
Filter Cleaning Freq.	<input type="checkbox"/> Daily	<input type="checkbox"/> Weekly	<input type="checkbox"/> Monthly	<input checked="" type="checkbox"/> Not Known

### Comments:

### FIRE PROTECTION SYSTEM

Kitchen:	<input checked="" type="checkbox"/> Powder	<input checked="" type="checkbox"/> CO2	<input type="checkbox"/> Foam	<input checked="" type="checkbox"/> Other
Cooker Hoods:	<input checked="" type="checkbox"/> CO2	<input checked="" type="checkbox"/> Sprinkler	<input type="checkbox"/> Dry Powder	<input checked="" type="checkbox"/> Other
Fire Dampers:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	Fusible Links:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No

### DUCTWORK

Duct Made of:	<input checked="" type="checkbox"/> Galvanized Steel	<input type="checkbox"/> Stainless Steel	<input type="checkbox"/> Other
Physical Entry:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Partly
Access with Tools only:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Partly
Vertical Access:	<input type="checkbox"/> Rope access	<input type="checkbox"/> Safety Harness	<input checked="" type="checkbox"/> N/A
Entire System Cleaned	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No if No, give details	

### Comments

Doors/Plates Present:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels
Doors/Plates Installed:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels

### Where Installed:

Duct Size & Approx. Length:	Insulated:	<input type="checkbox"/> Yes	<input type="checkbox"/> No
Condition of Ducts:	<input type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty
Damaged:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Where <input type="checkbox"/> N/A
Exhaust Fans:	<input type="checkbox"/> Upblast	<input type="checkbox"/> Inline	<input type="checkbox"/> Utility <input type="checkbox"/> Others

Location: <u>80 MTR</u>	Condition of Roof:
-------------------------	--------------------

LAST CLEANING DATE	CURRENT CLEANING DATE	NEXT CLEANING DATE
	<u>30-12-2019</u>	<u>29-12-2020</u>

### CHEMICALS AND EQUIPMENTS USED

<input checked="" type="checkbox"/> JETTING MACHINE	<input checked="" type="checkbox"/> INLET WATER HOSE	<input type="checkbox"/> EXTENTION CORDS	<input type="checkbox"/> VACCUM CLEANER
<input checked="" type="checkbox"/> LED LIGHTS	<input type="checkbox"/> PLASTICS ROLL/BAGS	<input checked="" type="checkbox"/> SUITABLE PPE	<input checked="" type="checkbox"/> DEGREASER CHEMICAL
<input checked="" type="checkbox"/> LADDER			

COMMENTS AND RECOMMENDATION: 6 nos DUCT CLEANED & DISINFECTED FINISHED.

Crystalline Representative: <u>C. ANSARI</u>	Signature: <u>[Signature]</u>
Customer Representative: <u>SABER AHMED</u>	Signature: <u>[Signature]</u>

## Kitchen Hood & Exhaust System Cleaning

Before Photo




After Photo



Before Photo




After Photo

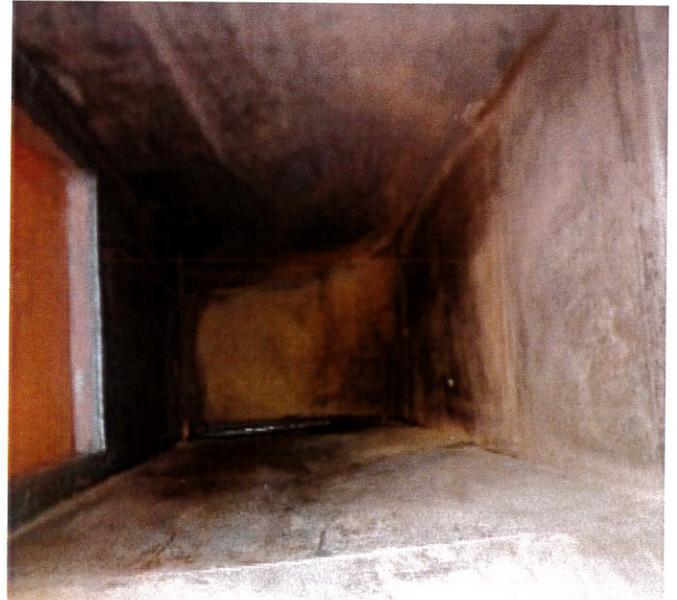


## Kitchen Hood & Exhaust System Cleaning

Before Photo

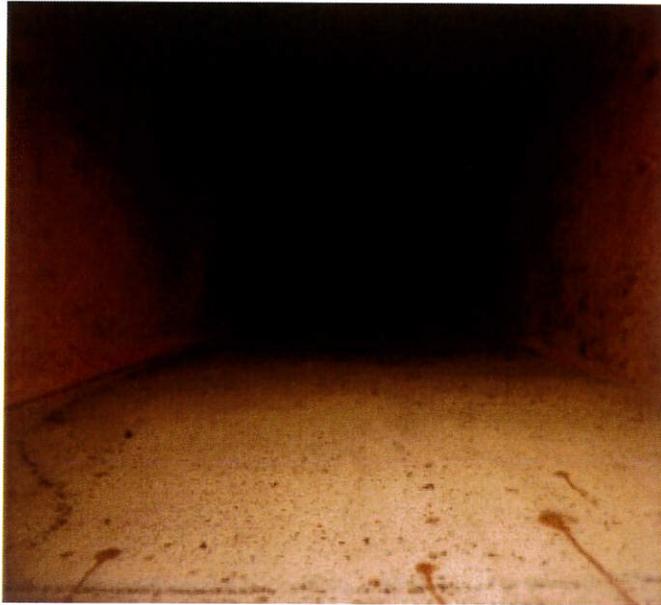

After Photo

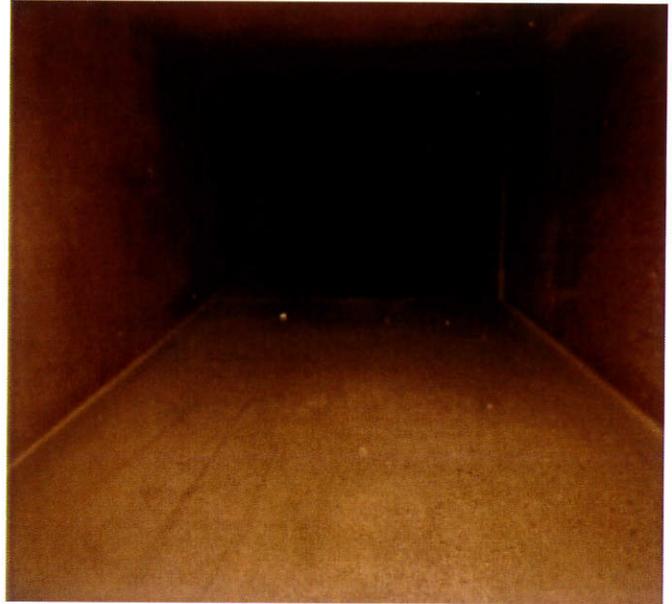

Before Photo



After Photo



## Kitchen Hood & Exhaust System Cleaning

Before Photo




After Photo



Before Photo



After Photo

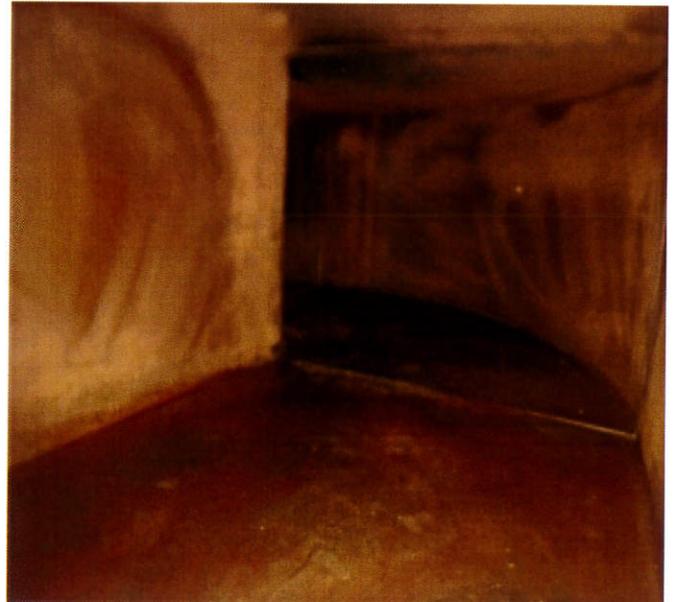



# CRYSTALLINE ENVIROMENTAL SERVICES

## KITCHEN EXHAUST SYSTEM - AFTER SERVICE REPORT

1862

CUSTOMER: <u>ICHADAMAT</u>	CONTACT PERSON: <u>MR. SHABEER</u>
SITE DETAILS: <u>UAEU UNIVERSITY</u>	CONTACT NUMBER: <u>056-403 8808</u>
NAME OF KITCHEN: <u>D1-KITCHEN</u>	LOCATION: <u>BASEMENT - 2</u>
TYPE OF BUILDING: <input type="checkbox"/> COMMERCIAL <input type="checkbox"/> HOTEL <input type="checkbox"/> RESIDENCIAL <input type="checkbox"/> RESTAURANT	

### Type & Size of Hood:

Cooking Volume:	<input type="checkbox"/> Very High	<input type="checkbox"/> High	<input type="checkbox"/> Medium	<input checked="" type="checkbox"/> Low
Type of Filters:	<input type="checkbox"/> Mesh	<input checked="" type="checkbox"/> Baffle	<input type="checkbox"/> N/A	
Filters in Place:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> N/A	
Filter Cleaning Freq.	<input type="checkbox"/> Daily	<input type="checkbox"/> Weekly	<input type="checkbox"/> Monthly	<input checked="" type="checkbox"/> Not Known

Comments:

### FIRE PROTECTION SYSTEM

Kitchen:	<input checked="" type="checkbox"/> Powder	<input checked="" type="checkbox"/> CO2	<input type="checkbox"/> Foam	<input checked="" type="checkbox"/> Other
Cooker Hoods:	<input checked="" type="checkbox"/> CO2	<input checked="" type="checkbox"/> Sprinkler	<input type="checkbox"/> Dry Powder	<input checked="" type="checkbox"/> Other
Fire Dampers:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	Fusible Links:	<input type="checkbox"/> Yes <input type="checkbox"/> No

### DUCTWORK

Duct Made of:	<input checked="" type="checkbox"/> Galvanized Steel	<input type="checkbox"/> Stainless Steel	<input type="checkbox"/> Other
Physical Entry:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Partly
Access with Tools only:	<input type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Partly
Vertical Access:	<input type="checkbox"/> Rope access	<input type="checkbox"/> Safety Harness	<input checked="" type="checkbox"/> N/A
Entire System Cleaned	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No if No, give details	

Comments

Doors/Plates Present:	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels
Doors/Plates Installed:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> No. of doors	<input type="checkbox"/> No of Panels

Where Installed:

Duct Size & Approx. Length:	Insulated:	<input type="checkbox"/> Yes	<input type="checkbox"/> No
Condition of Ducts:	<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty
Damaged:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Where <input type="checkbox"/> N/A
Exhaust Fans:	<input type="checkbox"/> Upblast	<input checked="" type="checkbox"/> Inline	<input type="checkbox"/> Utility <input type="checkbox"/> Others

Location: Condition of Roof:

LAST CLEANING DATE	CURRENT CLEANING DATE	NEXT CLEANING DATE
	<u>31/12/19</u>	<u>31/12/20</u>

### CHEMICALS AND EQUIPMENTS USED


<input type="checkbox"/> JETTING MACHINE	<input type="checkbox"/> INLET WATER HOSE	<input checked="" type="checkbox"/> EXTENTION CORDS	<input type="checkbox"/> VACCUM CLEANER
<input type="checkbox"/> LED LIGHTS	<input checked="" type="checkbox"/> PLASTICS ROLL/BAGS	<input checked="" type="checkbox"/> SUITABLE PPE	<input checked="" type="checkbox"/> DEGREASER CHEMICAL
<input checked="" type="checkbox"/> LADDER			

COMMENTS AND RECOMMENDATION: SINGLE HOOD CLEANED & DISINFECTION COMPLETED.

Crystalline Representative: <u>E. ANSARI</u>	Signature: <u>[Signature]</u>
Customer Representative: <u>SABEER AHMED</u>	Signature: <u>[Signature]</u>

## Kitchen Hood & Exhaust System Cleaning

Before Photo

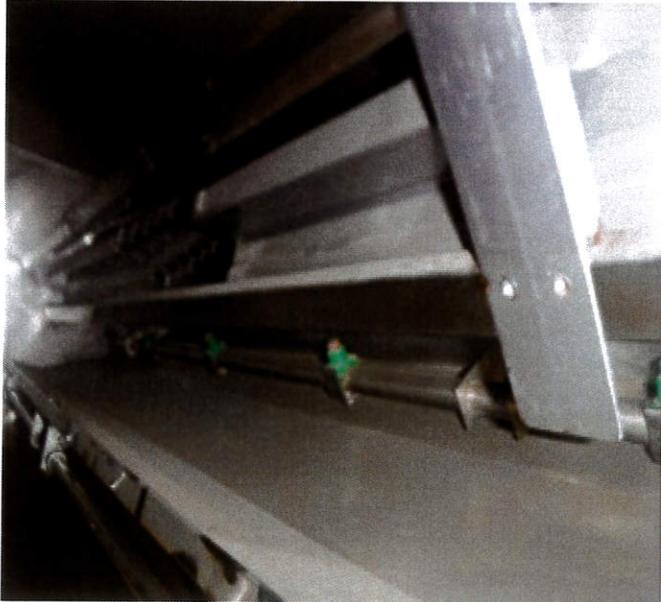


After Photo



Before Photo




After Photo

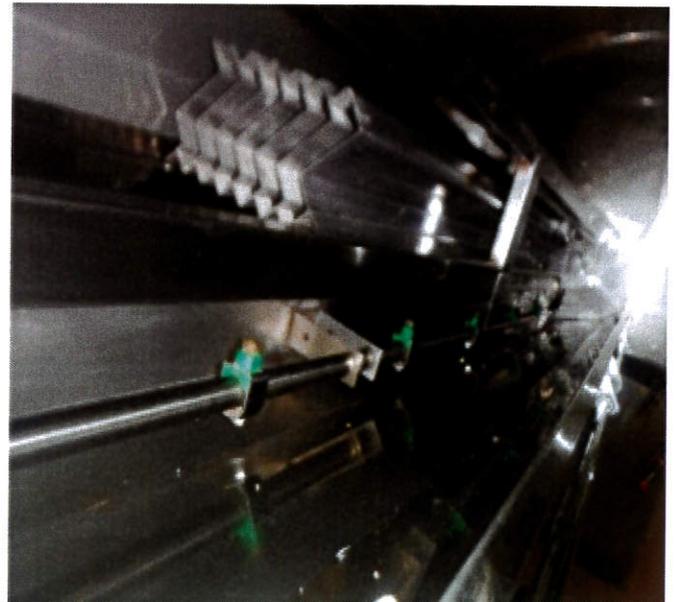

## Kitchen Hood & Exhaust System Cleaning

Before Photo

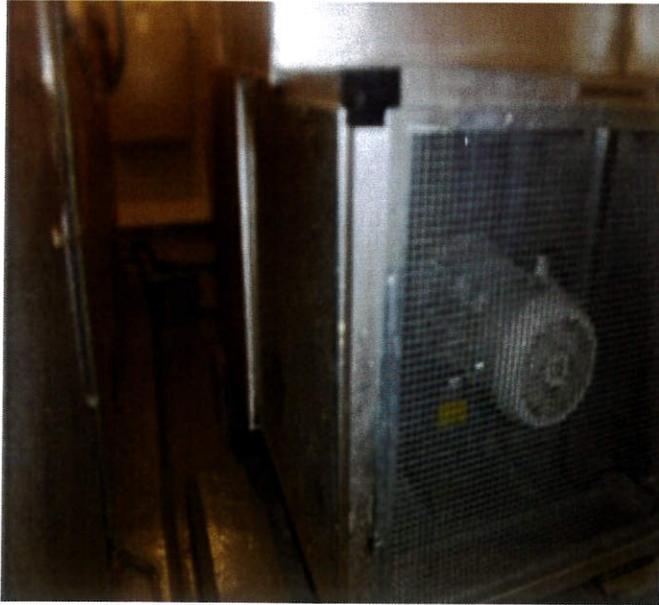

After Photo



Before Photo



After Photo



# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

CLIENT NAME : KHADAMAT FACILITIES MANAGEMENT LLC  
CLIENT ADDRESS : P.O BOX 66718, AL AIN, UAE.  
CONTACT PERSON : MR. AROCKIA JOHN PAUL  
SITE DETAILS : A11 BUILDING, UAE UNIVERSITY,  
AL AIN, UAE  
DETAILS : KITCHEN DUCTS, HOODS & FAN UNIT  
DATE OF CLEANING : DECEMBER 2019  
FREQUENCY OF CLEANING : EVERY ONE (1) YEAR  
DATE OF NEXT CLEANING : DECEMBER 2020

*The procedures employed in this cleaning and disinfection comply with Abu Dhabi Municipality guidelines*

*The entire Kitchen Duct should be cleaned and disinfected minimum every year depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

CLIENT NAME : KHADAMAT FACILITIES MANAGEMENT LLC  
CLIENT ADDRESS : P.O BOX 66718, AL AIN, UAE.  
CONTACT PERSON : MR. AROCKIA JOHN PAUL  
SITE DETAILS : D1 BUILDING, UAE UNIVERSITY,  
AL AIN, UAE  
DETAILS : KITCHEN DUCTS, HOODS & FAN UNIT  
DATE OF CLEANING : DECEMBER 2019  
FREQUENCY OF CLEANING : EVERY ONE (1) YEAR  
DATE OF NEXT CLEANING : DECEMBER 2020

*The procedures employed in this cleaning and disinfection comply with Abu Dhabi Municipality guidelines*

*The entire Kitchen Duct should be cleaned and disinfected minimum every year depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES