

**ENVIRONMENTAL  
SERVICES FOR  
A GREENER  
TOMORROW...  
ONE STEP AT  
A TIME.**



**CRYSTALLINE**  
ENVIRONMENTAL SERVICES



Completion Report for

## **Water Tank Cleaning & Disinfection**

Date: **30 October 2019**  
Client Name: **Al Raha Village**  
Contact Person: **Mr. Bashar Abu Salim**  
Designation: **QHSE**  
Site Detail: **Al Raha Village, Baniyas**



<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> GRP Elevated Water Tank 1		<b>Location:</b> Near Admin building	
<b>Type Of Building :</b> <input type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete	<input checked="" type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input checked="" type="checkbox"/> Very Dirty	<input type="checkbox"/> Dirty
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	<input type="checkbox"/> Moulds
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	<input type="checkbox"/> Mud & Sand
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half	<input type="checkbox"/> Empty	<input type="checkbox"/> Covered
		<input type="checkbox"/> Damaged	<input checked="" type="checkbox"/> NA
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
		<b>Pipes Disinfected</b>	
		<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 500ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 500ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		19 October 2019	
		<b>Next Cleaning Date</b>	
		19 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## GRP Elevated Water Tank 1

Before Photo




After Photo



Before Photo



After Photo

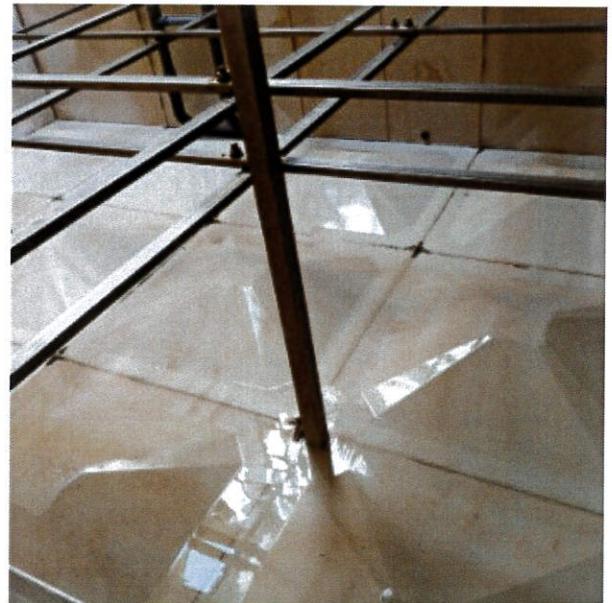

Mentioned tank has cleaned & disinfected

<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> GRP Elevated Water Tank 2		<b>Location:</b> Near Admin building	
<b>Type Of Building :</b> <input type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete	<input checked="" type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input checked="" type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<input type="checkbox"/> Clean		<input checked="" type="checkbox"/> Clean	
<input type="checkbox"/> Dirty		<input type="checkbox"/> Dirty	
<input type="checkbox"/> Very Dirty		<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms		<input type="checkbox"/> Biofilms	
<input type="checkbox"/> Moulds		<input type="checkbox"/> Moulds	
<input type="checkbox"/> Slime		<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments		<input type="checkbox"/> Sediments	
<input type="checkbox"/> Mud & Sand		<input type="checkbox"/> Mud & Sand	
<input type="checkbox"/> Rust		<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half	<input type="checkbox"/> Empty	
<input type="checkbox"/> Covered		<input type="checkbox"/> Damaged	
<input checked="" type="checkbox"/> NA			
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Leaks</b>			
<input type="checkbox"/> Yes		<input checked="" type="checkbox"/> No	
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Float Valve</b>			
<input checked="" type="checkbox"/> Yes		<input type="checkbox"/> No	
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Pipes Disinfected</b>			
<input type="checkbox"/> Yes		<input checked="" type="checkbox"/> No	
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 500ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 500ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		19 October 2019	
		<b>Next Cleaning Date</b>	
		19 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## GRP Elevated Water Tank 2

Before Photo



After Photo




Before Photo



After Photo



Mentioned tank has cleaned & disinfected

<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> GRP Elevated Water Tank 3		<b>Location:</b> Near Admin building	
<b>Type Of Building :</b>			
<input type="checkbox"/> Commercial		<input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others	
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete		<input checked="" type="checkbox"/> GRP Panel	
<input type="checkbox"/> Steel Panel		<input type="checkbox"/> FRP Tank	
<input type="checkbox"/> Others		<input type="checkbox"/> Concrete Coated	
<input type="checkbox"/> Plastic		<input type="checkbox"/> Galvanized	
<input type="checkbox"/> Mud & Sand		<input type="checkbox"/> Polyurethane	
<input type="checkbox"/> Rust			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean		<input checked="" type="checkbox"/> Clean	
<input type="checkbox"/> Dirty		<input type="checkbox"/> Dirty	
<input checked="" type="checkbox"/> Very Dirty		<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms		<input type="checkbox"/> Biofilms	
<input type="checkbox"/> Moulds		<input type="checkbox"/> Moulds	
<input type="checkbox"/> Slime		<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments		<input type="checkbox"/> Sediments	
<input type="checkbox"/> Mud & Sand		<input type="checkbox"/> Mud & Sand	
<input type="checkbox"/> Rust		<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full		<input type="checkbox"/> Covered	
<input checked="" type="checkbox"/> Half		<input type="checkbox"/> Damaged	
<input type="checkbox"/> Empty		<input checked="" type="checkbox"/> NA	
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Leaks</b>			
<input type="checkbox"/> Yes		<input checked="" type="checkbox"/> No	
<input checked="" type="checkbox"/> No			
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Float Valve</b>			
<input checked="" type="checkbox"/> Yes		<input type="checkbox"/> No	
<input type="checkbox"/> No			
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Pipes Disinfected</b>			
<input type="checkbox"/> Yes		<input checked="" type="checkbox"/> No	
<input checked="" type="checkbox"/> No			
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 500ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 500ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump		<input checked="" type="checkbox"/> High/low Pressure Jet	
<input checked="" type="checkbox"/> Foot Bath		<input checked="" type="checkbox"/> Extension Cords	
<input checked="" type="checkbox"/> Vacuum Cleaner		<input checked="" type="checkbox"/> Ventilating Fan	
<input checked="" type="checkbox"/> Cleaning Materials		<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<input checked="" type="checkbox"/> LED Lights		<input checked="" type="checkbox"/> Oxygen Meter	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		20 October 2019	
		<b>Next Cleaning Date</b>	
		20 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## GRP Elevated Water Tank 3

Before Photo



After Photo





Before Photo



After Photo



Mentioned tank has cleaned & disinfected
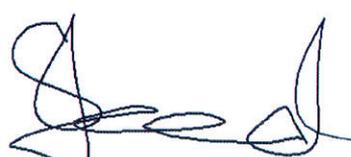
<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> GRP Elevated Water Tank 4		<b>Location:</b> Near Admin building	
<b>Type Of Building :</b>			
<input type="checkbox"/> Commercial		<input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others	
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete		<input checked="" type="checkbox"/> GRP Panel	
<input type="checkbox"/> Steel Panel		<input type="checkbox"/> FRP Tank	
<input type="checkbox"/> Others		<input type="checkbox"/> Galvanized	
<input type="checkbox"/> Plastic		<input type="checkbox"/> Concrete Coated	
<input type="checkbox"/> Mud & Sand		<input type="checkbox"/> Polyurethane	
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean		<input checked="" type="checkbox"/> Clean	
<input type="checkbox"/> Dirty		<input type="checkbox"/> Dirty	
<input checked="" type="checkbox"/> Very Dirty		<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms		<input type="checkbox"/> Biofilms	
<input type="checkbox"/> Moulds		<input type="checkbox"/> Moulds	
<input type="checkbox"/> Slime		<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments		<input type="checkbox"/> Sediments	
<input type="checkbox"/> Rust		<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full		<input type="checkbox"/> Covered	
<input checked="" type="checkbox"/> Half		<input type="checkbox"/> Damaged	
<input type="checkbox"/> Empty		<input checked="" type="checkbox"/> NA	
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
		<b>Pipes Disinfected</b>	
		<input type="checkbox"/> Yes	
		<input checked="" type="checkbox"/> No	
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 500ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 500ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump		<input checked="" type="checkbox"/> High/low Pressure Jet	
<input checked="" type="checkbox"/> Foot Bath		<input checked="" type="checkbox"/> Ladder	
<input checked="" type="checkbox"/> Vacuum Cleaner		<input checked="" type="checkbox"/> Cleaning Materials	
		<input checked="" type="checkbox"/> Extension Cords	
		<input checked="" type="checkbox"/> Ventilating Fan	
		<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<input checked="" type="checkbox"/> LED Lights		<input checked="" type="checkbox"/> Oxygen Meter	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		20 October 2019	
		<b>Next Cleaning Date</b>	
		20 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## GRP Elevated Water Tank 4

Before Photo



After Photo



Before Photo



After Photo



Mentioned tank has cleaned & disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : AL RAHA VILLGAE PROPERTIES LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABU SALIM.  
SITE DETAILS : AL RAHA VILLAGE, ABU DHABI.  
DETAILS : NEAR ADMIN BUILDING- WATER TANK 4 NOS  
DATE OF CLEANING : 19-20 OCTOBER 2019  
FREQUENCY OF CLEANING : EVERY YEAR  
DATE OF NEXT CLEANING : 19 OCTOBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be disinfected minimum every one (1) year depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> GRP Elevated Water Tank 1		<b>Location:</b> Civil Store	
<b>Type Of Building :</b>			
<input type="checkbox"/> Commercial		<input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others	
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete		<input checked="" type="checkbox"/> GRP Panel	
<input type="checkbox"/> Steel Panel		<input type="checkbox"/> FRP Tank	
<input type="checkbox"/> Others		<input type="checkbox"/> Concrete Coated	
<input type="checkbox"/> Plastic		<input type="checkbox"/> Galvanized	
<input type="checkbox"/> Mud & Sand		<input type="checkbox"/> Polyurethane	
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean		<input checked="" type="checkbox"/> Clean	
<input type="checkbox"/> Dirty		<input type="checkbox"/> Dirty	
<input checked="" type="checkbox"/> Very Dirty		<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms		<input type="checkbox"/> Biofilms	
<input type="checkbox"/> Moulds		<input type="checkbox"/> Moulds	
<input type="checkbox"/> Slime		<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments		<input type="checkbox"/> Sediments	
<input type="checkbox"/> Rust		<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full		<input type="checkbox"/> Covered	
<input checked="" type="checkbox"/> Half		<input type="checkbox"/> Damaged	
<input type="checkbox"/> Empty		<input checked="" type="checkbox"/> NA	
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
		<b>Pipes Disinfected</b>	
		<input type="checkbox"/> Yes	
		<input checked="" type="checkbox"/> No	
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 500ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 500ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump		<input checked="" type="checkbox"/> High/low Pressure Jet	
<input checked="" type="checkbox"/> Foot Bath		<input checked="" type="checkbox"/> Ladder	
<input checked="" type="checkbox"/> Vacuum Cleaner		<input checked="" type="checkbox"/> Cleaning Materials	
		<input checked="" type="checkbox"/> Extension Cords	
		<input checked="" type="checkbox"/> Ventilating Fan	
		<input checked="" type="checkbox"/> Suction/Discharge Hoses	
		<input checked="" type="checkbox"/> LED Lights	
		<input checked="" type="checkbox"/> Oxygen Meter	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		21 October 2019	
		<b>Next Cleaning Date</b>	
		21 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## GRP Elevated Water Tank 1

Before Photo



After Photo



Before Photo



After Photo



Mentioned tank has cleaned & disinfected

<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem			
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404			
<b>Description:</b> GRP Elevated Water Tank 2		<b>Location:</b> Civil Store			
<b>Type Of Building :</b> <input type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others					
<b>Type Of Tank</b>					
<input type="checkbox"/> Concrete	<input checked="" type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized		
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane		
<input type="checkbox"/> Others					
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>			
<input type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input checked="" type="checkbox"/> Very Dirty			
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime			
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust			
<b>Condition after cleaning</b>		<b>Condition after cleaning</b>			
<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty			
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime			
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust			
<b>Size of Tank</b>					
<b>M3:</b>		<b>USG:</b>			
		<b>L*B*H:</b>			
<b>Quantity Of Water</b>		<b>Manhole</b>			
<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half	<input type="checkbox"/> Empty			
<input type="checkbox"/> Covered	<input type="checkbox"/> Damaged	<input checked="" type="checkbox"/> NA			
<b>Ladder In</b>		<b>Ladder Out</b>		<b>Leaks</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>		<b>Float Valve</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>		<b>Pipes Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>					
<b>Chemical:</b> Carela bio				<b>Quantity:</b> 500ml	
<b>Chemical:</b> Carela plus				<b>Quantity:</b> 500ml	
<b>Equipments Used</b>					
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights		
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter		
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses			
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>		<b>Next Cleaning Date</b>	
-		22 October 2019		22 October 2020	
<b>Crystalline Representative</b>			<b>Customer Representative</b>		
					

## GRP Elevated Water Tank 2

Before Photo



After Photo



Before Photo



After Photo



Mentioned tank has cleaned & disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : AL RAHA VILLGAE PROPERTIES LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABU SALIM.  
SITE DETAILS : AL RAHA VILLAGE, ABU DHABI.  
DETAILS : WATER TANK LAUNDRY OUTSIDE- 5000 Gal  
DATE OF CLEANING : 26 OCTOBER 2019  
FREQUENCY OF CLEANING : EVERY YEAR  
DATE OF NEXT CLEANING : 26 OCTOBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be disinfected minimum every year depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> GRP Elevated Water Tank 1		<b>Location:</b> Plumbing Store	
<b>Type Of Building :</b>		<input type="checkbox"/> Commercial	<input checked="" type="checkbox"/> Residential
			<input type="checkbox"/> Others
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete	<input checked="" type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input checked="" type="checkbox"/> Very Dirty	<input type="checkbox"/> Dirty
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	<input type="checkbox"/> Moulds
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	<input type="checkbox"/> Rust
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	<b>L*B*H:</b>
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half	<input type="checkbox"/> Empty	<input type="checkbox"/> Covered
			<input type="checkbox"/> Damaged
			<input checked="" type="checkbox"/> NA
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
		<b>Pipes Disinfected</b>	
		<input type="checkbox"/> Yes	
		<input checked="" type="checkbox"/> No	
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 500ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 500ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		21 October 2019	
		<b>Next Cleaning Date</b>	
		21 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## GRP Elevated Water Tank 1


Before Photo




After Photo



Before Photo

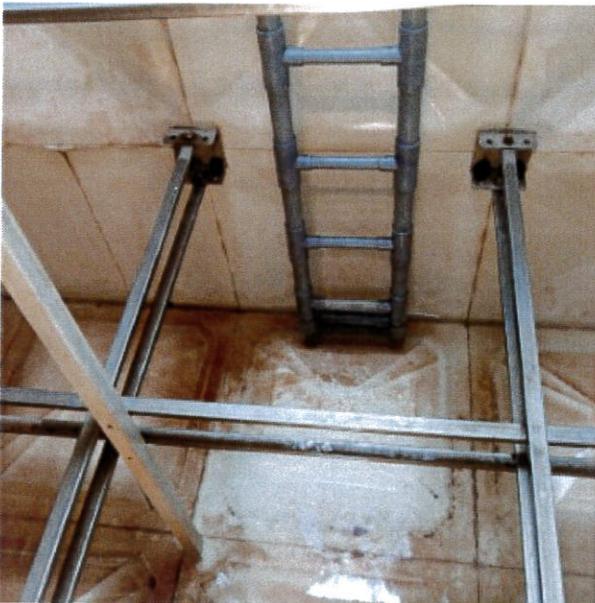

After Photo

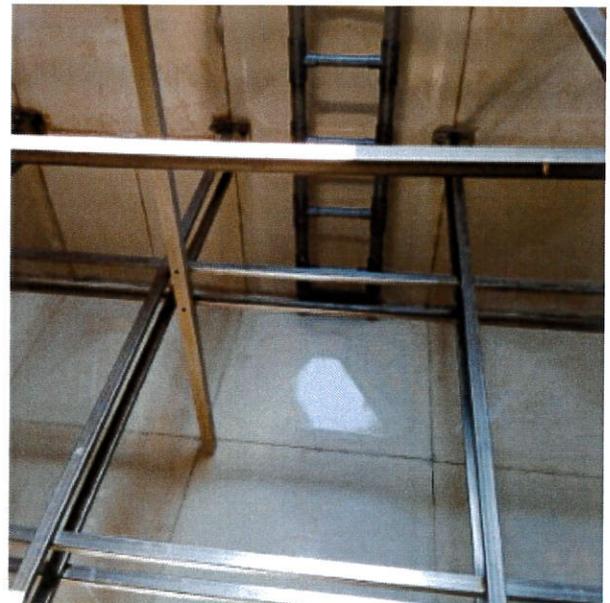

Mentioned tank has cleaned & disinfected

<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> GRP Elevated Water Tank 2		<b>Location:</b> Plumbing Store	
<b>Type Of Building :</b>			
<input type="checkbox"/> Commercial		<input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others	
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete		<input checked="" type="checkbox"/> GRP Panel	
<input type="checkbox"/> Steel Panel		<input type="checkbox"/> FRP Tank	
<input type="checkbox"/> Others		<input type="checkbox"/> Galvanized	
<input type="checkbox"/> Plastic		<input type="checkbox"/> Concrete Coated	
<input type="checkbox"/> Mud & Sand		<input type="checkbox"/> Polyurethane	
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean		<input checked="" type="checkbox"/> Clean	
<input type="checkbox"/> Dirty		<input type="checkbox"/> Dirty	
<input checked="" type="checkbox"/> Very Dirty		<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms		<input type="checkbox"/> Biofilms	
<input type="checkbox"/> Moulds		<input type="checkbox"/> Moulds	
<input type="checkbox"/> Slime		<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments		<input type="checkbox"/> Sediments	
<input type="checkbox"/> Rust		<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full		<input type="checkbox"/> Covered	
<input checked="" type="checkbox"/> Half		<input type="checkbox"/> Damaged	
<input type="checkbox"/> Empty		<input checked="" type="checkbox"/> NA	
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
		<b>Pipes Disinfected</b>	
		<input type="checkbox"/> Yes	
		<input checked="" type="checkbox"/> No	
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 500ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 500ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump		<input checked="" type="checkbox"/> High/low Pressure Jet	
<input checked="" type="checkbox"/> Foot Bath		<input checked="" type="checkbox"/> Ladder	
<input checked="" type="checkbox"/> Vacuum Cleaner		<input checked="" type="checkbox"/> Cleaning Materials	
		<input checked="" type="checkbox"/> Extension Cords	
		<input checked="" type="checkbox"/> Ventilating Fan	
		<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<input checked="" type="checkbox"/> LED Lights		<input checked="" type="checkbox"/> Oxygen Meter	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		22 October 2019	
		<b>Next Cleaning Date</b>	
		22 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## GRP Elevated Water Tank 2

Before Photo



After Photo



Before Photo



After Photo



Mentioned tank has cleaned & disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : AL RAHA VILLGAE PROPERTIES LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABU SALIM.  
SITE DETAILS : AL RAHA VILLAGE, ABU DHABI.  
DETAILS : PLUMBING STORES- WATER TANK 2 NOS  
DATE OF CLEANING : 21 & 22 OCTOBER 2019  
FREQUENCY OF CLEANING : EVERY YEAR  
DATE OF NEXT CLEANING : 21 OCTOBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be disinfected minimum every one (1) year depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> GRP Elevated Water Tank 2		<b>Location:</b> Diner 6, Cluster 2 Pump Room	
<b>Type Of Building :</b>			
<input type="checkbox"/> Commercial		<input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others	
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete		<input checked="" type="checkbox"/> GRP Panel	
<input type="checkbox"/> Steel Panel		<input type="checkbox"/> FRP Tank	
<input type="checkbox"/> Others		<input type="checkbox"/> Galvanized	
<input type="checkbox"/> Plastic		<input type="checkbox"/> Concrete Coated	
<input type="checkbox"/> Mud & Sand		<input type="checkbox"/> Polyurethane	
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean		<input checked="" type="checkbox"/> Clean	
<input type="checkbox"/> Dirty		<input type="checkbox"/> Dirty	
<input checked="" type="checkbox"/> Very Dirty		<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms		<input type="checkbox"/> Biofilms	
<input type="checkbox"/> Moulds		<input type="checkbox"/> Moulds	
<input type="checkbox"/> Slime		<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments		<input type="checkbox"/> Sediments	
<input type="checkbox"/> Rust		<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full		<input type="checkbox"/> Covered	
<input checked="" type="checkbox"/> Half		<input type="checkbox"/> Damaged	
<input type="checkbox"/> Empty		<input checked="" type="checkbox"/> NA	
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
		<b>Pipes Disinfected</b>	
		<input type="checkbox"/> Yes	
		<input checked="" type="checkbox"/> No	
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 500ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 500ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump		<input checked="" type="checkbox"/> High/low Pressure Jet	
<input checked="" type="checkbox"/> Foot Bath		<input checked="" type="checkbox"/> Ladder	
<input checked="" type="checkbox"/> Vacuum Cleaner		<input checked="" type="checkbox"/> Cleaning Materials	
		<input checked="" type="checkbox"/> Extension Cords	
		<input checked="" type="checkbox"/> Ventilating Fan	
		<input checked="" type="checkbox"/> Suction/Discharge Hoses	
		<input checked="" type="checkbox"/> LED Lights	
		<input checked="" type="checkbox"/> Oxygen Meter	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		23 October 2019	
		<b>Next Cleaning Date</b>	
		23 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## GRP Elevated Water Tank 2

Before Photo



After Photo



Before Photo



After Photo



Mentioned tank has cleaned & disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS



CLIENT NAME : AL RAHA VILLGAE PROPERTIES LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABU SALIM.  
SITE DETAILS : AL RAHA VILLAGE, ABU DHABI.  
DETAILS : W2 CLUSTER- WATER TANK 1 NO  
DATE OF CLEANING : 23 OCTOBER 2019  
FREQUENCY OF CLEANING : EVERY YEAR  
DATE OF NEXT CLEANING : 23 OCTOBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be disinfected minimum every one (1) year depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES
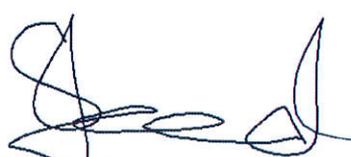
<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> GRP Elevated Water Tank 2		<b>Location:</b> Diner 5, Cluster 3 Pump Room	
<b>Type Of Building :</b>			
<input type="checkbox"/> Commercial		<input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others	
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete		<input checked="" type="checkbox"/> GRP Panel	
<input type="checkbox"/> Steel Panel		<input type="checkbox"/> FRP Tank	
<input type="checkbox"/> Others		<input type="checkbox"/> Galvanized	
<input type="checkbox"/> Plastic		<input type="checkbox"/> Concrete Coated	
<input type="checkbox"/> Mud & Sand		<input type="checkbox"/> Polyurethane	
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean		<input checked="" type="checkbox"/> Clean	
<input type="checkbox"/> Dirty		<input type="checkbox"/> Dirty	
<input checked="" type="checkbox"/> Very Dirty		<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms		<input type="checkbox"/> Biofilms	
<input type="checkbox"/> Moulds		<input type="checkbox"/> Moulds	
<input type="checkbox"/> Slime		<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments		<input type="checkbox"/> Sediments	
<input type="checkbox"/> Rust		<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full		<input type="checkbox"/> Covered	
<input checked="" type="checkbox"/> Half		<input type="checkbox"/> Damaged	
<input type="checkbox"/> Empty		<input checked="" type="checkbox"/> NA	
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
		<b>Pipes Disinfected</b>	
		<input type="checkbox"/> Yes	
		<input checked="" type="checkbox"/> No	
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 500ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 500ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump		<input checked="" type="checkbox"/> High/low Pressure Jet	
<input checked="" type="checkbox"/> Foot Bath		<input checked="" type="checkbox"/> Ladder	
<input checked="" type="checkbox"/> Vacuum Cleaner		<input checked="" type="checkbox"/> Cleaning Materials	
		<input checked="" type="checkbox"/> Extension Cords	
		<input checked="" type="checkbox"/> Ventilating Fan	
		<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<input checked="" type="checkbox"/> LED Lights		<input checked="" type="checkbox"/> Oxygen Meter	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		24 October 2019	
		<b>Next Cleaning Date</b>	
		24 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## GRP Elevated Water Tank 2

Before Photo



After Photo



Before Photo



After Photo



Mentioned tank has cleaned & disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS



CLIENT NAME : AL RAHA VILLGAE PROPERTIES LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABU SALIM.  
SITE DETAILS : AL RAHA VILLAGE, ABU DHABI.  
DETAILS : W3 CLUSTER- WATER TANK 1 NO  
DATE OF CLEANING : 24 OCTOBER 2019  
FREQUENCY OF CLEANING : EVERY YEAR  
DATE OF NEXT CLEANING : 24 OCTOBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be disinfected minimum every one (1) year depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES
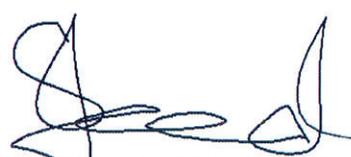
<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> Polycon Water Tank 1		<b>Location:</b> Laundry	
<b>Type Of Building :</b>		<input type="checkbox"/> Commercial	<input checked="" type="checkbox"/> Residential
			<input type="checkbox"/> Others
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete	<input checked="" type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input checked="" type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
		<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty
		<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds
		<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand
			<input type="checkbox"/> Rust
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	<b>L*B*H:</b>
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half	<input type="checkbox"/> Empty	
		<input type="checkbox"/> Covered	<input type="checkbox"/> Damaged
			<input checked="" type="checkbox"/> NA
<b>Ladder In</b>		<b>Ladder Out</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
		<b>Leaks</b>	
		<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
		<b>Float Valve</b>	
		<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
		<b>Pipes Disinfected</b>	
		<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 250ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 250ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		26 October 2019	
		<b>Next Cleaning Date</b>	
		25 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Polycon Water Tank 1

Before Photo



After Photo





Before Photo



After Photo



Mentioned tank has cleaned & disinfected
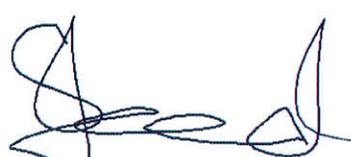
<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> Polycon Water Tank 2		<b>Location:</b> Laundry	
<b>Type Of Building :</b>		<input type="checkbox"/> Commercial	<input checked="" type="checkbox"/> Residential
			<input type="checkbox"/> Others
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete	<input checked="" type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input checked="" type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
		<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty
		<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds
		<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand
			<input type="checkbox"/> Rust
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	<b>L*B*H:</b>
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half	<input type="checkbox"/> Empty	
		<input type="checkbox"/> Covered	<input type="checkbox"/> Damaged
			<input checked="" type="checkbox"/> NA
<b>Ladder In</b>		<b>Ladder Out</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
		<b>Leaks</b>	
		<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
		<b>Float Valve</b>	
		<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
		<b>Pipes Disinfected</b>	
		<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 250ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 250ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		26 October 2019	
		<b>Next Cleaning Date</b>	
		25 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Polycon Water Tank 2

Before Photo



After Photo



Before Photo



After Photo




Mentioned tank has cleaned & disinfected


<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> Polycon Water Tank 3		<b>Location:</b> Laundry	
<b>Type Of Building :</b>			
<input type="checkbox"/> Commercial		<input checked="" type="checkbox"/> Residential	
<input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete		<input checked="" type="checkbox"/> GRP Panel	
<input type="checkbox"/> Steel Panel		<input type="checkbox"/> FRP Tank	
<input type="checkbox"/> Others		<input type="checkbox"/> Galvanized	
<input type="checkbox"/> Plastic		<input type="checkbox"/> Concrete Coated	
<input type="checkbox"/> Mud & Sand		<input type="checkbox"/> Polyurethane	
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean		<input checked="" type="checkbox"/> Clean	
<input type="checkbox"/> Dirty		<input type="checkbox"/> Dirty	
<input checked="" type="checkbox"/> Very Dirty		<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms		<input type="checkbox"/> Biofilms	
<input type="checkbox"/> Moulds		<input type="checkbox"/> Moulds	
<input type="checkbox"/> Slime		<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments		<input type="checkbox"/> Sediments	
<input type="checkbox"/> Rust		<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full		<input type="checkbox"/> Covered	
<input checked="" type="checkbox"/> Half		<input type="checkbox"/> Damaged	
<input type="checkbox"/> Empty		<input checked="" type="checkbox"/> NA	
<b>Ladder In</b>		<b>Ladder Out</b>	
<input type="checkbox"/> Yes		<input type="checkbox"/> Yes	
<input checked="" type="checkbox"/> No		<input checked="" type="checkbox"/> No	
<b>Leaks</b>		<b>Float Valve</b>	
<input type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input checked="" type="checkbox"/> No		<input type="checkbox"/> No	
<b>Drain Line</b>		<b>Valves</b>	
<input type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input checked="" type="checkbox"/> No		<input type="checkbox"/> No	
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
<b>Pipes Disinfected</b>		<input type="checkbox"/> Yes	
<input checked="" type="checkbox"/> No		<input checked="" type="checkbox"/> No	
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 250ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 250ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump		<input checked="" type="checkbox"/> High/low Pressure Jet	
<input checked="" type="checkbox"/> Foot Bath		<input checked="" type="checkbox"/> Ladder	
<input checked="" type="checkbox"/> Vacuum Cleaner		<input checked="" type="checkbox"/> Cleaning Materials	
<input checked="" type="checkbox"/> Extension Cords		<input checked="" type="checkbox"/> LED Lights	
<input checked="" type="checkbox"/> Ventilating Fan		<input checked="" type="checkbox"/> Oxygen Meter	
<input checked="" type="checkbox"/> Suction/Discharge Hoses			
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		26 October 2019	
		<b>Next Cleaning Date</b>	
		25 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Polycon Water Tank 3


Before Photo

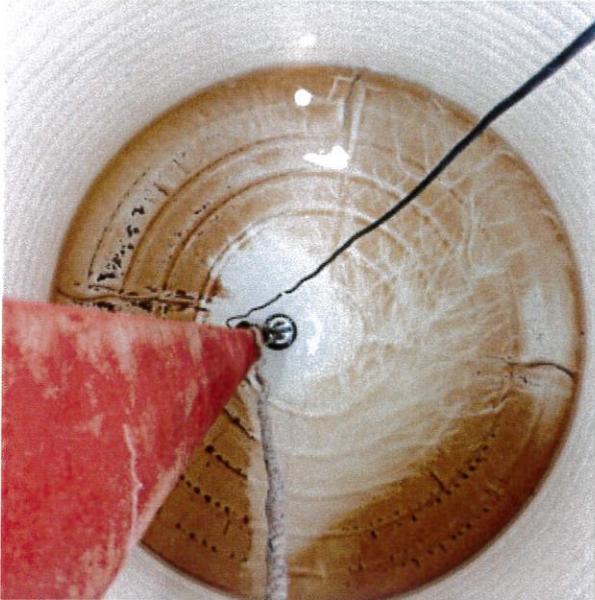


After Photo

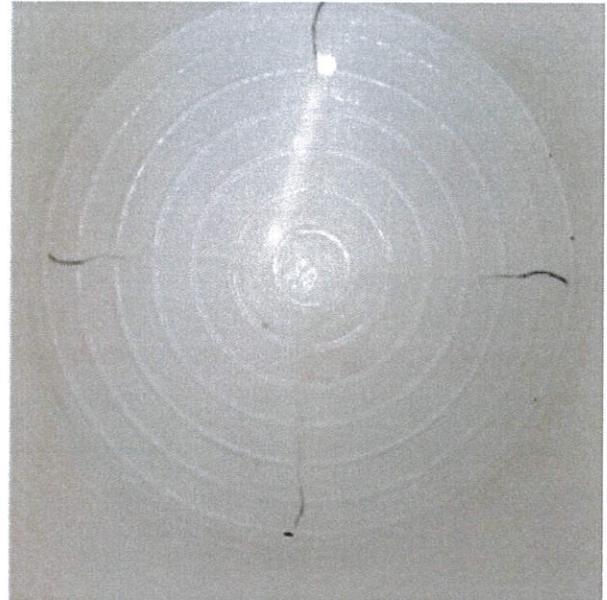



Before Photo

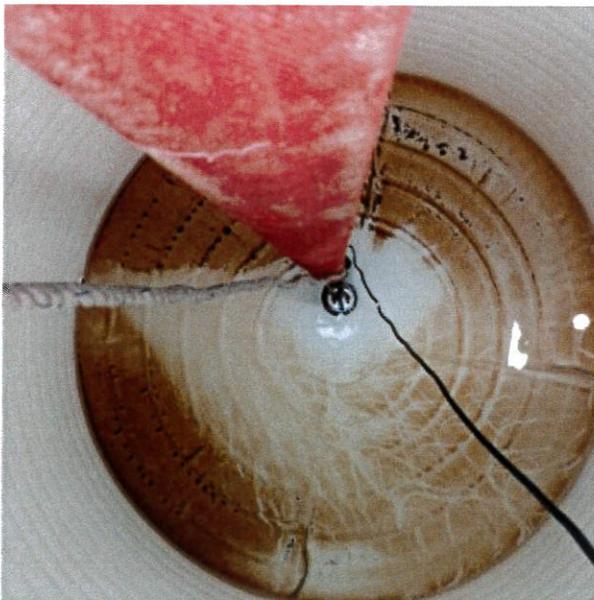

After Photo

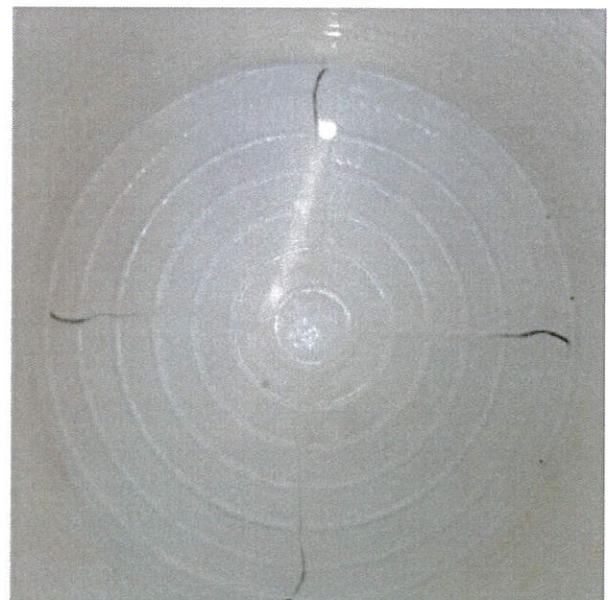

Mentioned tank has cleaned & disinfected
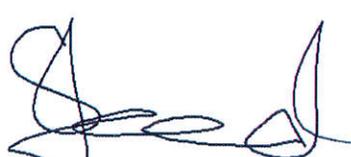
<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> Polycon Water Tank 4		<b>Location:</b> Laundry	
<b>Type Of Building :</b> <input type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete	<input checked="" type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input checked="" type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Condition after cleaning</b>		<b>Condition after cleaning</b>	
<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half	<input type="checkbox"/> Empty	
<input type="checkbox"/> Covered		<input type="checkbox"/> Damaged	
<input checked="" type="checkbox"/> NA			
<b>Ladder In</b>		<b>Ladder Out</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Leaks</b>		<b>Leaks</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Float Valve</b>		<b>Float Valve</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Pipes Disinfected</b>		<b>Pipes Disinfected</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 250ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 250ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		26 October 2019	
		<b>Next Cleaning Date</b>	
		25 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Polycon Water Tank 4


Before Photo



After Photo



Before Photo

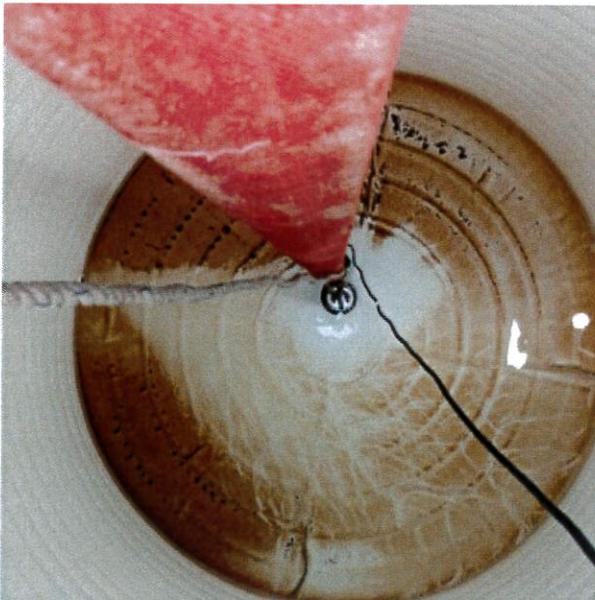

After Photo



Mentioned tank has cleaned & disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS



**CLIENT NAME** : AL RAHA VILLAGAE PROPERTIES LLC.  
**CLIENT ADDRESS** : P.O. BOX: 6634, ABU DHABI, UAE.  
**CONTACT PERSON** : MR. BASHAR ABU SALIM.  
**SITE DETAILS** : AL RAHA VILLAGE, ABU DHABI.  
**DETAILS** : WATER TANK LAUNDRY OUTSIDE- 3000 Gal  
**DATE OF CLEANING** : 26 OCTOBER 2019  
**FREQUENCY OF CLEANING** : EVERY YEAR  
**DATE OF NEXT CLEANING** : 26 OCTOBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be disinfected minimum every year depending upon the condition.*




CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

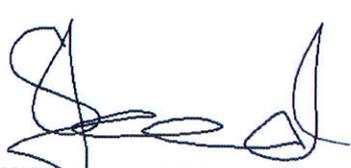
<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> Polycon Water Tank 1		<b>Location:</b> Kitchen 1	
<b>Type Of Building :</b> <input type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete	<input checked="" type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input checked="" type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Condition after cleaning</b>		<b>Condition after cleaning</b>	
<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half	<input type="checkbox"/> Empty	
<input type="checkbox"/> Covered		<input type="checkbox"/> Damaged	
<input checked="" type="checkbox"/> NA			
<b>Ladder In</b>		<b>Ladder Out</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Leaks</b>		<b>Leaks</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Float Valve</b>		<b>Float Valve</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Pipes Disinfected</b>		<b>Pipes Disinfected</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 250ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 250ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		27 October 2019	
		<b>Next Cleaning Date</b>	
		26 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Polycon Water Tank 1


Before Photo

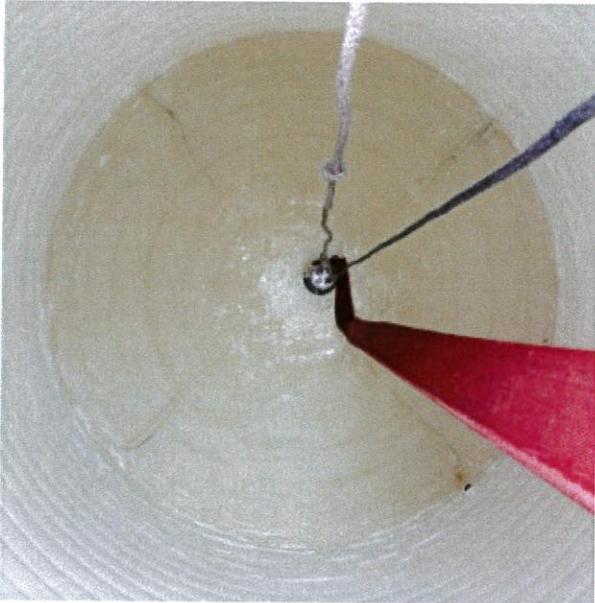


After Photo

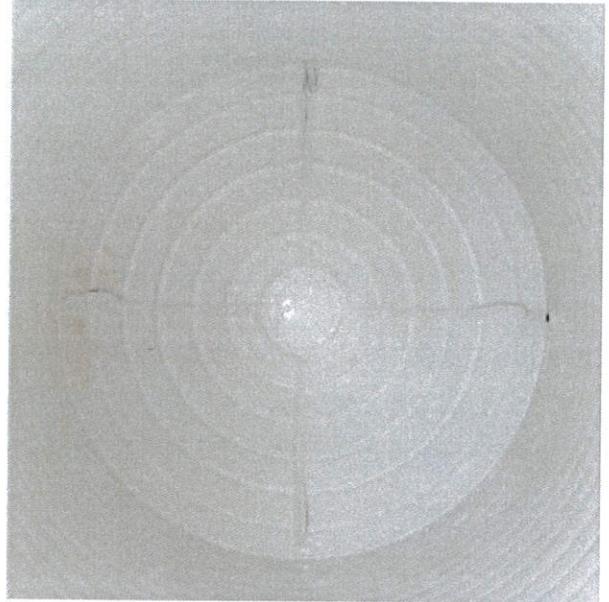

Before Photo

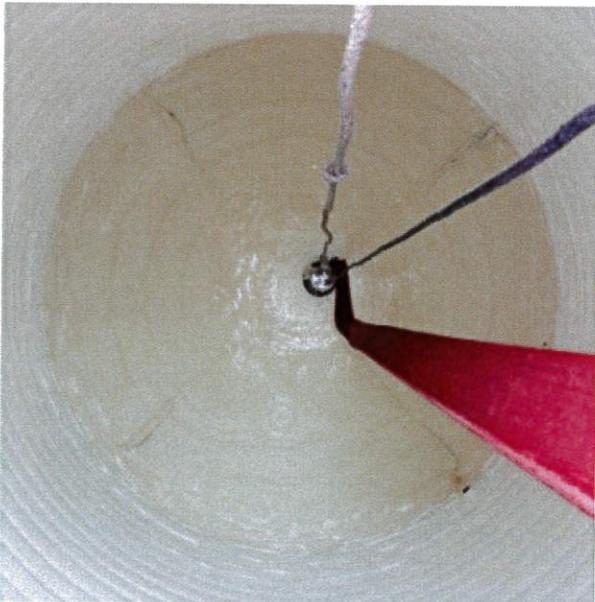

After Photo

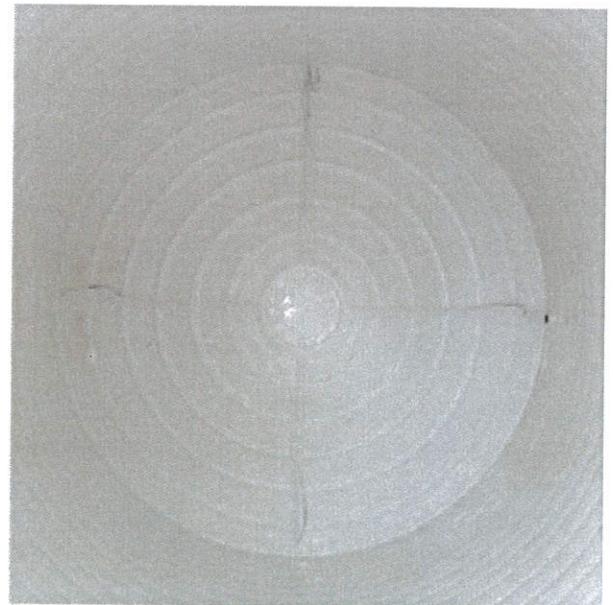

Mentioned tank has cleaned & disinfected


<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> Polycon Water Tank 2		<b>Location:</b> Kitchen 1	
<b>Type Of Building :</b> <input type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete	<input checked="" type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input checked="" type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>	<b>USG:</b>	<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half	<input type="checkbox"/> Empty	
<input type="checkbox"/> Covered		<input type="checkbox"/> Damaged	
<input checked="" type="checkbox"/> NA			
<b>Ladder In</b>		<b>Ladder Out</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Leaks</b>			
<input type="checkbox"/> Yes		<input checked="" type="checkbox"/> No	
<b>Drain Line</b>		<b>Valves</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Float Valve</b>			
<input checked="" type="checkbox"/> Yes		<input type="checkbox"/> No	
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Pipes Disinfected</b>			
<input type="checkbox"/> Yes		<input checked="" type="checkbox"/> No	
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 250ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 250ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>	<b>Current Cleaning Date</b>	<b>Next Cleaning Date</b>	
-	27 October 2019	26 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Polycon Water Tank 2

Before Photo




After Photo

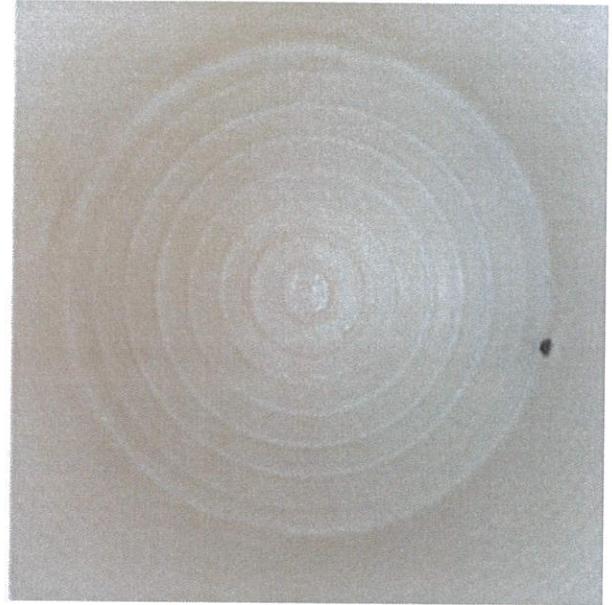

Before Photo



After Photo

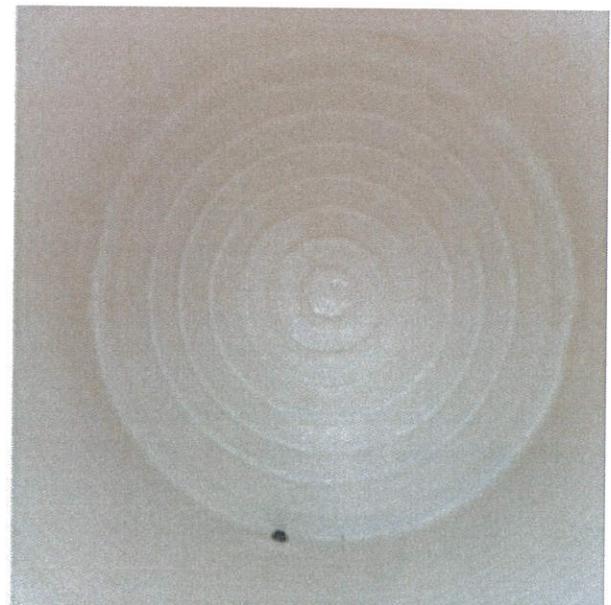

Mentioned tank has cleaned & disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : AL RAHA VILLGAE PROPERTIES LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABU SALIM.  
SITE DETAILS : AL RAHA VILLAGE, ABU DHABI.  
DETAILS : KITCHEN 1 OUTSIDE- WATER TANK 2 Nos  
DATE OF CLEANING : 27 OCTOBER 2019  
FREQUENCY OF CLEANING : EVERY YEAR  
DATE OF NEXT CLEANING : 27 OCTOBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be disinfected minimum every one year depending upon the condition.*




CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> Polycon Water Tank 3		<b>Location:</b> Kitchen 2	
<b>Type Of Building :</b> <input type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete	<input checked="" type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input checked="" type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<input type="checkbox"/> Clean		<input type="checkbox"/> Dirty	
<input type="checkbox"/> Biofilms		<input type="checkbox"/> Moulds	
<input type="checkbox"/> Sediments		<input type="checkbox"/> Mud & Sand	
<input type="checkbox"/> Very Dirty		<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Slime		<input type="checkbox"/> Slime	
<input type="checkbox"/> Rust		<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half	<input type="checkbox"/> Empty	
<input type="checkbox"/> Covered		<input type="checkbox"/> Damaged	
<input checked="" type="checkbox"/> NA			
<b>Ladder In</b>		<b>Ladder Out</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Leaks</b>			
<input type="checkbox"/> Yes		<input checked="" type="checkbox"/> No	
<b>Drain Line</b>		<b>Valves</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Float Valve</b>			
<input checked="" type="checkbox"/> Yes		<input type="checkbox"/> No	
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Pipes Disinfected</b>			
<input type="checkbox"/> Yes		<input checked="" type="checkbox"/> No	
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 250ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 250ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		27 October 2019	
		<b>Next Cleaning Date</b>	
		26 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Polycon Water Tank 3

Before Photo

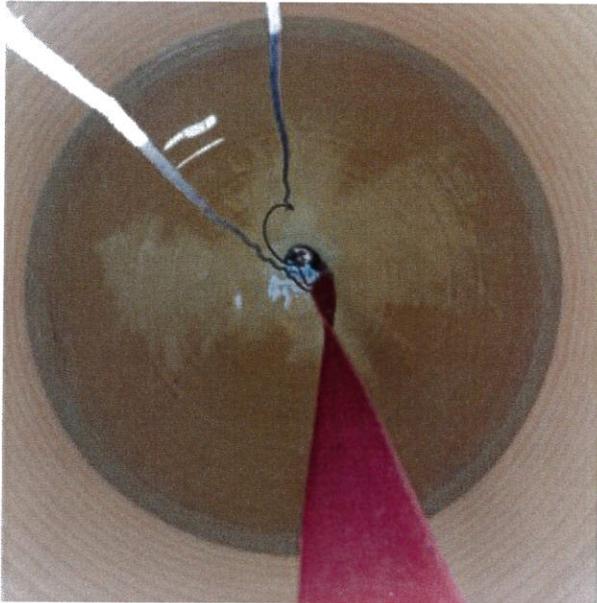

After Photo




Before Photo



After Photo




Mentioned tank has cleaned & disinfected

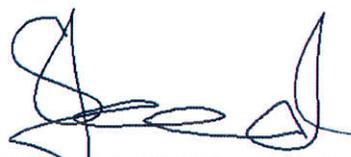
<b>Customer:</b> Al Raha Village		<b>Contact Person:</b> Mr. Bashar Abu Saleem	
<b>Site:</b> Al Raha Village		<b>Contact Number:</b> 050488 6404	
<b>Description:</b> Polycon Water Tank 4		<b>Location:</b> Kitchen 2	
<b>Type Of Building :</b>		<input type="checkbox"/> Commercial	<input checked="" type="checkbox"/> Residential
			<input type="checkbox"/> Others
<b>Type Of Tank</b>			
<input type="checkbox"/> Concrete	<input checked="" type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input checked="" type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
		<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty
		<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds
		<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand
			<input type="checkbox"/> Very Dirty
			<input type="checkbox"/> Slime
			<input type="checkbox"/> Rust
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	<b>L*B*H:</b>
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half	<input type="checkbox"/> Empty	
		<input type="checkbox"/> Covered	<input type="checkbox"/> Damaged
			<input checked="" type="checkbox"/> NA
<b>Ladder In</b>		<b>Ladder Out</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
		<b>Leaks</b>	
		<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
		<b>Float Valve</b>	
		<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
		<b>Pipes Disinfected</b>	
		<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>			
<b>Chemical:</b> Carela bio		<b>Quantity:</b> 250ml	
<b>Chemical:</b> Carela plus		<b>Quantity:</b> 250ml	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		27 October 2019	
		<b>Next Cleaning Date</b>	
		26 October 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Polycon Water Tank 4


Before Photo

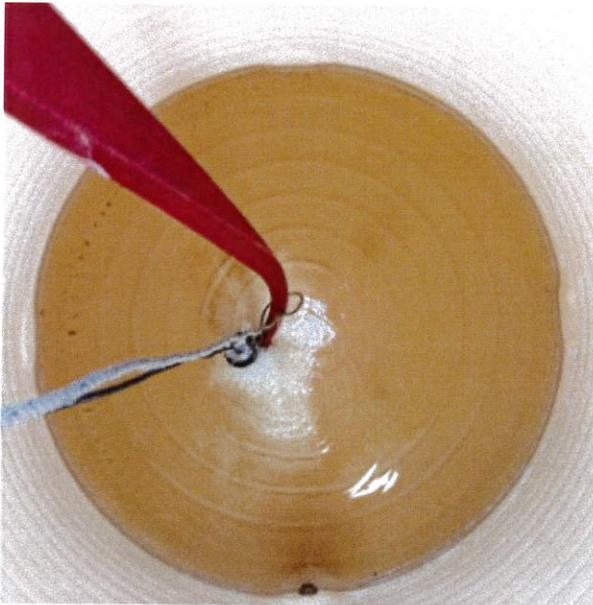


After Photo

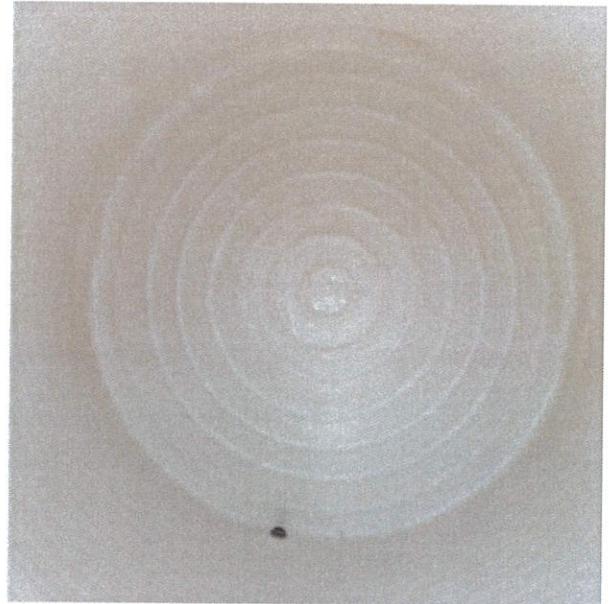

Before Photo

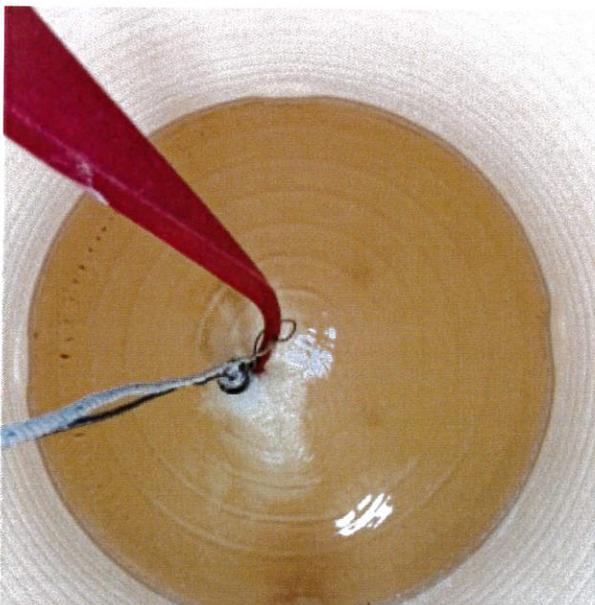

After Photo

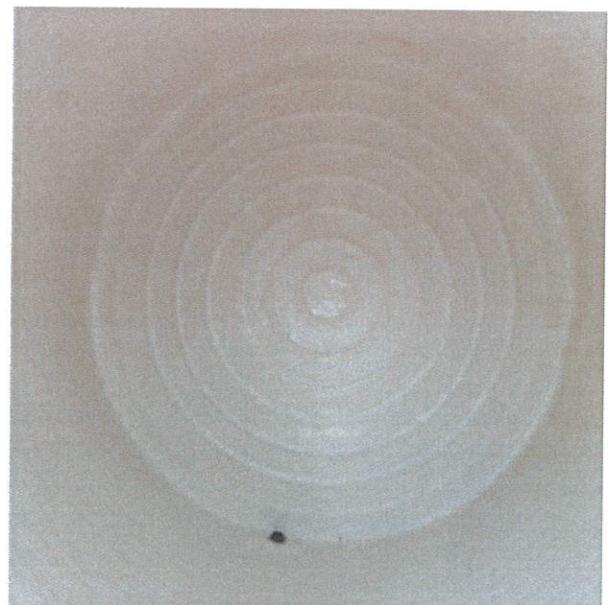

Mentioned tank has cleaned & disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : AL RAHA VILLGAE PROPERTIES LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABU SALIM.  
SITE DETAILS : AL RAHA VILLAGE, ABU DHABI.  
DETAILS : KITCHEN 2 OUTSIDE- WATER TANK 2 Nos  
DATE OF CLEANING : 27 OCTOBER 2019  
FREQUENCY OF CLEANING : EVERY YEAR  
DATE OF NEXT CLEANING : 27 OCTOBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be disinfected minimum every year depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES