


**ENVIRONMENTAL
SERVICES FOR
A GREENER
TOMORROW...
ONE STEP AT
A TIME.**



Completion Report for
Water Tank Cleaning & Disinfection

Date: **06 February 2020**
Client Name: **JUMEIRAH SAADIYAT ISLAND RESORT.**
Contact Person: **Mr. Sanal Pellissery Anto**
Designation: **Engineering Coordinator**
Site Detail: **Jumeriah Saadiyat Island Resort, Abu
Dhabi**

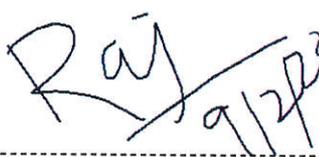


Customer: JUMEIRAH SAADIYAT ISLAND RESORT.		Contact Person: Mr. Sanal Pellissery Anto	
Site: Saadiyat, Abu Dhabi.		Contact Number: 0553776264	
Description: RCC Water Tank Cleaning		Location: Basement pump room tank 1	
Type Of Building :			
<input type="checkbox"/> Commercial		<input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others	
Type Of Tank			
<input checked="" type="checkbox"/> Concrete		<input type="checkbox"/> GRP Panel	
<input type="checkbox"/> Steel Panel		<input type="checkbox"/> FRP Tank	
<input type="checkbox"/> Others		<input type="checkbox"/> Concrete Coated	
<input type="checkbox"/> Plastic		<input type="checkbox"/> Galvanized	
<input type="checkbox"/> Mud & Sand		<input type="checkbox"/> Polyurethane	
<input type="checkbox"/> Rust			
Condition before cleaning		Condition after cleaning	
<input type="checkbox"/> Clean		<input checked="" type="checkbox"/> Clean	
<input checked="" type="checkbox"/> Dirty		<input type="checkbox"/> Dirty	
<input type="checkbox"/> Very Dirty		<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms		<input type="checkbox"/> Biofilms	
<input type="checkbox"/> Moulds		<input type="checkbox"/> Moulds	
<input type="checkbox"/> Slime		<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments		<input type="checkbox"/> Sediments	
<input checked="" type="checkbox"/> Mud & Sand		<input type="checkbox"/> Mud & Sand	
<input type="checkbox"/> Rust		<input type="checkbox"/> Rust	
Size of Tank			
M3:		USG:	
		L*B*H:	
Quantity Of Water		Manhole	
<input type="checkbox"/> Full		<input checked="" type="checkbox"/> Covered	
<input type="checkbox"/> Half		<input type="checkbox"/> Damaged	
<input checked="" type="checkbox"/> Empty		<input type="checkbox"/> NA	
Ladder In		Ladder Out	
<input checked="" type="checkbox"/> Yes		<input type="checkbox"/> Yes	
<input type="checkbox"/> No		<input checked="" type="checkbox"/> No	
Drain Line		Valves	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
Tank Cleaned		Tank Disinfected	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
		Pipes Disinfected	
		<input type="checkbox"/> Yes	
		<input checked="" type="checkbox"/> No	
Chemicals Used			
Chemical: Carela bio and plus		Quantity: 500 MI	
Chemical:		Quantity:	
Equipments Used			
<input checked="" type="checkbox"/> Submersibel Pump		<input type="checkbox"/> High/low Pressure Jet	
<input checked="" type="checkbox"/> Foot Bath		<input type="checkbox"/> Ladder	
<input type="checkbox"/> Vacuum Cleaner		<input checked="" type="checkbox"/> Cleaning Materials	
		<input checked="" type="checkbox"/> Extension Cords	
		<input checked="" type="checkbox"/> Ventilating Fan	
		<input checked="" type="checkbox"/> Suction/Discharge Hoses	
		<input checked="" type="checkbox"/> LED Lights	
		<input checked="" type="checkbox"/> Oxygen Meter	
Last Cleaning Date		Current Cleaning Date	
-		09 February 2020	
		Next Cleaning Date	
		08 July 2020	
Crystalline Representative		Customer Representative	
			

RCC Water Tank Cleaning

Before Photo




After Photo

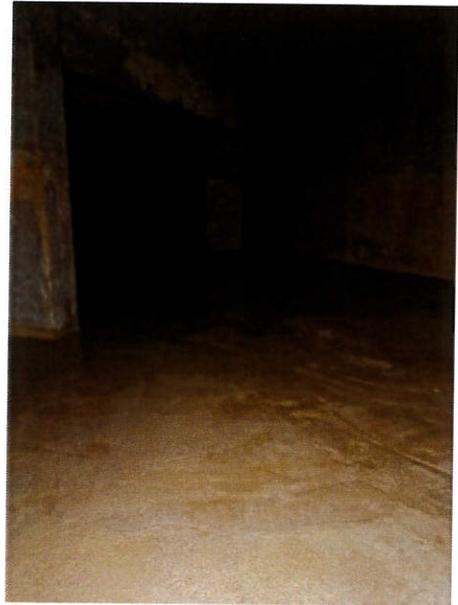

Before Photo



After Photo

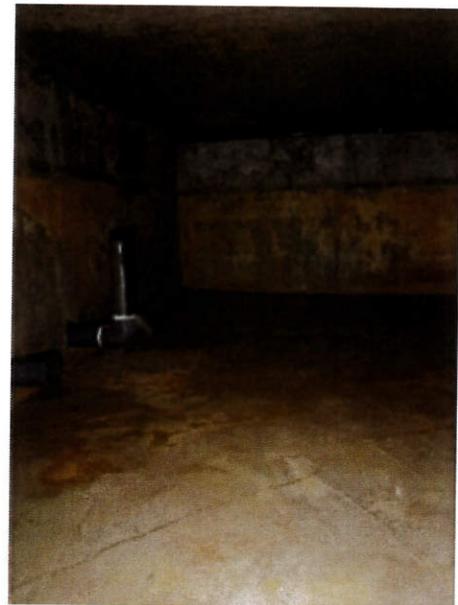

Water Tank is Cleaning and Disinfection

CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

CLEANING & DISINFECTION CERTIFICATE

CLIENT NAME : JUMEIRAH SAADIYAT ISLAND RESORT,

CONTACT PERSON : MR. SANAL PELLISSERY ANTO.

SITE DETAILS : JUMEIRAH SAADIYAT ISLAND RESORT,
ABU DHABI, UAE.

DETAILS : RCC WATER TANK CLEANING #1 (BASEMENT)

DATE OF CLEANING : 05 FEBRUARY 2020

FREQUENCY OF CLEANING : EVERY SIX MONTHS



DATE OF NEXT CLEANING : 04 AUGUST 2020

The procedures employed in this cleaning and disinfection comply with Abu Dhabi Municipality guidelines.

The entire water storage tanks should be cleaned and disinfected minimum every six (6) months depending upon the condition.



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

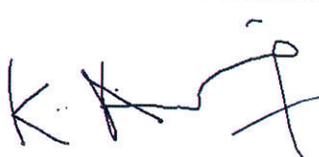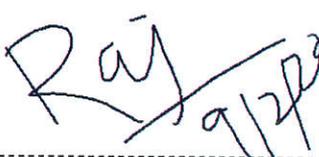Customer: JUMEIRAH SAADIYAT ISLAND RESORT.		Contact Person: Mr. Sanal Pellissery Anto	
Site: Saadiyat, Abu Dhabi.		Contact Number: 0553776264	
Description: RCC Water Tank Cleaning		Location: Basement pump room tank 2	
Type Of Building :			
<input type="checkbox"/> Commercial		<input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others	
Type Of Tank			
<input checked="" type="checkbox"/> Concrete		<input type="checkbox"/> GRP Panel	
<input type="checkbox"/> Steel Panel		<input type="checkbox"/> FRP Tank	
<input type="checkbox"/> Others		<input type="checkbox"/> Concrete Coated	
<input type="checkbox"/> Moulds		<input type="checkbox"/> Polyurethane	
<input type="checkbox"/> Plastic			
Condition before cleaning		Condition after cleaning	
<input type="checkbox"/> Clean		<input checked="" type="checkbox"/> Clean	
<input checked="" type="checkbox"/> Dirty		<input type="checkbox"/> Dirty	
<input type="checkbox"/> Very Dirty		<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms		<input type="checkbox"/> Biofilms	
<input type="checkbox"/> Moulds		<input type="checkbox"/> Moulds	
<input type="checkbox"/> Slime		<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments		<input type="checkbox"/> Sediments	
<input checked="" type="checkbox"/> Mud & Sand		<input type="checkbox"/> Mud & Sand	
<input type="checkbox"/> Rust		<input type="checkbox"/> Rust	
Size of Tank			
M3:		USG:	
		L*B*H:	
Quantity Of Water		Manhole	
<input type="checkbox"/> Full		<input checked="" type="checkbox"/> Covered	
<input type="checkbox"/> Half		<input type="checkbox"/> Damaged	
<input checked="" type="checkbox"/> Empty		<input type="checkbox"/> NA	
Ladder In		Ladder Out	
<input checked="" type="checkbox"/> Yes		<input type="checkbox"/> Yes	
<input type="checkbox"/> No		<input checked="" type="checkbox"/> No	
Drain Line		Valves	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
Tank Cleaned		Tank Disinfected	
<input checked="" type="checkbox"/> Yes		<input checked="" type="checkbox"/> Yes	
<input type="checkbox"/> No		<input type="checkbox"/> No	
		Pipes Disinfected	
		<input type="checkbox"/> Yes	
		<input checked="" type="checkbox"/> No	
Chemicals Used			
Chemical: Carela bio and plus		Quantity: 500 MI	
Chemical:		Quantity:	
Equipments Used			
<input checked="" type="checkbox"/> Submersibel Pump		<input type="checkbox"/> High/low Pressure Jet	
<input checked="" type="checkbox"/> Foot Bath		<input type="checkbox"/> Ladder	
<input type="checkbox"/> Vacuum Cleaner		<input checked="" type="checkbox"/> Cleaning Materials	
		<input checked="" type="checkbox"/> Extension Cords	
		<input checked="" type="checkbox"/> Ventilating Fan	
		<input checked="" type="checkbox"/> Suction/Discharge Hoses	
		<input checked="" type="checkbox"/> LED Lights	
		<input checked="" type="checkbox"/> Oxygen Meter	
Last Cleaning Date		Current Cleaning Date	
-		09 February 2020	
		Next Cleaning Date	
		08 July 2020	
Crystalline Representative		Customer Representative	
			

RCC Water Tank Cleaning


Before Photo




After Photo



Before Photo

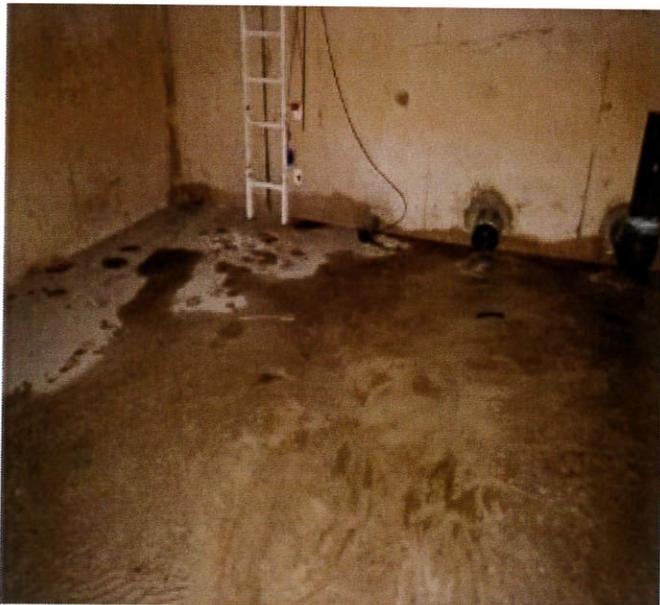

After Photo

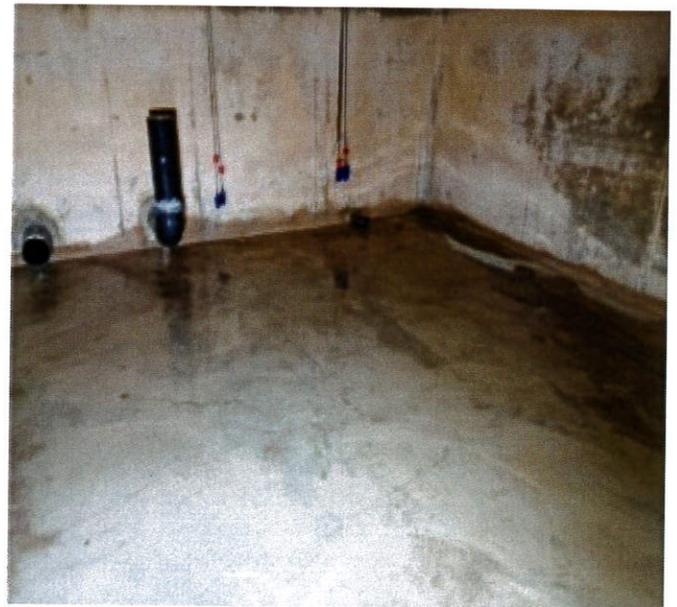

Water Tank is Cleaning and Disinfection

CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

CLEANING & DISINFECTION CERTIFICATE

CLIENT NAME : JUMEIRAH SAADIYAT ISLAND RESORT.

CONTACT PERSON : MR. SANAL PELLISSERY ANTO.

SITE DETAILS : JUMEIRAH SAADIYAT ISLAND RESORT,
ABU DHABI, UAE.

DETAILS : RCC WATER TANK CLEANING #2 (BASEMENT)

DATE OF CLEANING : 05 FEBRUARY 2020

FREQUENCY OF CLEANING : EVERY SIX MONTHS

DATE OF NEXT CLEANING : 04 AUGUST 2020

The procedures employed in this cleaning and disinfection comply with Abu Dhabi Municipality guidelines

The entire water storage tanks should be cleaned and disinfected minimum every six (6) months depending upon the condition.

Tasmanperito



CRYSTALLINE CLEANING AND ENVIRONMENTAL SE