

WATER TANK CLEANING & DISINFECTION

COMPLETION REPORT

FOR

APLEONA

HSG Facility Management

Client : Apleona HSG Facility Mgt. LLC.
Contact Person: Mr. Saif Khan
FM-Khalifa Port - KIZAD
Site Details : Khalifa Port, Abu Dhabi UAE.
Date : 23 May 2018



CRYSTALLINE
ENVIRONMENTAL SERVICES

CRYSTALLINE ENVIRONMENTAL
SERVICES

P.O. BOX 131463, Abu Dhabi, U.A.E.
TEL: 02 6508930 FAX: 02 6508942

info@crystalline-uae.com

www.crystalline-uae.com





CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT


13851

CUSTOMER: KIZAD			CONTACT PERSON:		
SITE DETAILS: WAREHOUSE			CONTACT NO: 052 751 06 03		
TANK DETAILS: DOMESTIC WATER TANK N°01			LOCATION DETAILS:		
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input checked="" type="checkbox"/> MOULDS	<input checked="" type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA					
LADDER IN		LADDER OUT		LEAKS	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO
DRAIN LINE		VALVES		FLOAT VALVE	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO <input type="checkbox"/> NA
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		11/05/2018		11/11/2018	
CHEMICALS & EQUIPMENTS USED					
1. Carelo bio Quantity 500 ml					
2. Carelo bio plus Quantity 500 ml					
<input checked="" type="checkbox"/> Submersibel Pump <input checked="" type="checkbox"/> High/Low Pressure Jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED lights <input checked="" type="checkbox"/> Foot Bath <input checked="" type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Meter <input checked="" type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
We mention that the water tank has been cleaned and disinfected					
Crystalline Representative: Patrick .k			Signature:		

Date of Cleaning: 11-05-2018

PHOTOGRAPHS
UNDER GROUND RCC WATER TANK - 01

BEFORE

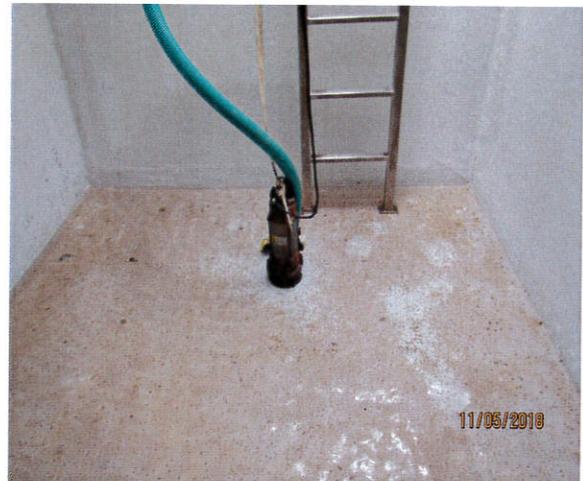

AFTER





CRYSTALLINE ENVIRONMENTAL SERVICES

WATER TANK - AFTER SERVICE REPORT


13852

CUSTOMER: KIZAD			CONTACT PERSON:		
SITE DETAILS: WAREHOUSE			CONTACT NO: 05275 10603		
TANK DETAILS: DOMESTIC WATER TANK NO.02			LOCATION DETAILS:		
TYPE OF BUILDING: <input checked="" type="checkbox"/> COMMERCIAL		<input type="checkbox"/> RESIDENTIAL		<input type="checkbox"/> OTHERS	
TYPE OF TANK					
<input checked="" type="checkbox"/> CONCRETE	<input type="checkbox"/> GRP PANEL	<input type="checkbox"/> FRP TANK	<input type="checkbox"/> GALVANIZED	<input type="checkbox"/> STEEL PANEL	<input type="checkbox"/> PLASTIC
<input type="checkbox"/> CONCRETE COATED		<input type="checkbox"/> POLYURETHANE	<input type="checkbox"/> OTHERS		
SIZE OF TANK			QUANTITY OF WATER		
M3	USG	L*B*H	<input type="checkbox"/> FULL	<input checked="" type="checkbox"/> HALF	<input type="checkbox"/> EMPTY
CONDITION OF WATER TANK BEFORE CLEANING			CONDITION OF WATER TANK AFTER CLEANING		
<input type="checkbox"/> CLEAN	<input checked="" type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY	<input checked="" type="checkbox"/> CLEAN	<input type="checkbox"/> DIRTY	<input type="checkbox"/> VERY DIRTY
<input type="checkbox"/> BIOFILMS	<input checked="" type="checkbox"/> MOULDS	<input checked="" type="checkbox"/> SLIME	<input type="checkbox"/> BIOFILMS	<input type="checkbox"/> MOULDS	<input type="checkbox"/> SLIME
<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST	<input type="checkbox"/> SEDIMENTS	<input type="checkbox"/> MUD & SAND	<input type="checkbox"/> RUST
ACCESS		MANHOLE		<input checked="" type="checkbox"/> COVERED	<input type="checkbox"/> DAMAGED
<input type="checkbox"/> NA	<input type="checkbox"/> NA			<input type="checkbox"/> NA	<input type="checkbox"/> NA
LADDER IN		LADDER OUT		LEAKS	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO
DRAIN LINE		VALVES		FLOAT VALVE	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO
TANK CLEANED		TANK DISINFECTED		PIPES DISINFECTED	
<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO
LAST CLEANING DATE		CURRENT CLEANING DATE		NEXT CLEANING DATE	
		11/05/2018		11/11/2018	
CHEMICALS & EQUIPMENTS USED					
1. Carebo bio Quantity 500 ml					
2. Carebo bio plus Quantity 500 ml					
<input checked="" type="checkbox"/> Submersibel Pump <input checked="" type="checkbox"/> High/Low Pressure Jet <input checked="" type="checkbox"/> Extension Cords <input checked="" type="checkbox"/> LED lights <input checked="" type="checkbox"/> Foot Bath <input checked="" type="checkbox"/> Ladder					
<input checked="" type="checkbox"/> Ventilating Fan <input checked="" type="checkbox"/> Suction/Discharge Hoses <input checked="" type="checkbox"/> Oxygen Meter <input checked="" type="checkbox"/> Vacuum Cleaner <input checked="" type="checkbox"/> Cleaning Materials					
COMMENTS & RECOMMENDATIONS:					
We mention that the water tank has been cleaned and disinfected					
Crystalline Representative: PATRIEK KOM			Signature:		



Date of Cleaning: 11-05-2018

PHOTOGRAPHS
UNDER GROUND RCC WATER TANK - 02

BEFORE

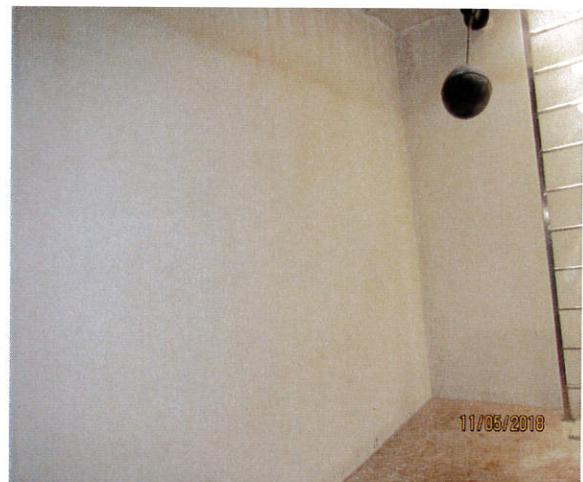

AFTER

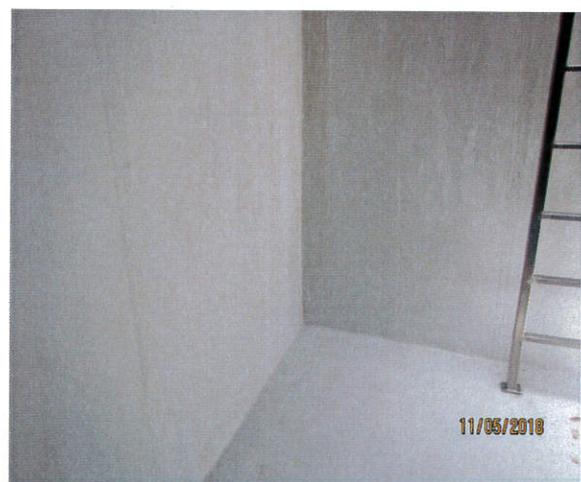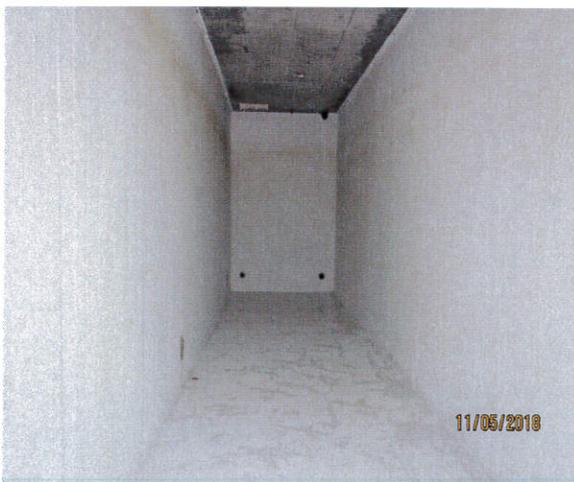

CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

CLEANING & DISINFECTION CERTIFICATE

POTABLE WATER TANKS

CLIENT NAME : APLEONA HSG FACILITY MGT. LLC.
CLIENT ADDRESS : P.O. BOX: 8925, BUSINESS BAY, DUBAI, UAE.
CONTACT PERSON : MR. SAIF KHAN
SITE DETAILS : KHALIFA PORT - KIZAD, ABU DHABI, UAE.
DETAILS : WATER TANK CLEANING
DATE OF CLEANING : 11 MAY 2018
FREQUENCY OF CLEANING : EVERY SIX MONTHS
DATE OF NEXT CLEANING : 11 NOVEMBER 2018

The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.

The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES