

**ENVIRONMENTAL  
SERVICES FOR  
A GREENER  
TOMORROW...  
ONE STEP AT  
A TIME.**



**CRYSTALLINE**  
ENVIRONMENTAL SERVICES



Completion Report for

## **Water Tank Cleaning & Disinfection**

Date: **06 June 2020**  
Client Name: **Workers Village Real Estate LLC**  
Contact Person: **Mr. Bashar Abu Salim**  
Designation: **Manager QHSES**  
Site Detail: **Workers Village, Mussafah, Abu  
Dhabi**



<b>Customer:</b> Workers Village Real Estate LLC		<b>Contact Person:</b> Mr. Bashar Abu Salim	
<b>Site:</b> Workers Village, Musaffah, Abu Dhabi		<b>Contact Number:</b> 0504886406	
<b>Description:</b> Under Ground RCC Water Tank Cleaning		<b>Location:</b> Kitchen #1, Part A	
<b>Type Of Building :</b> <input checked="" type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input checked="" type="checkbox"/> Concrete	<input type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	<input checked="" type="checkbox"/> Clean
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	<input type="checkbox"/> Dirty
<input type="checkbox"/> Sediments	<input checked="" type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	<input type="checkbox"/> Very Dirty
<input type="checkbox"/> Biofilms		<input type="checkbox"/> Moulds	
<input type="checkbox"/> Sediments		<input type="checkbox"/> Slime	
<input type="checkbox"/> Mud & Sand		<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input type="checkbox"/> Half	<input checked="" type="checkbox"/> Empty	<input checked="" type="checkbox"/> Covered
		<input type="checkbox"/> Damaged	<input type="checkbox"/> NA
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
		<b>Leaks</b>	
		<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
		<b>Float Valve</b>	
		<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
		<b>Pipes Disinfected</b>	
		<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>			
<b>Chemical:</b> Crystal Shc		<b>Quantity:</b> 3.5 ltr	
<b>Chemical:</b>		<b>Quantity:</b>	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		16 May 2020	
		<b>Next Cleaning Date</b>	
		16 November 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Under Ground RCC Water Tank Cleaning

Before Photo



After Photo



Before Photo



After Photo



Above mentioned water tank cleaned and disinfected

## Under Ground RCC Water Tank Cleaning

Before Photo



After Photo



Before Photo



After Photo



Above mentioned water tank cleaned and disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : WORKERS VILLAGE REAL ESTATE LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABUSALIM.  
SITE DETAILS : WORKERS VILLAGE, MUSSAFFAH.  
DETAILS : RCC WATER TANK – KITCHEN 1 (PART A)  
DATE OF CLEANING : 16 MAY 2020  
FREQUENCY OF CLEANING : EVERY SIX MONTHS  
DATE OF NEXT CLEANING : 16 NOVEMBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

<b>Customer:</b> Workers Village Real Estate LLC		<b>Contact Person:</b> Mr. Bashar Abu Salim	
<b>Site:</b> Workers Village, Musaffah, Abu Dhabi		<b>Contact Number:</b> 0504886406	
<b>Description:</b> Under Ground RCC Water Tank Cleaning		<b>Location:</b> Kitchen #1, Part B	
<b>Type Of Building :</b> <input checked="" type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input checked="" type="checkbox"/> Concrete	<input type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input checked="" type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Condition after cleaning</b>		<b>Condition after cleaning</b>	
<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input type="checkbox"/> Half	<input checked="" type="checkbox"/> Empty	
<input checked="" type="checkbox"/> Covered	<input type="checkbox"/> Damaged	<input type="checkbox"/> NA	
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Leaks</b>		<b>Leaks</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Float Valve</b>		<b>Float Valve</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Pipes Disinfected</b>		<b>Pipes Disinfected</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>			
<b>Chemical:</b> Crystal Shc		<b>Quantity:</b> 3. 5ltr	
<b>Chemical:</b>		<b>Quantity:</b>	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		30 May 2020	
		<b>Next Cleaning Date</b>	
		30 November 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Under Ground RCC Water Tank Cleaning

Before Photo




After Photo



Before Photo



After Photo

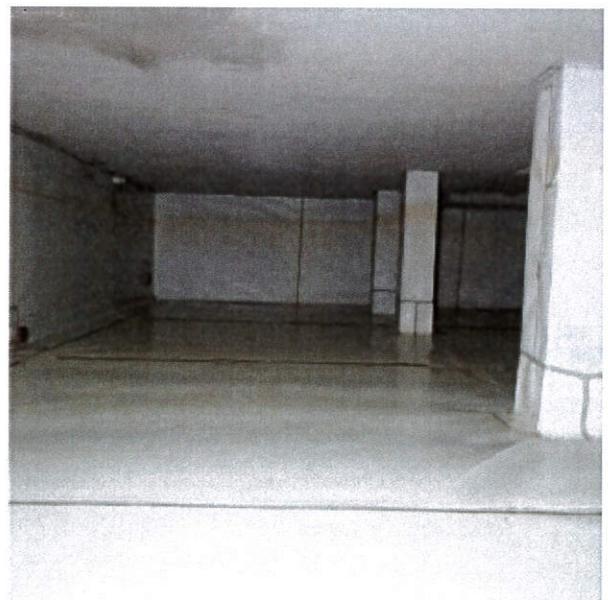

Above mentioned water tank cleaned and disinfected

## Under Ground RCC Water Tank Cleaning

Before Photo



After Photo



Before Photo



After Photo



Above mentioned water tank cleaned and disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : WORKERS VILLAGE REAL ESTATE LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABU SALIM.  
SITE DETAILS : WORKERS VILLAGE, MUSSAFFAH.  
DETAILS : RCC WATER TANK – KITCHEN 01 (PART B)  
DATE OF CLEANING : 30 MAY 2020  
FREQUENCY OF CLEANING : EVERY SIX MONTHS  
DATE OF NEXT CLEANING : 30 NOVEMBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

<b>Customer:</b> Workers Village Real Estate LLC		<b>Contact Person:</b> Mr. Bashar Abu Salim			
<b>Site:</b> Workers Village, Musaffah, Abu Dhabi		<b>Contact Number:</b> 0504886406			
<b>Description:</b> Under Ground RCC Water Tank Cleaning		<b>Location:</b> Kitchen #2, part A			
<b>Type Of Building :</b> <input checked="" type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others					
<b>Type Of Tank</b>					
<input checked="" type="checkbox"/> Concrete	<input type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized		
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane		
<input type="checkbox"/> Others					
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>			
<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	<input type="checkbox"/> Very Dirty		
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	<input type="checkbox"/> Slime		
<input type="checkbox"/> Sediments	<input checked="" type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	<input type="checkbox"/> Rust		
<b>Size of Tank</b>					
<b>M3:</b>		<b>USG:</b>			
		<b>L*B*H:</b>			
<b>Quantity Of Water</b>		<b>Manhole</b>			
<input type="checkbox"/> Full	<input type="checkbox"/> Half	<input checked="" type="checkbox"/> Empty	<input checked="" type="checkbox"/> Covered		
			<input type="checkbox"/> Damaged		
			<input type="checkbox"/> NA		
<b>Ladder In</b>		<b>Ladder Out</b>		<b>Leaks</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>		<b>Float Valve</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>		<b>Pipes Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>					
<b>Chemical:</b> Crystal Shc				<b>Quantity:</b> 3 ltr	
<b>Chemical:</b>				<b>Quantity:</b>	
<b>Equipments Used</b>					
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights		
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter		
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses			
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>		<b>Next Cleaning Date</b>	
-		18 May 2020		18 November 2020	
<b>Crystalline Representative</b>			<b>Customer Representative</b>		
					

## Under Ground RCC Water Tank Cleaning

Before Photo



After Photo



Before Photo



After Photo




Above mentioned water tank cleaned and disinfected

## Under Ground RCC Water Tank Cleaning


Before Photo



After Photo

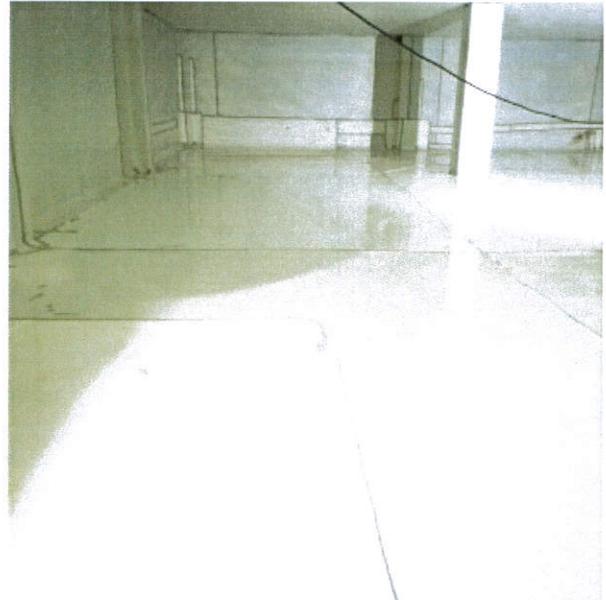

Before Photo

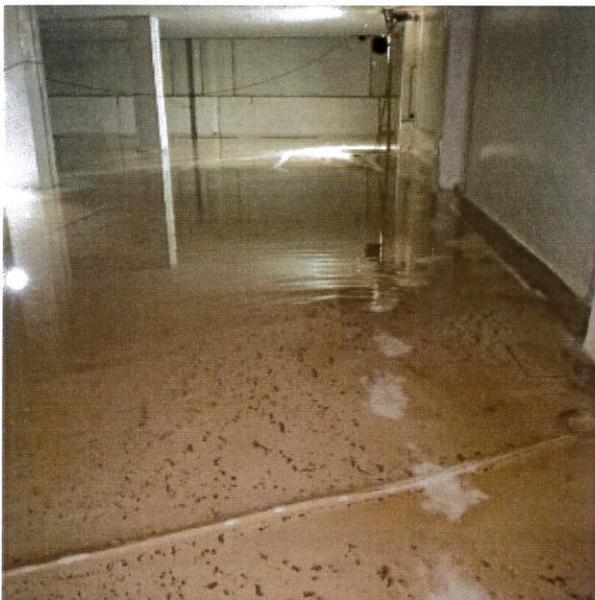

After Photo



Above mentioned water tank cleaned and disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : WORKERS VILLAGE REAL ESTATE LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABUSALIM.  
SITE DETAILS : WORKERS VILLAGE, MUSSAFFAH.  
DETAILS : RCC WATER TANK – KITCHEN o2 (PART A)  
DATE OF CLEANING : 18 MAY 2020  
FREQUENCY OF CLEANING : EVERY SIX MONTHS  
DATE OF NEXT CLEANING : 18 NOVEMBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES


<b>Customer:</b> Workers Village Real Estate LLC		<b>Contact Person:</b> Mr. Bashar Abu Salim	
<b>Site:</b> Workers Village, Musaffah, Abu Dhabi		<b>Contact Number:</b> 0504886406	
<b>Description:</b> Under Ground RCC Water Tank Cleaning		<b>Location:</b> Kitchen 02 , Part B	
<b>Type Of Building :</b> <input checked="" type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input checked="" type="checkbox"/> Concrete	<input type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input checked="" type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Condition after cleaning</b>		<b>Condition after cleaning</b>	
<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input type="checkbox"/> Half	<input checked="" type="checkbox"/> Empty	
<input checked="" type="checkbox"/> Covered	<input type="checkbox"/> Damaged	<input type="checkbox"/> NA	
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Leaks</b>		<b>Leaks</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Float Valve</b>		<b>Float Valve</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Pipes Disinfected</b>		<b>Pipes Disinfected</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>			
<b>Chemical:</b> Crystal Shc		<b>Quantity:</b> 3 ltr	
<b>Chemical:</b>		<b>Quantity:</b>	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
		01 June 2020	
<b>Next Cleaning Date</b>			
		01 December 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Under Ground RCC Water Tank Cleaning

Before Photo



After Photo

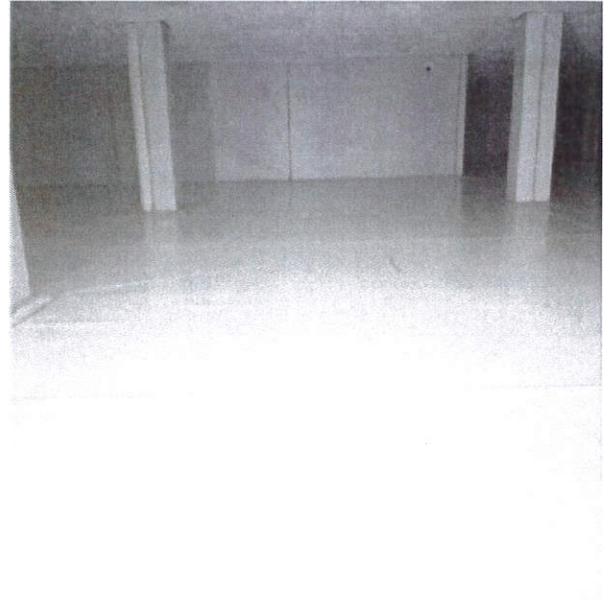

Before Photo



After Photo




Above mentioned water tank cleaned and disinfected

## Under Ground RCC Water Tank Cleaning

Before Photo




After Photo

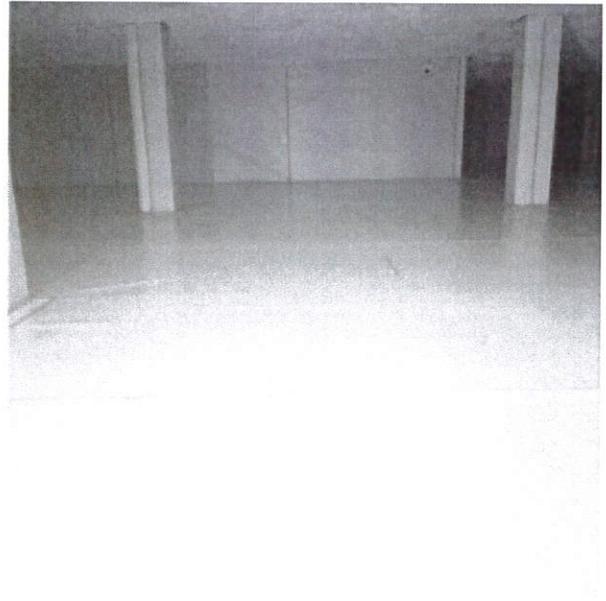

Before Photo



After Photo

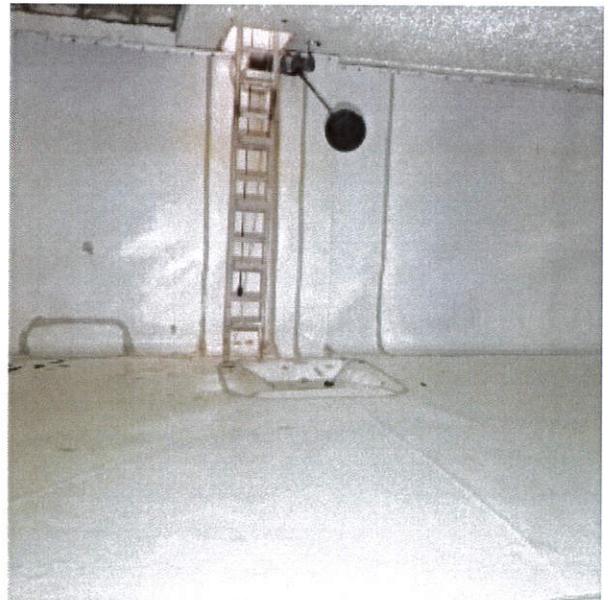

Above mentioned water tank cleaned and disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : WORKERS VILLAGE REAL ESTATE LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABUSALIM.  
SITE DETAILS : WORKERS VILLAGE, MUSSAFFAH.  
DETAILS : RCC WATER TANK – KITCHEN 2 (PART B)  
DATE OF CLEANING : 1 JUNE 2020  
FREQUENCY OF CLEANING : EVERY SIX MONTHS  
DATE OF NEXT CLEANING : 01 DECEMBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

<b>Customer:</b> Workers Village Real Estate LLC		<b>Contact Person:</b> Mr. Bashar Abu Salim	
<b>Site:</b> Workers Village, Musaffah, Abu Dhabi		<b>Contact Number:</b> 0504886406	
<b>Description:</b> Under Ground RCC Water Tank Cleaning		<b>Location:</b> Kitchen #3 Part A	
<b>Type Of Building :</b> <input checked="" type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input checked="" type="checkbox"/> Concrete	<input type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input checked="" type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Condition after cleaning</b>		<b>Condition after cleaning</b>	
<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input type="checkbox"/> Half	<input checked="" type="checkbox"/> Empty	
<input checked="" type="checkbox"/> Covered	<input type="checkbox"/> Damaged	<input type="checkbox"/> NA	
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Leaks</b>		<b>Leaks</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Float Valve</b>		<b>Float Valve</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Pipes Disinfected</b>		<b>Pipes Disinfected</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>			
<b>Chemical:</b> Crystal Shc		<b>Quantity:</b> 3 ltr	
<b>Chemical:</b>		<b>Quantity:</b>	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		20 May 2020	
		<b>Next Cleaning Date</b>	
		20 November 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Under Ground RCC Water Tank Cleaning


Before Photo




After Photo



Before Photo

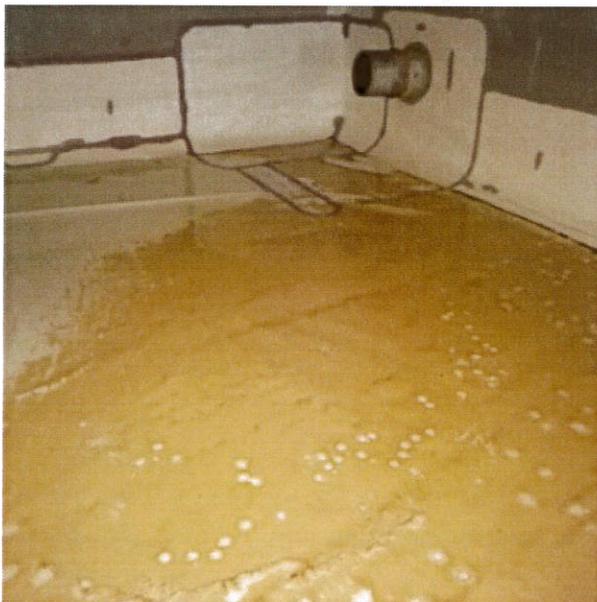

After Photo

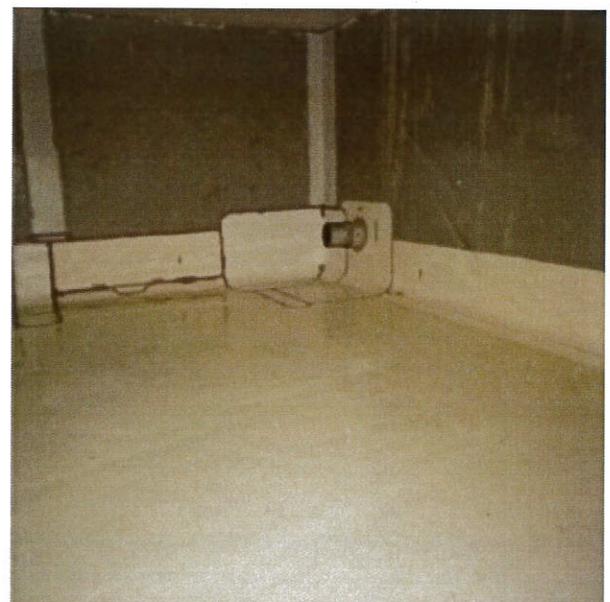

Above mentioned water tank cleaned and disinfected

## Under Ground RCC Water Tank Cleaning

Before Photo




After Photo



Before Photo



After Photo

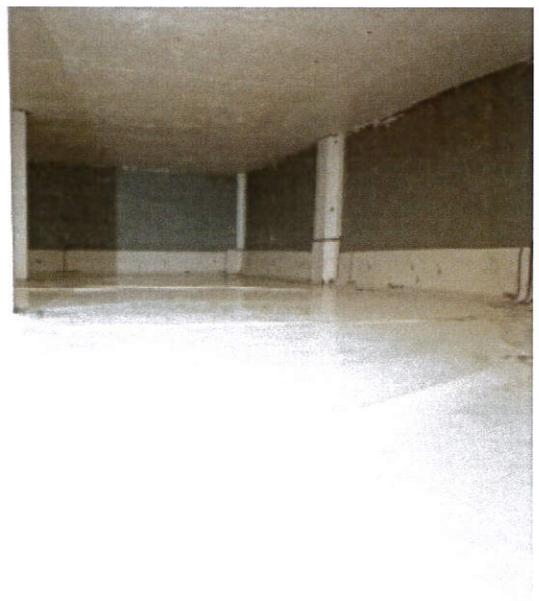

Above mentioned water tank cleaned and disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : WORKERS VILLAGE REAL ESTATE LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABUSALIM.  
SITE DETAILS : WORKERS VILLAGE, MUSSAFFAH.  
DETAILS : RCC WATER TANK – KITCHEN 3 (PART A)  
DATE OF CLEANING : 20 MAY 2020  
FREQUENCY OF CLEANING : EVERY SIX MONTHS  
DATE OF NEXT CLEANING : 20 NOVEMBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

<b>Customer:</b> Workers Village Real Estate LLC		<b>Contact Person:</b> Mr. Bashar Abu Salim	
<b>Site:</b> Workers Village, Musaffah, Abu Dhabi		<b>Contact Number:</b> 0504886406	
<b>Description:</b> Under Ground RCC Water Tank Cleaning		<b>Location:</b> Kitchen #3, Part B	
<b>Type Of Building :</b> <input checked="" type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input checked="" type="checkbox"/> Concrete	<input type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	<input checked="" type="checkbox"/> Clean
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	<input type="checkbox"/> Dirty
<input type="checkbox"/> Sediments	<input checked="" type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	<input type="checkbox"/> Very Dirty
		<input type="checkbox"/> Biofilms	
		<input type="checkbox"/> Moulds	
		<input type="checkbox"/> Slime	
		<input type="checkbox"/> Sediments	
		<input type="checkbox"/> Mud & Sand	
		<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input type="checkbox"/> Half	<input checked="" type="checkbox"/> Empty	<input checked="" type="checkbox"/> Covered
		<input type="checkbox"/> Damaged	<input type="checkbox"/> NA
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
		<b>Leaks</b>	
		<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
		<b>Float Valve</b>	
		<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
		<b>Pipes Disinfected</b>	
		<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>			
<b>Chemical:</b> Crystal Shc		<b>Quantity:</b> 04.ltr	
<b>Chemical:</b>		<b>Quantity:</b>	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		03 June 2020	
		<b>Next Cleaning Date</b>	
		03 December 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Under Ground RCC Water Tank Cleaning

Before Photo




After Photo



Before Photo



After Photo

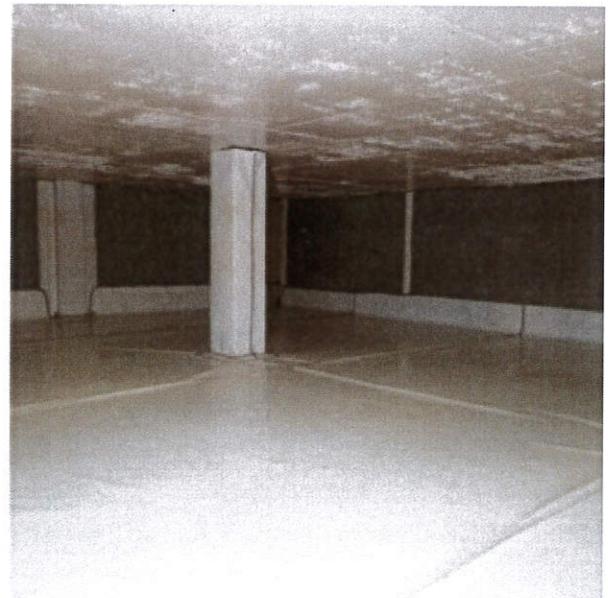

Above mentioned water tank cleaned and disinfected

## Under Ground RCC Water Tank Cleaning

Before Photo



After Photo



Before Photo



After Photo



Above mentioned water tank cleaned and disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : WORKERS VILLAGE REAL ESTATE LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABUSALIM.  
SITE DETAILS : WORKERS VILLAGE, MUSSAFFAH.  
DETAILS : RCC WATER TANK – KITCHEN 03 (PART B)  
DATE OF CLEANING : 3 JUNE 2020  
FREQUENCY OF CLEANING : EVERY SIX MONTHS  
DATE OF NEXT CLEANING : 03 DECEMBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

<b>Customer:</b> Workers Village Real Estate LLC		<b>Contact Person:</b> Mr. Bashar Abu Salim	
<b>Site:</b> Workers Village, Musaffah, Abu Dhabi		<b>Contact Number:</b> 0504886406	
<b>Description:</b> Under Ground RCC Water Tank Cleaning		<b>Location:</b> Old Dining #1, Part A	
<b>Type Of Building :</b> <input checked="" type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input checked="" type="checkbox"/> Concrete	<input type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input checked="" type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Condition after cleaning</b>		<b>Condition after cleaning</b>	
<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input type="checkbox"/> Half	<input checked="" type="checkbox"/> Empty	
		<input checked="" type="checkbox"/> Covered	<input type="checkbox"/> Damaged <input type="checkbox"/> NA
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Leaks</b>		<b>Leaks</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Float Valve</b>		<b>Float Valve</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Pipes Disinfected</b>		<b>Pipes Disinfected</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Chemicals Used</b>			
<b>Chemical:</b> Crystal Shc		<b>Quantity:</b> 3 ltr	
<b>Chemical:</b>		<b>Quantity:</b>	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		28 May 2020	
		<b>Next Cleaning Date</b>	
		28 November 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Under Ground RCC Water Tank Cleaning

Before Photo



After Photo



Before Photo



After Photo



Above mentioned water tank cleaned and disinfected

## Under Ground RCC Water Tank Cleaning

Before Photo



After Photo



Before Photo



After Photo



Above mentioned water tank cleaned and disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : WORKERS VILLAGE REAL ESTATE LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABUSALIM.  
SITE DETAILS : WORKERS VILLAGE, MUSSAFFAH.  
DETAILS : RCC WATER TANK – OLD DINING 1 (PART A)  
DATE OF CLEANING : 28 MAY 2020  
FREQUENCY OF CLEANING : EVERY SIX MONTHS  
DATE OF NEXT CLEANING : 28 NOVEMBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES

<b>Customer:</b> Workers Village Real Estate LLC		<b>Contact Person:</b> Mr. Bashar Abu Salim	
<b>Site:</b> Workers Village, Musaffah, Abu Dhabi		<b>Contact Number:</b> 0504886406	
<b>Description:</b> Under Ground RCC Water Tank Cleaning		<b>Location:</b> Old Dining #1, Part B	
<b>Type Of Building :</b> <input checked="" type="checkbox"/> Commercial <input checked="" type="checkbox"/> Residential <input type="checkbox"/> Others			
<b>Type Of Tank</b>			
<input checked="" type="checkbox"/> Concrete	<input type="checkbox"/> GRP Panel	<input type="checkbox"/> FRP Tank	<input type="checkbox"/> Galvanized
<input type="checkbox"/> Steel Panel	<input type="checkbox"/> Plastic	<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Polyurethane
<input type="checkbox"/> Others			
<b>Condition before cleaning</b>		<b>Condition after cleaning</b>	
<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input checked="" type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Condition after cleaning</b>		<b>Condition after cleaning</b>	
<input checked="" type="checkbox"/> Clean	<input type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	
<input type="checkbox"/> Biofilms	<input type="checkbox"/> Moulds	<input type="checkbox"/> Slime	
<input type="checkbox"/> Sediments	<input type="checkbox"/> Mud & Sand	<input type="checkbox"/> Rust	
<b>Size of Tank</b>			
<b>M3:</b>		<b>USG:</b>	
		<b>L*B*H:</b>	
<b>Quantity Of Water</b>		<b>Manhole</b>	
<input type="checkbox"/> Full	<input type="checkbox"/> Half	<input checked="" type="checkbox"/> Empty	
<input checked="" type="checkbox"/> Covered	<input type="checkbox"/> Damaged	<input type="checkbox"/> NA	
<b>Ladder In</b>		<b>Ladder Out</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
<b>Leaks</b>		<b>Leaks</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No		
<b>Drain Line</b>		<b>Valves</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Float Valve</b>		<b>Float Valve</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No		
<b>Tank Cleaned</b>		<b>Tank Disinfected</b>	
<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
<b>Pipes Disinfected</b>		<b>Pipes Disinfected</b>	
<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No		
<b>Chemicals Used</b>			
<b>Chemical:</b> Crystal Shc		<b>Quantity:</b> 3 ltr	
<b>Chemical:</b>		<b>Quantity:</b>	
<b>Equipments Used</b>			
<input checked="" type="checkbox"/> Submersibel Pump	<input checked="" type="checkbox"/> High/low Pressure Jet	<input checked="" type="checkbox"/> Extension Cords	<input checked="" type="checkbox"/> LED Lights
<input checked="" type="checkbox"/> Foot Bath	<input checked="" type="checkbox"/> Ladder	<input checked="" type="checkbox"/> Ventilating Fan	<input checked="" type="checkbox"/> Oxygen Meter
<input checked="" type="checkbox"/> Vacuum Cleaner	<input checked="" type="checkbox"/> Cleaning Materials	<input checked="" type="checkbox"/> Suction/Discharge Hoses	
<b>Last Cleaning Date</b>		<b>Current Cleaning Date</b>	
-		06 June 2020	
		<b>Next Cleaning Date</b>	
		06 December 2020	
<b>Crystalline Representative</b>		<b>Customer Representative</b>	
			

## Under Ground RCC Water Tank Cleaning

Before Photo




After Photo



Before Photo



After Photo

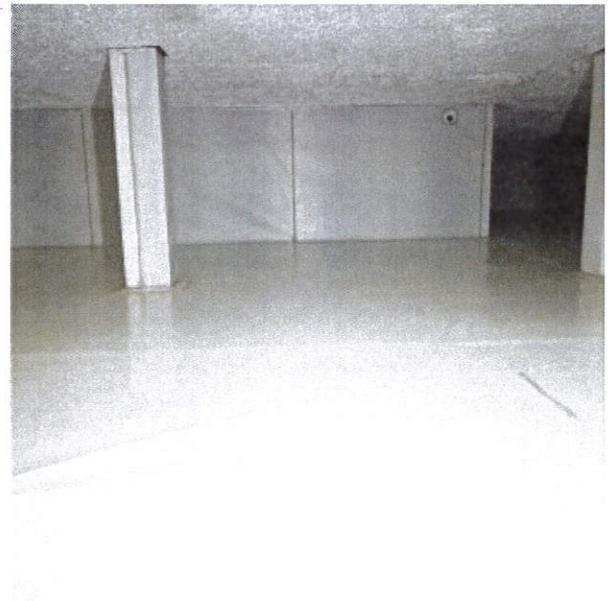

Above mentioned water tank cleaned and disinfected

## Under Ground RCC Water Tank Cleaning

Before Photo



After Photo



Before Photo



After Photo



Above mentioned water tank cleaned and disinfected

# CRYSTALLINE CLEANING & ENVIRONMENTAL SERVICES

## CLEANING & DISINFECTION CERTIFICATE

### POTABLE WATER TANKS

CLIENT NAME : WORKERS VILLAGE REAL ESTATE LLC.  
CLIENT ADDRESS : P.O. BOX: 6634, ABU DHABI, UAE.  
CONTACT PERSON : MR. BASHAR ABUSALIM.  
SITE DETAILS : WORKERS VILLAGE, MUSSAFFAH.  
DETAILS : RCC WATER TANK – OLD DINING 1 (PART B)  
DATE OF CLEANING : 06 JUNE 2020  
FREQUENCY OF CLEANING : EVERY SIX MONTHS  
DATE OF NEXT CLEANING : 06 DECEMBER 2020

*The procedures employed in this cleaning and disinfection comply with HS (G) 70 health and safety guidelines for prevention of legionella as well as BS6700 and CARELA BIO PLUS method statement.*

*The entire water storage tank should be cleaned and disinfected minimum every six (6) months depending upon the condition.*



CRYSTALLINE CLEANING AND ENVIRONMENTAL SERVICES